


www.villalighting.com

**LIGHTING FLOOR PLAN**  
SCALE 1/4" = 1'-0"

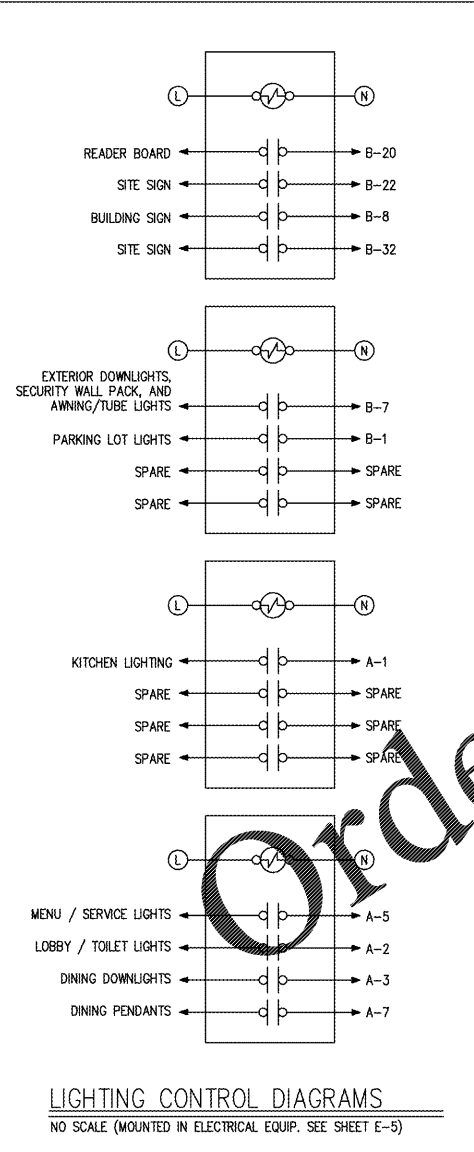


LIGHTING FIXTURE SCHEDULE							
TYPE	MANUFACTURER	CATALOG NUMBER	VOLT	QTY	LAMPS TYPE	MOUNTING	REMARKS
A	COOPER_LIGHTING HALO	H7T-LED14DR5630K	120	1	14W LED	RECESSED	EXTERIOR_DOWNLIGHT
B	COOPER_LIGHTING LUMARK	24FP4735C	120	1	18W LED	WALL	EXTERIOR_WALL_PACK
C	TEXAS_FLUORESCENTS	OSL-96L-F97W4800L-DMV-40K	120		48W LED'S	SURFACE	OUTDOOR_SIGN LIGHTER
C1	TEXAS_FLUORESCENTS	OSL-96L-F97W9600L-DMV-40K	120		97W LED'S	SURFACE	OUTDOOR_SIGN LIGHTER
C2	TEXAS_FLUORESCENTS	CUSTOM SIZE	120		148W LED'S	SURFACE	OUTDOOR_SIGN LIGHTER
D	SLIMLINE	701499C-B-10 / 701507-MODW / 400299-100 / 701572-25	120		LED'S	SURFACE	EXTERIOR_LED LIGHTING
E	COOPER_LIGHTING HALO	H7T-LED14DR5630K	120	1	14W LED	RECESSED	INTERIOR_DOWNLIGHT
F	BARBICAN	16-0424-10H-ACW-OA-LF-736-NT-BA-INC	120	2	7W LED	PENDANT	DRUM_PENDANT
G	HI-LITE_MFG	H-15112-11-CORD-LED11A	120	1	11W LED	PENDANT, 66" AFF	WAREHOUSE_SHADE PENDANT
H	COOPER_LIGHTING METALUX	24FP4735C	120		40.4W LED'S	RECESSED	2X4_LAY-IN
S	LUMARK	PFRV-X-A40-TX-25-0	120		143W LED	SEE STRUCTURAL SHEETS FOR POLE BASE	PARKING_LOT_LIGHT
X1	EXITRONIX	VLED-U-WH-EL90-R	120		INCLUDED	SURFACE	EXIT_LIGHT_WITH EMERGENCY_BATTERY
X2	EXITRONIX	LED-90	120		INCLUDED	SURFACE	EMERGENCY_LIGHT_WITH EMERGENCY_BATTERY
XR	EXITRONIX	MLED2-G-WP	120		INCLUDED	SURFACE, SEE ARCH. EXTERIOR ELEVATIONS OR RCP FOR MOUNTING HEIGHTS.	REMOTE_EMERGENCY LIGHTS

\* COLOR AND LENGTH TO BE DETERMINED. PROVIDE ALL ACCESSORIES AS REQUIRED FOR COMPLETE INSTALLATION.  
NOTES: LIGHTING FIXTURE PACKAGE TO BE PURCHASED THROUGH VILLA LIGHTING. CALL BRYAN BIRDWELL AT 1-800-325-0963 FOR ANY QUESTIONS REGARDING THE FIXTURE PACKAGE. NOT ALL LIGHT FIXTURE MAY BE ON PLAN.

- PLAN NOTES**
- EXIT AND EMERGENCY LIGHTING UNITS TO BE CONNECTED TO THE NL (NIGHT LIGHTING) CIRCUIT A-6 AND REMAIN ENERGIZED 24 HOURS IN COMPLIANCE WITH NEC 700-12(E) "UNIT EQUIPMENT". THE CIRCUIT FEEDING THE NIGHT LIGHTING AND EMERGENCY EQUIPMENT SHALL HAVE A LOCK ON THE BREAKER.
  - NIGHT LIGHT.
  - SEE THE ARCHITECTURAL EXTERIOR ELEVATIONS FOR MOUNTING HEIGHTS AND LOCATIONS OF THE EXTERIOR LIGHTING FIXTURES.
  - STEM AND ESCUTCHEONS FOR 'C/C1/C2' LIGHT FIXTURE TO BE INCLUDED IN FIXTURE PACKAGE. CENTER LIGHTS OVER AWNINGS, TYPICAL.
  - COORDINATE LIGHTS WITH WALK-IN MANUFACTURER FOR LOCATION OF CONNECTION POINTS. SEE SHEET E-3 FOR CIRCUITS.
  - J-BOX FOR HOOD CONTROLS. COORDINATE ALL REQUIREMENTS WITH HOOD SUPPLIER/INSTALLER.
  - J-BOX FOR CONNECTION TO BUILDING SIGN. COORDINATE EXACT LOCATION WITH ARCHITECTURAL DRAWINGS. COORDINATE ALL REQUIREMENTS WITH SIGN INSTALLER/SUPPLIER.

- GENERAL NOTES**
- SEE SHEET E-4 FOR ELECTRICAL PANEL SCHEDULES.
  - SEE SHEET E-8 FOR SPECIFICATIONS.
  - SEE SHEET E-6 FOR GENERAL ELECTRIC NOTES.
  - CONTRACTOR SHALL REFER TO THE ARCHITECTURAL REFLECTED CEILING PLAN FOR THE LOCATIONS OF THE LIGHTING FIXTURES IN RELATION TO THE CEILING GRID AND OTHER CEILING MOUNTED ITEMS. GRID TO BE ADJUSTED FOR COORDINATION WITH ROOF TRUSSES.
  - CONTRACTOR SHALL REFER TO THE ARCHITECTURAL ELEVATIONS (INTERIOR AND EXTERIOR) FOR THE LOCATIONS AND MOUNTING HEIGHTS OF WALL MOUNTED LIGHTING FIXTURES.
  - CONTRACTOR SHALL COORDINATE WITH THE SUPPLIER AND INSTALLER OF THE WALK-IN COOLER/FREEZER FOR THE ROUGH-IN LOCATIONS AND REQUIREMENTS FOR THE UNITS' LIGHTING. THE WALK-IN UNITS' LIGHTING IS TO BE PRE-WIRED TO A JUNCTION BOX.
  - ALL LIGHT FIXTURE LAMPS SHALL BE SHIELDED, COATED, OR OTHERWISE SHATTER-RESISTANT LAMPS WHERE THERE IS EXPOSED FOOD, CLEAN EQUIPMENT, UTENSILS, LINENS, OR UNWRAPPED SINGLE SERVICE AND SINGLE USE ARTICLES.

A NEW LOCATION FOR  
**CAPTAIN D'S**  
 7525 STATE AVENUE  
 KANSAS CITY, KS 66112  
**CAPTAIN D'S, LLC**  
 624 GRASSMERE PARK DRIVE,  
 SUITE 30  
 NASHVILLE, TN 37211



**Job Number:** \_\_\_\_\_  
**Revisions:** \_\_\_\_\_

E-1

LIGHTING FLOOR PLAN