


GENERAL NOTES

- CONTRACTOR SHALL COORDINATE ALL ELECTRICAL CONSTRUCTION WITH OTHER TRADES TO AVOID CONFLICTS.
- CONTRACTOR SHALL VERIFY THERE IS NO OVERLOADING OF BRANCH CIRCUITS AND/OR PANELBOARDS REGARDLESS OF CIRCUITRY INDICATED.
- ALL OUTLETS TO BE INSTALLED AT 18" AFF ON CENTER UNLESS OTHERWISE NOTED OR INSTRUCTED BY OWNER/ARCHITECT.
- CONDUITS BELOW SLAB SHALL BE PVC CONDUITS WITH METAL ELBOW. CONDUITS ENCLOSED IN WALL/CEILING SHALL BE METAL CONDUITS. ANY EXPOSED CONDUITS SHALL BE METAL ONLY. CONDUITS ENCLOSED IN CONCRETE SHALL BE PVC.
- G.C. TO COORDINATE ALL POWER AND OTHER OUTLETS WITH ARCHITECTURAL PLANS AND ENGINEERING DRAWINGS.
- ALL 120V, 208V, SINGLE PHASE, THREE PHASE, 15A AND 20A RECEPTACLES INSTALLED OUTDOORS, IN BATHROOMS, KITCHENS WITHIN 6 FEET OF A SINK, AND ON ROOFTOP AREAS SHALL HAVE GROUND-FAULT CIRCUIT INTERRUPTER PROTECTION.
- EXPOSED CONDUITS WITHIN FOOD PREP AREA MUST HAVE SMOOTH SURFACE FOR CLEANING PER HEALTH DEPARTMENT REQUIREMENTS AND SHALL BE STANDARD METAL CONDUITS.

KEY NOTES

- PROVIDE JUNCTION BOX FOR SIGNAGE. CONTRACTOR TO FIELD LOCATE.
- CONTRACTOR SHALL PROVIDE TELEPHONE CABINET. COORDINATE EXACT LOCATION AND REQUIREMENT WITH TELEPHONE COMPANY. CONTRACTOR TO STUB UP CONDUIT FROM TELEPHONE CABINET TO TELEPHONE COMPANY POINT OF SERVICE. PROVIDE CONDUIT AND CABLE.
- SHOW WINDOW RECEPTACLES SHALL BE SPACED AT NOT MORE THAN 12'-0" O.C. AND INSTALLED WITHIN 18" ABOVE TOP OF WINDOWS PER NEC 210.82.
- CONTRACTOR SHALL FIELD LOCATE ELECTRICAL PANEL AS PER ELECTRICAL CODE ADOPTED BY AUTHORITY HAVING JURISDICTION.
- CONTRACTOR SHALL EXTEND 1" CONDUIT FROM BUILDING TELEPHONE CABINET TO TELEPHONE BACKBOARD. FIELD LOCATE TELEPHONE BACKBOARD.
- CONTRACTOR SHALL PROVIDE AND FIELD LOCATE ELECTRICAL WIREWAY.
- TIME SWITCH SHALL FUNCTION ON A SCHEDULED BASIS USING TIME-OF-DAY WITH AN INDEPENDENT PROGRAM SCHEDULE THAT CONTROLS THE SIGNAGE.
- PROVIDE NEW DISCONNECT SWITCH FOR BEER CAVE COOLER CONDENSER. PROVIDE CABLE AND CONDUIT. CONTRACTOR TO FIELD VERIFY ELECTRICAL REQUIREMENTS, CONFIRM CIRCUIT BREAKER SIZE NEEDED AND PROVIDE.
- PROVIDE NEW DISCONNECT SWITCH FOR COOLER CONDENSER. PROVIDE CABLE AND CONDUIT. CONTRACTOR TO FIELD VERIFY ELECTRICAL REQUIREMENTS, CONFIRM CIRCUIT BREAKER SIZE NEEDED AND PROVIDE.
- CONTRACTOR SHALL FIELD COORDINATE MOUNTING HEIGHT AND LOCATION OF RECEPTACLES AND TELEPHONE/DATA OUTLETS.
- CONTRACTOR SHALL PROVIDE (2) 1" CONDUITS AND (20) 3/4" CONDUITS FROM ELECTRICAL PANEL TO 10' IN FRONT OF BUILDING. FIELD COORDINATE.
- CONTRACTOR SHALL FIELD VERIFY EQUIPMENT LOCATION AND ELECTRICAL REQUIREMENTS. PROVIDE DISCONNECT SWITCHES, CABLE, CONDUIT, AND CIRCUIT BREAKER AS REQUIRED.
- CONTRACTOR TO FIELD COORDINATE LOCATION AND MOUNTING HEIGHT OF COOLER SIGNAGE. CONTRACTOR SHALL FIELD VERIFY AND PROVIDE ELECTRICAL REQUIREMENTS.
- KITCHEN BY OTHERS. CONTRACTOR SHALL CONSULT OWNER FOR KITCHEN DESIGN AND EQUIPMENT.
- PROVIDE SMOKE DETECTOR. SMOKE DETECTOR SHALL SHUT DOWN UNIT WHEN ENERGIZED.
- INTERLOCK NEW EXHAUST FAN WITH NEW LIGHT SWITCH. NEW EXHAUST FAN SHALL BE FED BY CIRCUIT SERVING RESTROOM LIGHT FIXTURES.
- CONTRACTOR SHALL FIELD COORDINATE MOUNTING HEIGHT OF RECEPTACLE AT THE FRONT OF STORE. RECEPTACLE MOUNTING HEIGHT SHALL BE AT LEAST 12" A.F.F. OR HIGHER.

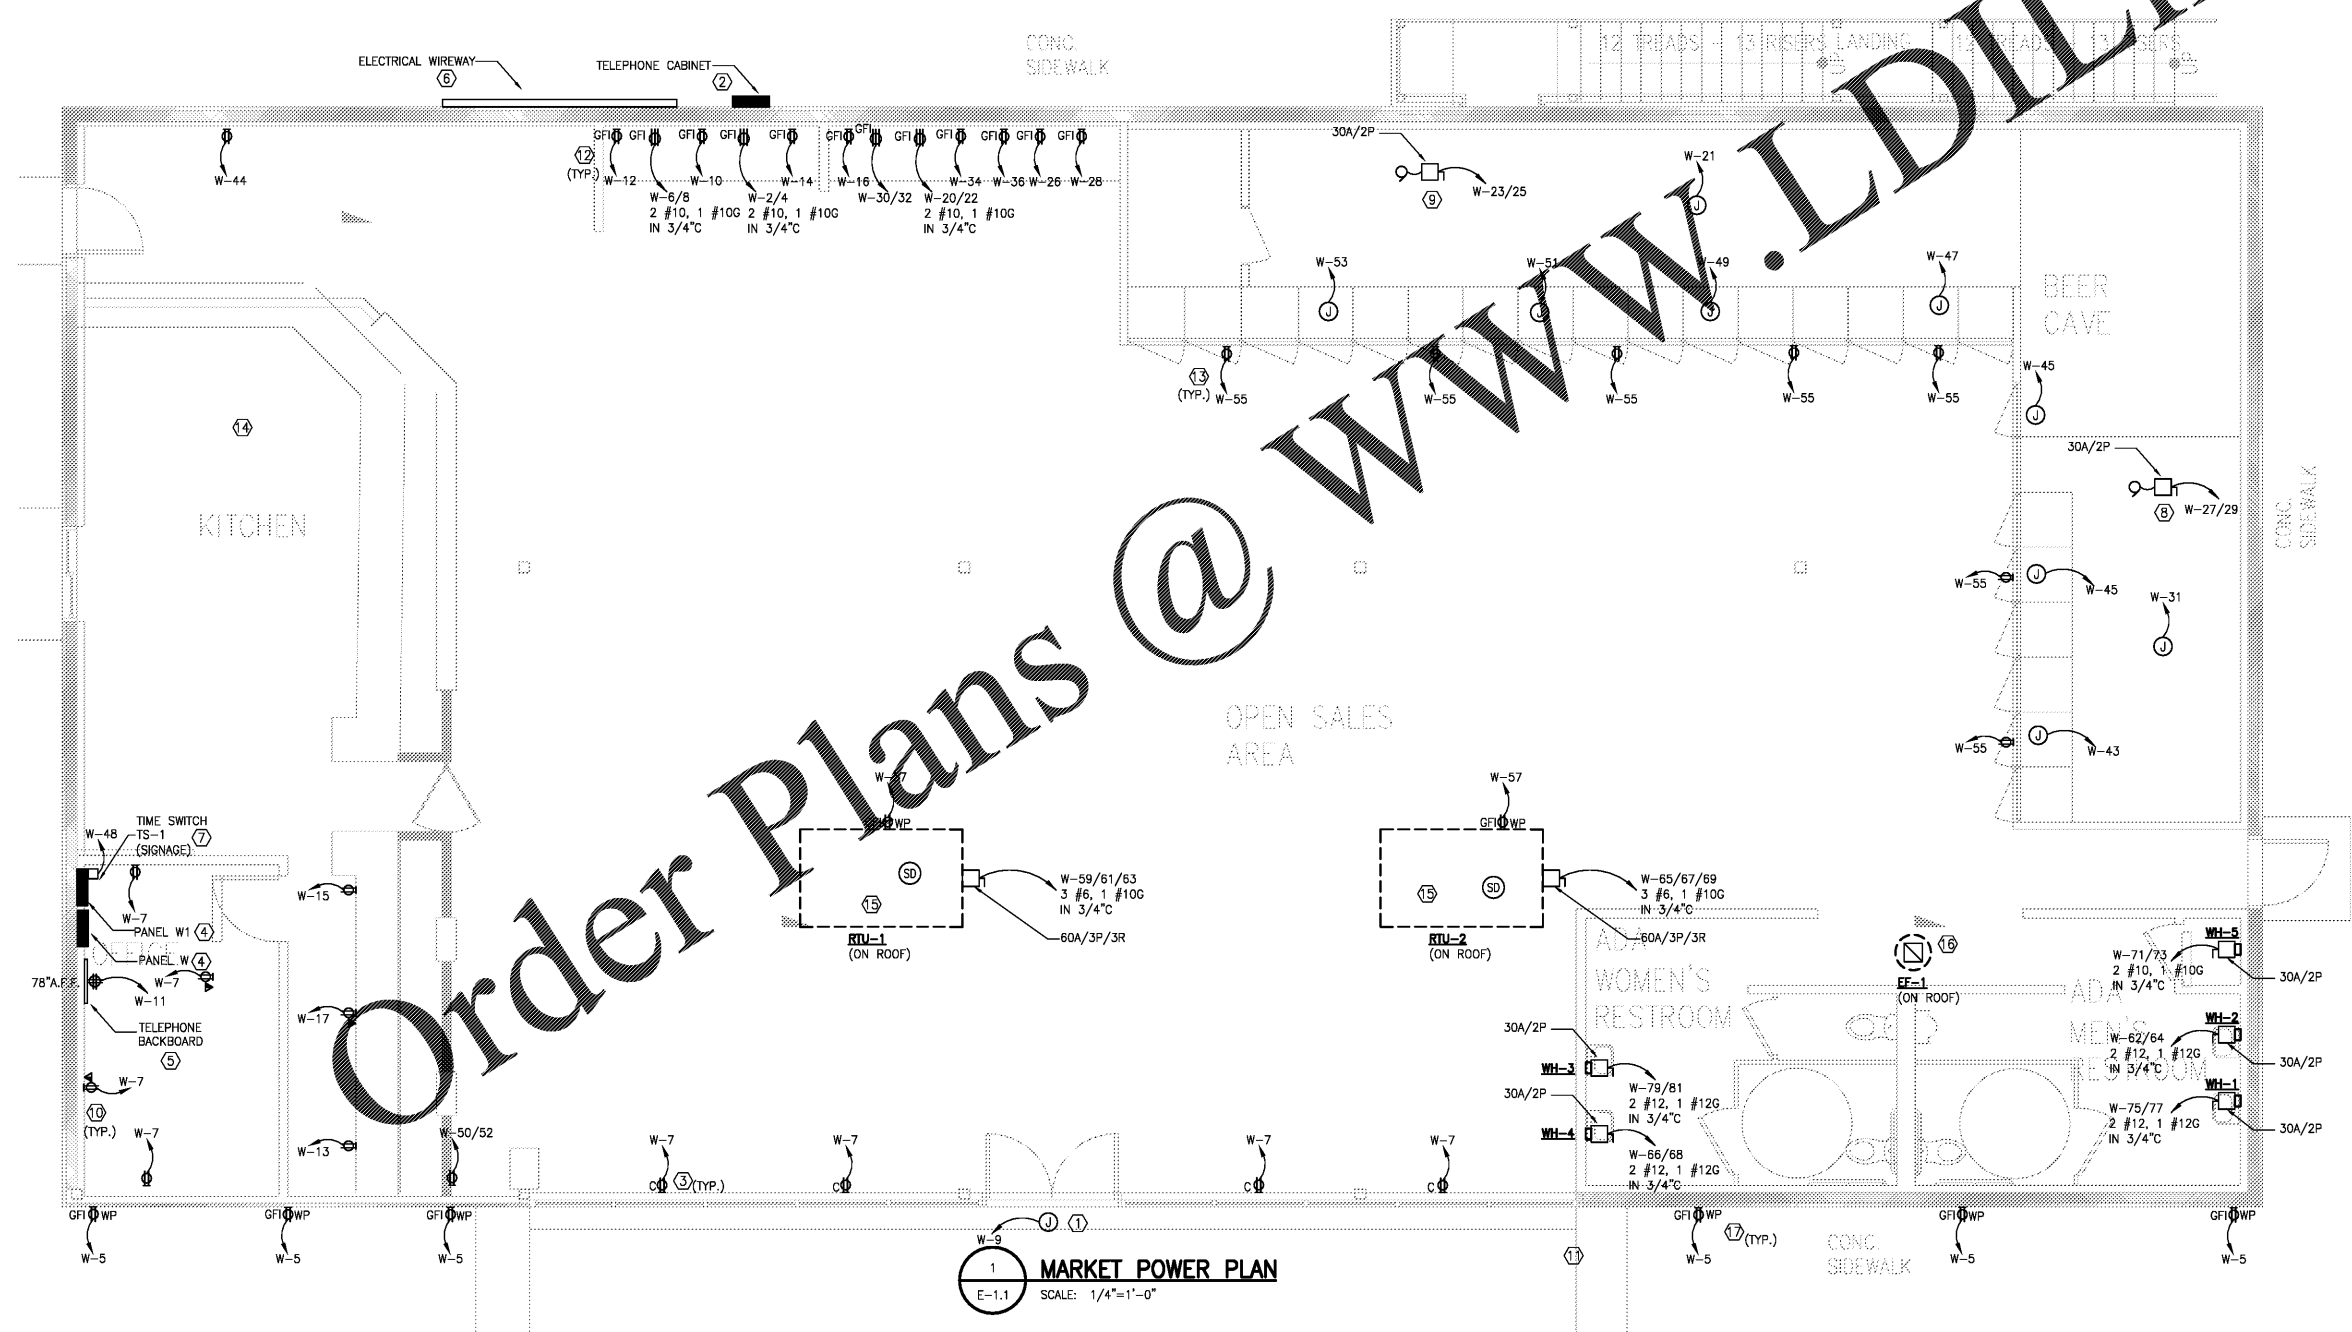

1 MARKET POWER PLAN
E-1.1 SCALE: 1/4"=1'-0"

Order Plans @ WWW.LDILine.com



<p>DATE: 06/18/20</p> <p>SCALE: 1/4"=1'-0"</p> <p>DRAWING NO: E-1.1</p>	<p>PROJECT: MARKET POWER PLAN</p> <p>CLIENT: WILD WOLF - COMMERCIAL DEVELOPMENT</p> <p>ADDRESS: BOYD MORRIS ROAD & GA HWY 293 SPUR</p> <p>CITY: BARTOW COUNTY, GEORGIA 30120</p>	<p>DESIGNED BY: ASHIM K. RAI</p> <p>CHECKED BY:</p> <p>DATE: 06/18/20</p>	<p>GENERAL CONTRACTOR:</p> <p>BLACKWATER CONSTRUCTION</p> <p>2100 SHELLETT BLVD - SUITE 400 - DULUTH, GEORGIA 30097</p> <p>VOICE: 404-546-3505 E-MAIL: INFO@BLACKWATER.COM WWW.BLACKWATER.COM</p>	<p>ENGINEERING CONSULTANT:</p> <p>LDI</p> <p>LDI Group Consulting Engineers, Inc.</p> <p>1027 Powers Ferry Road</p> <p>Building 20, Suite 100</p> <p>Atlanta, Georgia 30339</p> <p>TEL: (770) 952-9523</p>
---	--	---	--	---