


GENERAL NOTES:

1. CONTRACTOR SHALL CONFIRM EXISTING CONDITIONS PRIOR TO BID.
2. COORDINATE ALL MECHANICAL CONSTRUCTION WITH OTHER TRADES TO AVOID CONFLICTS.
3. CONFIRM LOCATIONS OF ALL EXISTING UTILITIES AND ADJUST ROUTING OF TENANT SYSTEMS AS REQUIRED.
4. EXISTING PLUMBING SERVICES (COLD WATER, HOT WATER, WASTE AND VENT) WHICH ARE NOT TO BE REUSED SHALL BE REMOVED BACK TO ACTIVE MAINS AND CAPPED. THERE SHALL BE NO "DEAD ENDS" LEFT IN PIPING SYSTEMS.

KEYED NOTES:

- ① VENTS SHALL BE MIN. 6" FROM ANY OUTDOOR AIR INTAKE.
- ② FLOOR SINK BELOW SODA FOUNTAIN STATION SHALL ALSO RECEIVE WALK-IN COOLER CONDENSATE DRAINAGE.

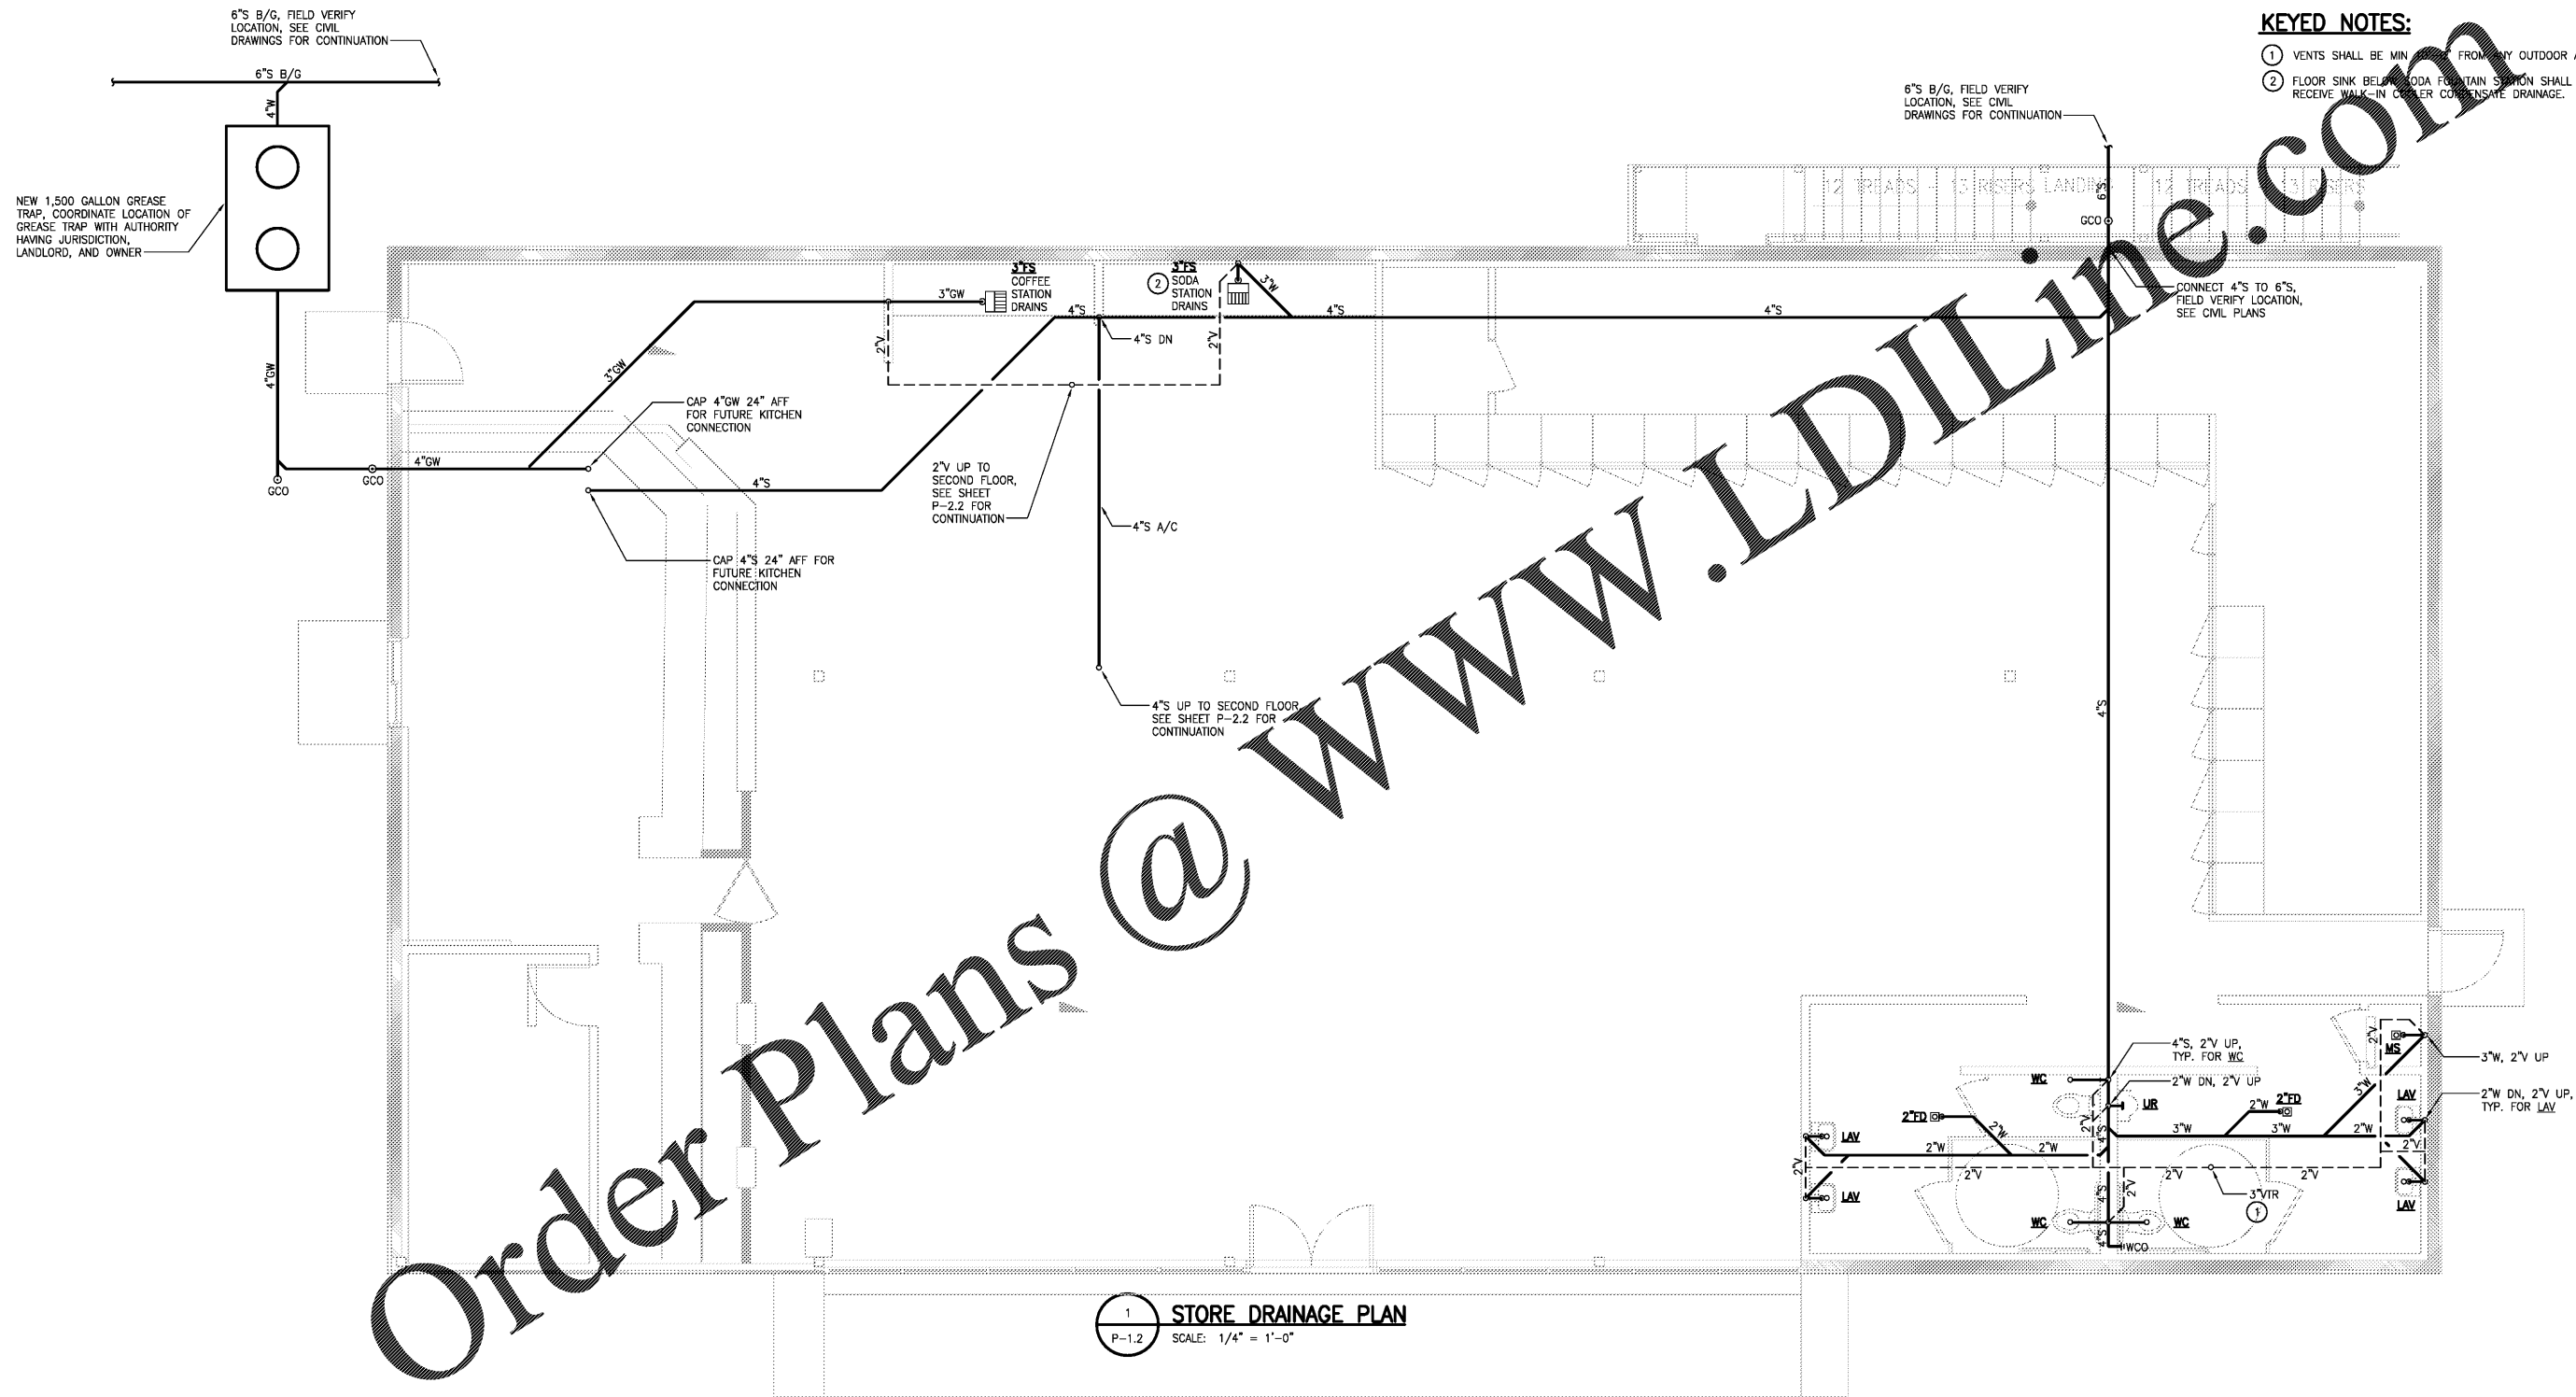

1 STORE DRAINAGE PLAN
P-1.2 SCALE: 1/4" = 1'-0"

Order Plans @ www.LDILINE.com



engineering consultant LDI The Group Consulting Engineers, Inc. 1027 Powers Ferry Road Atlanta, Georgia 30350 Fax: (770) 965-9633
general contractor BLACKWATER CONSTRUCTION 2100 SHELLEY BLVD - SUITE 400 - DULUTH, GEORGIA 30097 VOICE: 404-854-3855 E-MAIL: info@blackwater.com www.blackwater.com
STORE DRAINAGE PLAN WILD WOLF - COMMERCIAL DEVELOPMENT BOYD MORRIS ROAD & GA HWY 293 SPUR BARTOW COUNTY, GEORGIA 30120
DRAWING NO: P-1.2 DATE: 06/16/20