

To consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Details, Systems, and/or Certifications (if any) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings); 2. The statement "Reprinted from the Online Certification Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2019 UL LLC."

UL and the UL logo are trademarks of UL LLC © 2019 All Rights Reserved.

(Item 1), screws are spaced a max of 8 in. OC along resilient channels, fasteners are increased in length to 1-1/4 in, and gypsum board butt joints shall be staggered min. 2 ft within the assembly. Butted end joints between the main furring channels:
When Steel Framing Members (Item 6A or 6C) are used, sheets installed with long dimension perpendicular to furring channels and side joints of steel located beneath trusses. Gypsum board screws are driven through channel spaced 12 in. OC in the field when no insulation (Item 5 or 3A) is fitted in the concealed space, or 6 in. OC in the field when insulation (Item 3 or 3A) is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane. Gypsum board butt joints shall be staggered min. 2 ft within the assembly, and centered over main furring channels. At the gypsum board butt joints, each end of the gypsum board shall be supported by a single length of furring channel equal to the width of the wallboard plus 8 in. on each end. The furring channels shall be spaced approximately 3-1/2 in. OC and be attached to the truss at one clip at midspan. Screw spacing along the gypsum board along the butt joint to attach the gypsum board to the furring channels shall be 8 in. OC. Second (outer) layer of gypsum board required when furring channels (Item 6A, B) are spaced 24 in. OC and insulation is fitted in the concealed space, channel void be installed parallel to furring channels/gypsum board ceiling membrane. Outer layer of gypsum board attached to the furring channels using 1-5/8 in. long Type 5 bugle-head screws spaced 8 in. OC at butted joints and 12 in. OC in the field. Butted end joints of outer layer to be offset a minimum of 8 in. from base layer end joints. Butted side joints of outer layer to be offset minimum 18 in. from butted side joints of base layer.

When Steel Framing Members (Item 6B) are used, two layers of nom 5/8 in. thick, 4 ft wide gypsum board are installed with long dimensions perpendicular to furring channels (Item 6B). Base layer attached to the furring channels using 1 in. long Type 5 bugle-head steel screws spaced 8 in. OC along butted end joints and 12 in. OC in the field of the board. Butted end joints centered on the continuous furring channels. Butted base layer end joints to be offset a min of 18 in. in adjacent courses. Outer layer attached to the furring channels using 1-5/8 in. long Type 5 bugle-head steel screws spaced 8 in. OC at butted end joints and 12 in. OC in the field. Butted end joints centered on the continuous furring channels and offset a min of 18 in. from butted end joints of base layer. Butted side joints of outer layer to be offset min 18 in. from butted side joints of base layer.

When Steel Framing Members (Item 6C) are used, one layer of nom 5/8 in. thick, 4 ft wide gypsum board is installed with long dimensions perpendicular to furring channels. Gypsum board secured to furring channels with nom 1 in. long Type 5 bugle-head steel screws spaced 8 in. OC in the field of the board. Gypsum board butted end joints shall be staggered minimum 72 in. At the gypsum board butt joints, each end of each gypsum board shall be supported by a single length of furring channel equal to the width of the gypsum board plus 3 in. on each end, spaced approximately 2 in. in from joint. Screw spacing along the gypsum board butt joint shall be 8 in. OC. Butt joint furring channels shall be attached with a RESILMOUNT Sound Isolation Clip secured to underside of every truss that is located over the butt joint. Over all Gypsum Board side joints, apply a minimum 20 in. length of hanging channel void be installed parallel to trusses (Item 2) between main furring channels. Side joint furring channels shall be attached to underside of the joist with RESILMOUNT Sound Isolation Clips - located approximately 2 in. from each end of the approximate 20 in. length of channel. Both Gypsum Board side joints fastened into channel with screws spaced 6 in. OC, approximately 1/2 in. from joint edge.

When Steel Framing Members (Item 6E) are used, one layer of nom 5/8 in. thick, 4 ft wide gypsum board is installed with long dimensions perpendicular to furring channels. Gypsum board secured to furring channels with nom 1 in. long Type 5 bugle-head steel screws spaced 8 in. OC in the field of the board. Gypsum board butted end joints shall be staggered minimum 48 in. and centered over main furring channels. At the gypsum board butt joints, each end of each gypsum board shall be supported by a single length of furring channel equal to the width of the gypsum board plus 3 in. on each end. The two support furring channels shall be spaced approximately 3 in. in from end joint. Screw spacing along the gypsum board butt joint and along both additional channels shall be 8 in. OC. Additional screws shall be placed in the adjacent section of gypsum board into the aluminum hanger. At the gypsum board butt joint channels as well as into the main channel that runs between. Butt joint furring channels shall be attached with one RESILMOUNT Sound Isolation Clip at each end of the channel.

When alternate Steel Framing Members (Item 6F) are used, one layer of nom 5/8 in. thick, 4 ft wide gypsum board sheets installed with long dimension (side joints) perpendicular to the 8 ft long cross tees with the end joints staggered min 4 ft and centered between cross tees which are spaced 8 in. OC. Gypsum board side joints may occur beneath the furring channels. Prior to installation of the gypsum board sheets, backer strips consisting of nom 7-3/4 in. wide pieces of gypsum board are to be laid atop the cross tee flanges and centered over each butted end joint location. The backer strips are to be secured to the flanges of the cross tees at opposite corners of the backer strip with hold down clips to prevent the backer strips from being uplifted during screw-attachment of the gypsum board sheets. Gypsum board fastened to cross tees with 1 in. drywall screws spaced 16 in. apart on each side of the cross tee or channel and one screw spaced 1-1/2 in. from each gypsum board end joint. Except for staggered end joints, wallboard screws shall be located on alternating sides of the flange. At gypsum board end joints, gypsum board screws shall be located 1/2 in. from the joint. Gypsum board fastened to main runners with wallboard screws 12 in. OC. Additional 8 ft long cross tees intersections with cross tees or channels (Item 6F) in the field. Each additional gypsum board sheets shall be staggered not less than 32 in. from gypsum board sheets below attached to leg of wall angle with wallboard screws spaced 12 in. OC at butted joints as described in Item 7. For use with **Steel Framing Members** (Item 6F) when using **Batts and Blankets** (Item 3) are used - Follow the assembly details for **Batts and Blankets** (Item 3) as used - Follow the assembly details for cross tees. Fasten to cross tees with long dimension gypsum board screws spaced 8 in. OC in the field. Backer strips shall be secured to the flanges of the cross tees with hold down screws spaced 3 in. in from end joint. End joints of the sheets shall be staggered with spacing 3 in. in from end joint. Screws shall be spaced not less than 4 ft OC.

When Steel Framing Members (Item 6H) are used, one layer of nom 5/8 in. thick, 4 ft wide gypsum board is installed with long dimensions perpendicular to furring channels. Gypsum board secured to furring channels with nom 1 in. long Type 5 bugle-head steel screws spaced 8 in. OC in the field of the board. Gypsum board butted end joints shall be staggered minimum 48 in. and centered over main furring channels. At the gypsum board butt joints, an additional single length of furring channel shall be installed, and spaced approximately 3 in. from the butt joint 16 in. from the continuous furring channels) to support the floating end of the gypsum board. Each of these shorter sections of furring channel shall extend one truss beyond the width of the gypsum panel and be attached to the adjacent trusses with one SonusClip at every truss involved with the butt joint.

CGC INC --- Types C, IP-X2, IPC-AR

UNITED STATES GYPSUM CO --- Types C, IP-X2, IPC-AR

USG BORAL DRYWALL SFZ LLC --- Type C

USG MEXICO S A DE C V --- Type C, IP-X2, IPC-AR

7A. **Gypsum Board** --- For use with **Steel Framing Members** (Item 6D) where **Batts and Blankets** (Item 3) are not used. One layer of nom 5/8 in. thick by 48 in. wide boards, installed with long dimension parallel to the main runners. Gypsum board fastened to each cross tee or channel with five wallboard screws, with one screw located at the midspan of the cross tee or channel, one screw located 12 in. from and on each side of the cross tee or channel end, and one screw spaced 1-1/2 in. from each gypsum board end joint. Except for staggered end joints, wallboard screws shall be located on alternating sides of the flange. At gypsum board end joints, gypsum board screws shall be located 1/2 in. from the joint. Gypsum board fastened to main runners with wallboard screws 12 in. OC. Additional 8 ft long cross tees intersections with cross tees or channels (Item 7A) in the field. Each additional gypsum board sheets shall be staggered not less than 32 in. from gypsum board sheets below attached to leg of wall angle with wallboard screws spaced 12 in. OC at butted joints as described in Item 7. For use with **Steel Framing Members** (Item 7) when using **Batts and Blankets** (Item 3) are used - Follow the assembly details for cross tees. Fasten to cross tees with long dimension gypsum board screws spaced 8 in. OC in the field. Backer strips shall be secured to the flanges of the cross tees with hold down screws spaced 3 in. in from end joint. End joints of the sheets shall be staggered with spacing 3 in. in from end joint. Screws shall be spaced not less than 4 ft OC.

CGC INC --- Type C, IP-X2

UNITED STATES GYPSUM CO --- Type C or IP-X2

USG BORAL DRYWALL SFZ LLC --- Type C

USG MEXICO S A DE C V --- Type C or IP-X2

7B. **Gypsum Board** --- For use with Items 3C and 6G. Nom 5/8 in. thick, 48 in. wide gypsum panels installed with long dimension perpendicular to resilient channels. Gypsum panels secured with 1 in. long Type 5 bugle-head steel screws spaced 8 in. OC and located a min of 12 in. from side joints and 3 in. from the joints. Finish Rating with the ceiling system is 30 min. **UNITED STATES GYPSUM CO** --- Type ULX

8. **Finishing System** --- (Not Shown) --- Vinyl, dry or premixed joint compound, applied in two coats to joints and screw-heads; paper tape, 2 in. wide, embedded in first layer of compound over all joints. As an alternate, nom 3/32 in. thick veneer plaster may be applied to the entire surface of gypsum board. **Alternate Ceiling Membrane** --- Not Shown.

9. **Netting** --- Fibrous, woven netting material fastened to underside of each joint with staples, with side joints overlapped.

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

Design/System/Construction/Assemblies Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are not a substitute and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised

b. **Steel Framing Members** --- Used to attach furring channels (Item a) to the trusses (Item 2). Clips spaced 48 in. OC. R5IC-1 and R5IC-1 (2.75) clips secured to alternating trusses with No. 8 by 2-1/2 in. coarse drywall screws through the center grummet. R5IC-V and R5IC-V (2.75) clips secured to alternating trusses with No. 8 by 1-1/2 in. coarse drywall screw through the center hole. Furring channels are friction fitted into clips. R5IC-1 and R5IC-V clips for use with 2-9/16 in. wide furring channels. R5IC-1 (2.75) and R5IC-V (2.75) clips for use with 2-23/32 in. wide furring channels. Adjoining channels are overlapped as described in Item 6A. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping No. 6 framing screws, min 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel. Additional clips required to hold furring channels that supports the gypsum board butt joints, as described in Item 7. **PAC INTERNATIONAL L.L.C** --- Types R5IC-1, R5IC-V, R5IC-1 (2.75), R5IC-V (2.75).

6B. **Steel Framing Members** --- (Not Shown) --- As an alternate to Items 6 and 6A.

a. **Furring Channels** --- Hat-shaped furring channels, 7/8 in. deep by 2-5/8 in. wide at the base and 1-1/4 in. wide at the top, formed from No. 25 galv steel. spaced max 16 in. OC perpendicular to trusses and Cold Rolled Channels (Item 6B). Furring channels secured to Cold Rolled Channels at every intersection with a 1/2 in. pan head self-drilling screw through each furring channel leg. Ends of adjoining channels overlapped 4 in. and tied together with two double strand No. 18 SWG galv steel wire ties, one at each end of overlap. Additional furring channels at base layer and outer layer gypsum board butt joints are not required. Batts and Blankets draped over furring channels as described in Item 3. Two layers of gypsum board attached to furring channels as described in Item 7.

b. **Cold Rolled Channels** --- 1-1/2 in. x 1-1/2 in., formed from No. 18 galv steel, positioned vertically and parallel to trusses, friction-fit into the channel cavity on the Steel Framing Members (Item 6B). Adjoining lengths of cold rolled channels lapped min. 6 in. and wire-tied together with two double strand 18 SWG galv steel wire ties, one at each end of overlap.

c. **Blocking** --- Where truss design does not permit direct, full contact of the hanger bracket, a piece of nominal 2 by 4 in. lumber (blocking), min 5 in. long to permit full contact of the hanger bracket, to be secured vertically to the side of the truss (Item 2) at the top and bottom of the blocking at each Steel Framing Member (Item 6B) location.

d. **Steel Framing Members** --- Hangers spaced 48 in. OC, max along truss, and secured to the Blocking (Item 6B) on alternating trusses with a single 5/16 in. by 2 in. hex head lag bolt and four 8 by 1-1/4 in. drywall screws through each mounting hole(s) on the hanger bracket. The two 1/4 in. long steel ties on the hanger are embedded in the side of the blocking. Hanger positioned on blocking and leveling bolt height adjusted such that furring channels are flush with bottom of bruses before gypsum board installation. Spring gauge or hanger chosen per manufacturer's instructions. **KINETICS NOISE CONTROL INC** --- Type ICW.

6C. **Steel Framing Members** --- (Not Shown) --- As an alternate to Items 6, 6A and 6B.

a. **Furring Channels** --- Formed of No. 25 MSG galv steel, 2-3/8 in. wide by 7/8 in. deep installed perpendicular to wood structural members. Channels spaced a max of 16 in. OC when no insulation (Item 3 or 3A) is fitted in the concealed space or a max of 12 in. OC when insulation (Item 3 or 3A) is fitted in the concealed space. Channels secured to trusses as described in Item 6C. Ends of adjoining channels overlapped 6 in. and tied together with double strand of No. 18 AWG galvanized steel wire near each end and overlap.

b. **Steel Framing Members** --- Used to attach furring channels (Item 6C) to trusses (Item 2). Clips secured to the bottom chord of each truss (2A in. OC) with one No. 8 by 2-1/2 in. long coarse drywall screw through center grummet. Furring channels are friction fitted into clips. Adjoining channels are overlapped as described in Item 6C. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping No. 6 framing screws, min 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel. Additional clips required to hold furring channels that supports the gypsum board butt joints, as described in Item 7. **PLUTEQ INC** --- Type Genie Clip.

6D. **Steel Framing Members** --- (Not Shown) --- As an alternate to Items 6, 6A, and 6C.

a. **Main runners** --- Installed perpendicular to trusses --- Nom 10 or 12 ft long, 1 5/8 in. or 1-1/2 in. wide, spaced 24 in. OC. Main runners hung a min of 2 in. from bottom chord of truss with 1/2 in. pan head self-drilling screws. Wires located a max of 46 in. from joint.

b. **Cross tees or channels** --- Installed 19-1/2 in. long 1-1/2 in. wide face or edge channels, nom 4 ft long, 1-1/2 in. deep, installed perpendicular to the main runners, spaced 16 in. OC. Additional cross tees or channels used at 8 in. on each side of butted gypsum board end joints. The cross tees or channels shall be fastened or screw-attached to the wall angle or channel to facilitate the installation.

c. **Wall angles or channels** --- Used to support steel framing member ends to screw-attachment of the gypsum wallboard --- Min 0.016 in. thick, painted, galvanized steel angle with 1 in. legs or min. 0.016 in. thick painted galvanized steel channel with a 1 by 1-1/2 by 1 in. profile, attached to walls at perimeter of ceiling with fasteners 16 in. OC. **CGC INC** --- Type DGL or RX

USG INTERIORS LLC --- Type DGL or RX

6E. **Alternate Steel Framing Members** --- (Not Shown) --- As an alternate to Items 6, 6A, 6B, and 6C, furring channels and Steel Framing Members as described below.

a. **Furring Channels** --- Formed of No. 25 MSG galv steel, 2.5/8 in. wide by 7/8 in. deep, spaced 16 in. OC, perpendicular to trusses. When insulation, Items 3 or 3A) is used, the furring channel spacing shall be reduced to 12 in. OC. Channels secured to joists as described in Item 7.

b. **Steel Framing Members** --- Used to attach furring channels (Item a) to the wood trusses (Item 2). Clips spaced at 48" OC and secured to the bottom of the trusses with one 2 in. Coarse Drywall Screw with 1 in. diam washer through the center hole. Furring channels are then friction fitted into clips. Ends of channels are overlapped 6" and tied together with double strand of No. 18 AWG galvanized steel wire, additional clips are required to hold the gypsum butt joints as described in Item 7. **STUDDO BUILDING SYSTEMS** --- RESILMOUNT Sound Isolation Clips - Type A237 or A237R

6F. **Steel Framing Members** --- (Not Shown) --- As an alternate to Items 6 through 6E. Not for use with Items 3 or 3A. Main runners nom 12 ft long, spaced 72 in. OC. Main runners suspended by min 12 SWG galv steel hanger wires spaced 48 in. OC. Cross tees, nom 6 ft long, installed perpendicular to main runners and spaced 24 in. OC. Additional 8 ft long cross tees required at each gypsum board and joint with butted gypsum board end joints centered between cross tees spaced 8 in. OC. The main runners and cross tees may be riveted or screw attached to the wall angle or channel to facilitate the ceiling installation.

USG INTERIORS LLC --- Type DGL or RX

6G. **Resilient Channels** --- For Use With Item 7B - Formed from min 25 MSG galv steel installed perpendicular to trusses and spaced 16 in. OC. Channels secured to each truss with 1 in. long Type 5 bugle-head steel screws. Channels overlapped 4 in. at all joints. Two channels, spaced 6 in. OC, oriented opposite each gypsum panel and joint. Additional channels shall extend min 6 in. beyond each side edge of panel. Insulation, Item 3C is applied over the resilient channel/gypsum panel ceiling membrane.

6H. **Alternate Steel Framing Members** --- (Not Shown) --- As an alternate to Items 6 through 6C, furring channels and Steel Framing Members as described below.

a. **Furring Channels** --- Formed of No. 25 MSG galv steel, 2-1/2 in. wide by 7/8 in. deep, spaced 16 in. OC, perpendicular to trusses. When insulation, Items 3 or 3A) is used, the furring channel spacing shall be reduced to 12 in. OC. Channels secured to joists as described in Item 7.

b. **Steel Framing Members** --- Used to attach furring channels (Item a) to the wood trusses (Item 2). Clips spaced at 48" OC and secured to the bottom of the trusses with one 2-1/2 in. Coarse Drywall Screw with 1 in. diam washer through the center hole. Furring channels are then friction fitted into clips. Ends of channels are overlapped 6" and tied together with double strand of No. 18 AWG galvanized steel wire. Additional clips are required to hold the gypsum butt joints as described in Item 7. **REGUPO AMERICA** --- Type SonusClip

7. **Gypsum Board** --- One layer of nom 5/8 in. thick by 48 in. wide boards, installed with long dimension parallel to trusses. Attached to the resilient channels using 1 in. long Type 5 bugle-head screws. Screws spaced a max of 12 in. OC along butted end-joints and in the field when no insulation (Item 3 or 3A) is fitted in the concealed space, or a max of 8 in. OC along butted end joints and in the field when insulation (Item 3 or 3A) is fitted in the concealed space, draped over the resilient channel/gypsum board ceiling membrane. When insulation (Item 3B or 3D) is installed in the concealed space, spray-applied to the underside of the ceiling system

on the product installed. When spray foam insulation is installed, resilient channels (Item 6) shall be installed maximum 12 in. OC, with channels adjacent to butt joints of gypsum board (Item 7) spaced maximum 3 in. away from gypsum butt joints. Gypsum board (Item 7) to be installed using minimum 1-1/4 in. long Type 5 screws, spaced maximum 8 in. OC, and butted end joints shall be staggered min. 2 ft within the assembly, and occur midway between the continuous furring channels. Furring channels are friction fitted into clips. R5IC-1 and R5IC-V clips for use with 2-9/16 in. wide furring channels. R5IC-1 (2.75) and R5IC-V (2.75) clips for use with 2-23/32 in. wide furring channels. Adjoining channels are overlapped as described in Item 6A. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping No. 6 framing screws, min 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel. Additional clips required to hold furring channels that supports the gypsum board butt joints, as described in Item 7. **BASF CORP** --- Enervulad N80, Enervulad G, FE1780, Sprayfoam 17H, Sprayfoam 81206, WOLFR 200, Wastboard US-A, Wastboard US-A, and Wastboard 1P*

4. **Air Duct*** --- Any UL Class 0 or Class 1 Rexcel air duct installed in accordance with the instructions provided by the damper manufacturer.

5. **Ceiling Damper** --- Max nom area, 324 sq in. Max square size, 18 in. by 18 in. rectangular sizes not to exceed 324 sq in. with a max. width of 18 in. Max damper height is 14 in. Installed in accordance with manufacturer's installation instructions provided with the damper. Max damper openings not to exceed 162 sq in. per 100 sq ft of ceiling area. **C&S AIR PRODUCTS** --- Model RD-521

POTTORFF --- Model CFD-521

5A. **Alternate Ceiling Damper** --- Max nom area, 196 sq in. Max square size, 14 in. by 14 in. Rectangular sizes not to exceed 196 sq in. with a max width of 26 in. Max overall damper height is 7 in. Installed in accordance with the manufacturer's installation instructions provided with the damper. Max damper openings not to exceed 98 sq in. per 100 sq ft of ceiling area. **C&S AIR PRODUCTS** --- Model RD-521-BT

POTTORFF --- Model CFD-521-BT.

5B. **Alternate Ceiling Damper** --- Max nom area shall be 256 sq in. with the length not to exceed 24 in. and the width not to exceed 20 in. Max height of damper shall be 17 in. Aggregate damper openings shall not exceed 128 sq in. per 100 sq ft of ceiling area. Damper installed in accordance with manufacturer's installation instructions provided with the damper. A steel grille shall be installed in accordance with installation instructions. **C&S AIR PRODUCTS** --- Model RD-521-IP, RD-521-IP

POTTORFF --- Models CFD-521-IP, CFD-521-IP

5C. **Alternate Ceiling Damper** --- Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 256 sq in. with the length not to exceed 24 in. and the width not to exceed 9-3/4 in. Max height of damper shall be 14 in. with the length not to exceed 9-1/8 in. Aggregate damper openings shall not exceed 88 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions. **DELTA ELECTRONICS INC** --- Model CRD-1R, CRD, ITD

5D. **Alternate Ceiling Damper** --- Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 75 sq in. with the length not to exceed 9-1/4 in. and the width not to exceed 9-3/4 in. Max height of damper shall be 9-7/8 in. Aggregate damper openings shall not exceed 45 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions. **DELTA ELECTRONICS INC** --- Model SHG-CHD

5E. **Alternate Ceiling Damper** --- For use with min 18 in. deep trusses. Max nom area shall be 141 sq in. with the length not to exceed 14 in. and the width not to exceed 74 sq in. per 100 sq ft of ceiling area. Damper installed in accordance with the manufacturer's installation instructions provided with the damper. A steel grille shall be installed in accordance with installation instructions. **C&S AIR PRODUCTS** --- Model RD-521-90, RD-521-9P90

POTTORFF --- Models CFD-521-90, CFD-521-9P90

5F. **Alternate Ceiling Damper** --- Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 131 sq in. with the length not to exceed 11-1/8 in. and the width not to exceed 11-7/8 in. Aggregate damper openings shall not exceed 66 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions. **DELTA ELECTRONICS INC** --- Model SMT-CD0

5G. **Alternate Ceiling Damper** --- Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 103 sq in. with the length not to exceed 10-1/8 in. and the width not to exceed 10-1/8 in. Aggregate damper openings shall not exceed 52 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions. **PANASONIC CORPORATION, PANASONIC CORPORATION OF NORTH AMERICA** --- Model PC-RD505C

5H. **Alternate Ceiling Damper** --- Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 113 sq in. with the length not to exceed 10-1/8 in. and the width not to exceed 11-1/8 in. Aggregate damper openings shall not exceed 57 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions. **BROAN-NUTONE L.L.C** --- Model RFDLWVT

5I. **Alternate Ceiling Damper** --- Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 97 sq in. with the length not to exceed 10 in. and the width not to exceed 7-15/16 in. Aggregate damper openings shall not exceed 49 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions. **BROAN-NUTONE L.L.C** --- Models RD-11 and RDH

5J. **Alternate Ceiling Damper** --- Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 87 sq in. with the length not to exceed 9 in. and the width not to exceed 9-11/16 in. Aggregate damper openings shall not exceed 44 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions. **BROAN-NUTONE L.L.C** --- Model RDMWT

5K. **Alternate Ceiling Damper** --- Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 87 sq in. with the length not to exceed 9 in. and the width not to exceed 9-11/16 in. Aggregate damper openings shall not exceed 44 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions. **BROAN-NUTONE L.L.C** --- Model RDMRT2

6. **Furring Channels** --- Resilient channels formed of 25 MSG thick galv steel. Installed perpendicular to the trusses (Item 2), spaced a max of 16 in. OC when no insulation (Item 3 or 3A) is fitted in the concealed space, or a max of 12 in. OC when insulation (Item 3 or 3A) is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane or 24 in. OC when insulation (Item 3 or 3A) is fitted in the concealed space. Channels overlapped 4 in. at all joints. Two channels, spaced 6 in. OC, oriented opposite each gypsum panel and joint. Additional channels shall extend min 6 in. beyond each side edge of panel. Insulation, Item 3C is applied over the resilient channel/gypsum panel ceiling membrane.

6A. **Steel Framing Members** --- (Not Shown) --- As an alternate to Item 6, furring channels and Steel Framing Members as described below.

a. **Furring Channels** --- Formed of No. 25 MSG galv steel, 2-9/16 in. or 2-23/32 in. wide by 7/8 in. deep, spaced 16 in. OC, perpendicular to trusses when no insulation (Item 3 or 3A) is fitted in the concealed space or 12 in. OC when insulation (Item 3 or 3A) is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane or 24 in. OC when insulation (Item 3 or 3A) is fitted in the concealed space. Channels overlapped 4 in. at all joints. Two channels, spaced 6 in. OC, oriented opposite each gypsum panel and joint. Additional channels shall extend min 6 in. beyond each side edge of panel. Insulation, Item 3C is applied over the resilient channel/gypsum board ceiling membrane and a second layer of gypsum board is attached as described in Item 7. For steel framing members, Channels secured to trusses as described in Item 6A. Ends of adjoining channels overlapped 6 in. and tied together with double strand of No. 18 SWG galv steel wire near each end of overlap.

FIRE-RESISTANCE DESIGN

Assembly Usage Disclaimer

BXUV - Fire Resistance Ratings - ANSI/UL 263 Certified for United States

BXUVF - Fire Resistance Ratings - CANUL/S101 Certified for Canada

See General Information for Fire Resistance Ratings - ANSI/UL 263 Certified for United States. Design Details and Alternate Variations.

See General Information for Fire Resistance Ratings - CANUL/S101 Certified for Canada. Design Details and Alternate Variations.

Design No. P522


April 04, 2022

Unrestrained Assembly Rating --- 1 Hr

Finish Rating --- 26 Min (See Item 3, 3A)

This design was evaluated using a load design method and the Limit State Design Method (e.g., Working Stress Design Method). For jurisdictions that employ the Working Stress Design Method, such as Canada, a load restriction factor shall be used. See 5.5.3 of the BXUVF and BXUVF2.

* Indicates each product shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

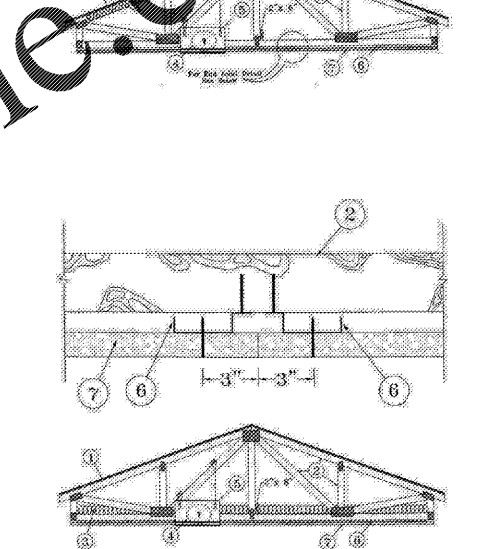

Alternate Insulation Placement.

1. **Roofing System** --- Any UL Class A, B or C Roofing System (TGRU or Prepared Roof Covering (FV2)) acceptable for use over nom 15/32 in