

ELECTRICAL SPECIFICATIONS

- 1601 GENERAL  
 A. INSTALLATION SHALL COMPLY WITH THE LATEST EDITION OF THE NORTH CAROLINA STATE BUILDING CODE, VOLUME I AND VOLUME X, NATIONAL ELECTRIC CODE, LOCAL BUILDING CODES AND ORDINANCES AND OTHER NATIONAL CODES AND ORDINANCES. IN THE CASE OF CONFLICT BETWEEN THE CODE AND THE DRAWINGS AND SPECIFICATIONS OR BETWEEN THE VARIOUS CODES, THEN THE MOST RESTRICTIVE SHALL TAKE PRECEDENT.  
 B. PROVIDE AND PAY ALL LICENSES, FEES, PERMITS, POWER COMPANY CONNECTION CHARGES, IF ANY, INSURANCE, ETC., REQUIRED FOR EXECUTION OF THIS WORK.  
 C. ELECTRICAL CONTRACTOR SHALL PROVIDE THE MATERIALS, PERFORM THE WORK AND TEST AND PAY ALL FEES NECESSARY TO MAKE THE ELECTRICAL SYSTEM OPERABLE AND READY FOR USE BY THE OWNER.  
 D. GUARANTEE: EQUIPMENT, MATERIALS AND INSTALLATION SHALL BE GUARANTEED TO BE FREE OF DEFECTS FOR A PERIOD OF ONE (1) YEAR AFTER FINAL ACCEPTANCE OF WORK OR IN ACCORDANCE WITH THE MANUFACTURER'S STANDARD WARRANTY, IF LONGER.  
 E. IT IS UNDERSTOOD AND AGREED THAT THESE PLANS AND SPECIFICATIONS SHALL BE FULFILLED IN THEIR TRUE SPIRIT AND INTENT SO THAT ANY MINOR MATERIALS OR DEVICES ESSENTIAL TO PROPER AND CONVENIENT OPERATION, REQUIRED OR IMPLIED, SHALL BE SUPPLIED AND INSTALLED BY THE CONTRACTOR WITHOUT EXTRA CHARGE, EVEN THOUGH NOT SPECIFICALLY CALLED OUT.  
 F. INSTALLATION SHALL COMPLY WITH OSHA STANDARDS.  
 G. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR HIS OWN CLEAN UP AND REMOVAL OF SCRAP FROM THE JOB SITE. THE ELECTRICAL CONTRACTOR SHALL MAINTAIN A CLEAN AND SAFE WORK AREA. THE ENGINEER IS NOT RESPONSIBLE FOR JOB SITE SAFETY. IN CASE OF CONFLICT BETWEEN THE PLANS AND SPECIFICATIONS OR CONFLICT BETWEEN INFORMATION PRESENTED ON THE PLANS OR IN THE SPECIFICATIONS, THEN THE MOST RESTRICTIVE SHALL TAKE PRECEDENT.  
 H. DIVISION 1 SHALL BECOME APART OF THESE SPECIFICATIONS BY REFERENCE.  
 I. ALL ELECTRICAL COMPONENTS SHALL BE INSTALLED, SUPPORTED, AND RESTRAINED IN ACCORDANCE WITH THE NORTH CAROLINA BUILDING CODE REQUIREMENTS FOR SEISMIC DESIGN. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RETAIN A PROFESSIONAL ENGINEER COMPETENT IN THIS FIELD FOR THIS DESIGN. FOR ONE POSSIBLE SOURCE FOR THIS SERVICE CONTACT SEISMIC CONTROL AND ISOLATIONS, INC. PHONE: 910 799-5204. ALL REQUIRED INSPECTIONS FOR THESE DESIGNS SHALL BE PERFORMED BY APPROVED INSPECTORS AND AGENCIES PROVIDED BY OWNER AND OWNER'S AGENT.
- 1602 SCOPE  
 WORK SHALL INCLUDE BUT IS NOT LIMITED TO:  
 A. PROVIDE SERVICES TO THE ADDITION AS INDICATED AND INTENDED BY PLANS.  
 B. PROVIDE AND INSTALL FIXTURES AS SHOWN ON THE PLANS.  
 C. PROVIDE AND INSTALL WIRING DEVICES, PANELS, AND CONDUIT.  
 D. PROVIDE AND INSTALL DATA/TELEPHONE BOXES.  
 E. PROVIDE CONNECTIONS TO MECHANICAL, AND PLUMBING EQUIPMENT.  
 F. PROVIDE REQUIRED DEMOLITION.
- 1603 MATERIALS  
 CONDUCTORS  
 1. ALL WIRE SHALL BE COPPER. WIRE #8 AND LARGER SHALL BE STRANDED.  
 2. USE WIRE WITH THHN/THWN INSULATION FOR ALL WIRE.  
 3. POWER CONDUCTORS SHALL BE #12 AWG MINIMUM. PILOT AND CONTROL CIRCUITS MAY BE #14 AWG.  
 CONDUIT  
 1. UNDERGROUND CONDUIT SHALL BE PVC. CHANGE TO RIGID GALVANIZED BELOW CONCRETE FLOOR AND STUB UP THROUGH FLOOR WITH RIGID GALVANIZED.  
 2. ARMOR CLAD CABLE SHALL BE ALLOWED IN CONCEALED AREAS.  
 3. OTHER ABOVE GRADE CONDUIT SHALL BE EMT WITH STEEL COMPRESSION FITTINGS. IF EXPOSED TO MECHANICAL DAMAGE CONDUIT SHALL BE RIGID GALVANIZED.  
 4. CONNECTIONS TO EQUIPMENT AND FIXTURES SHALL BE MADE WITH SEAL TIGHT FLEX CONDUIT FOR EXTERIOR CONNECTIONS AND GREENFIELD FOR INTERIOR CONNECTIONS.  
 5. WIRING DEVICES SHALL BE ONE MAKE, UNDERWRITERS APPROVED, MANUFACTURED BY PASS & SEYMOUR, HUBBELL OR EQUAL. DEVICE COVERS SHALL BE WEATHERPROOF FOR EXTERIOR COVERS. WIRING DEVICES SHALL BE STANDARD GRADE, TAMPER RESISTANT TYPE. COLOR SHALL BE DETERMINED BY THE ARCHITECT.  
 DISTRIBUTION EQUIPMENT SHALL BE THE LATEST PRODUCTS, MANUFACTURER SHALL BE G.E., SQUARE D, EATON OR SIEMENS INTERIOR EQUIPMENT SHALL BE NEMA 1 AND EXTERIOR EQUIPMENT SHALL BE NEMA 3R MINIMUM.  
 COORDINATE WITH POWER COMPANY TO OBTAIN BREAKER KAIC RATINGS. DRAWINGS SHALL INDICATE MINIMUM RATING. ALL BREAKERS SHALL BE BOLT ON TYPE. MAIN PANEL SHALL BE SERVICE ENTRY RATED AND LABELED. BREAKERS SHALL BE SERIES AND CURRENT LIMITING RATED.  
 PROVIDE MOTOR RATED SWITCHES FOR SWITCHES SERVING MOTORS AS REQUIRED.  
 FUSES SHALL BE CURRENT LIMITING TIME DELAY FUSES "CLASS RK5".  
 H. ALL EQUIPMENT AND FIXTURES SHALL BE UL APPROVED.  
 I. PROVIDE LAMPS FOR ALL FIXTURES. LAMPS SHALL BE G.E. OR PHILIPS.
- 1604 EXECUTION  
 A. UNLESS OTHERWISE NOTED, SET ALL RECEPTACLES SET ALL RECEPTACLES AT 16" AFF, AND SET ALL SWITCHES AT 48" AFF.  
 B. HOLES SHALL BE DRILLED OR CUT. DO NOT BREAK HOLES.  
 C. THE ELECTRICAL CONTRACTOR SHALL DO ALL CUTTING, PATCHING AND PAINTING NECESSARY TO INSTALL ALL EQUIPMENT AS REQUIRED UNDER THIS CONTRACT, AND SHALL ESTABLISH ALL FINISHES WHEN CUTTING AND PATCHING OCCUR TO THEIR ORIGINAL CONDITION. QUALIFIED WORKERS SHALL DO ALL CUTTING AND PATCHING WORK (I.E. DRY WALL CUTTING AND PATCHING SHALL BE DONE BY QUALIFIED DRY WALL CRAFTSMEN).  
 D. PATCHING SHALL BE DONE BY THE ELECTRICAL CONTRACTOR. ALL PATCHING SHALL BE DONE BY A CRAFTSMAN SKILLED IN THE WORK BEING PERFORMED.  
 E. WIRE SHALL BE COLOR CODED AS FOLLOWS:  

120/240	BLACK
PHASE A	RED
PHASE B	WHITE
NEUTRAL	GREEN
GROUND	

 F. CONTRACTOR SHALL CONFIRM THE LOCATION OF ALL EQUIPMENT AND POWER REQUIREMENTS FOR ALL EQUIPMENT BEFORE RUNNING SERVICE. CONDUIT AND WIRING IN FINISHED AREAS SHALL BE CONCEALED. ANY EXPOSED CONDUIT SHALL BE RUN IN A NEAT FASHION AND SHALL BE RUN PERPENDICULAR AND PARALLEL TO THE BUILDING LINES.  
 G. TELEPHONE AND COMPUTER OUTLETS SHALL BE DUPLEX RECEPTACLE BOXES WITH 3/4" EMT STUBBED INTO THE CEILING WITH PULL STRINGS INSTALLED.  
 I. CONTRACTOR SHALL PRESERVE ALL FIRE RATED WALLS AND CEILINGS. VERIFY RATING WAS OFF THE ARCHITECTURAL PLAN. THIS SHALL INCLUDE USING CAULKING THAT IS UL APPROVED FOR THE APPLICATIONS, OFFSETTING BOXES AS REQUIRED AND PROVIDING RATED CAPS OR COVERS FOR LIGHTS, AS REQUIRED.  
 J. IN ALL PATIENT TREATMENT AREAS SUPPLY METAL RACEWAY SYSTEM OR HOSPITAL GRADE AC CABLE WITH REDUNDANT GROUNDING PER NEC 517.13. THE GROUNDING CONDUCTOR SHALL BE INSULATED.
- 1605 DIRECTORY CARDS, NAME PLATES & EQUIPMENT LABELS  
 PROVIDE A TYPED DIRECTORY CARD IN EACH PANELBOARD INDICATING ELECTRICAL DEVICES OR EQUIPMENT SERVED BY EACH CIRCUIT BREAKER. FURNISH BLANK COVERPLATE.  
 B. PROVIDE NAMEPLATES FOR PANELS AND DISCONNECTS. NAMEPLATES SHALL BE LAMINATED PLASTIC. EACH NAMEPLATE SHALL IDENTIFY THE PANEL AND THE VOLTAGE. NAMEPLATES SHALL BE MELAMINE PLASTIC, 0.125 INCH THICK, BLACK WITH WHITE CENTER CORE. SURFACE SHALL BE WHITE FINISH. CORNERS SHALL BE SQUARE. ACCURATELY ALIGN LETTERING AND ENGRAVE INTO CORE. MINIMUM SIZE OF NAMEPLATES SHALL BE 1X2.5 INCHES. LETTERING SHALL BE A MINIMUM OF 0.25 INCHES HIGH, NORMAL BLOCK STYLE.
- 1606 TEST & ADJUSTMENTS  
 A. TEST AND ADJUST THE ELECTRICAL SYSTEM AND RELATED WORK PROVIDED UNDER THIS DIVISION OF THE SPECIFICATIONS.  
 B. TEST ALL CIRCUITS WITH A "MEGGER" TEST TO DETERMINE THAT THE SYSTEM IS FREE OF SHORT CIRCUITS AND THAT PHASE CONDUCTORS ARE NOT GROUNDED. CHECK ALL ELECTRICAL EQUIPMENT FOR PROPER OPERATIONS.
- 1607 GROUNDING  
 A. THE SERVICE EQUIPMENT, CONDUIT SYSTEM SUPPORT CABINETS, EQUIPMENT AND NEUTRAL CONDUCTOR SHALL BE GROUNDED IN ACCORDANCE WITH ARTICLE 250 OF THE LATEST EDITION OF THE NATIONAL ELECTRIC CODE. GROUNDING CONDUCTORS SHALL BE SO ROUTED AS TO PERMIT, AS FAR AS PRACTICAL, THE SHORTEST AND MOST DIRECT PATH TO THE GROUND ELECTRODE SYSTEM. ALL GROUND CONNECTIONS SHALL HAVE A CLEAN CONTACT SURFACE.  
 B. RUN A SEPARATE EQUIPMENT GROUND IN ALL FEEDS.
- 1608 SUBSTITUTION  
 A. ALL MATERIALS SHALL BE NEW UNLESS OTHERWISE SHOWN OR SPECIFIED AND SHALL BE OF THE VERY BEST QUALITY AS SPECIFIED.  
 B. REQUESTS TO SUBSTITUTE OTHER MATERIALS OR PRODUCTS FOR THOSE SPECIFIED SHALL BE SENT IN WRITING TO THE OWNER. REQUEST SHALL BE ACCOMPANIED BY ENGINEERING DATA, SPECIFICATION SHEETS, ETC., AS NECESSARY TO FULLY IDENTIFY AND APPRAISE THE PRODUCTS.  
 C. APPROVAL OF EQUIPMENT WILL NOT RELIEVE THE CONTRACTOR OF NONCOMPLIANCE WITH THE SPECIFICATIONS EVEN IF SUCH APPROVAL IS MADE IN WRITING, UNLESS THE ENGINEER IS CALLED TO THE NONCONFORMING FEATURES BY LETTER ACCOMPANYING THE SUBMITTAL DATA.
- 1609 VISIT TO SITE  
 ALL BIDDERS ON THIS WORK SHALL VISIT THE SITE AND THOROUGHLY FAMILIARIZE THEMSELVES WITH EXISTING CONDITIONS BEFORE SUBMITTING THEIR BIDS. NO ALLOWANCE WILL BE MADE FOR LACK OF KNOWLEDGE OF EXISTING CONDITION.
- 1610 SHOP DRAWINGS  
 AS SOON AS POSSIBLE (AND NOT MORE THAN 30 DAYS) AFTER THE CONTRACT IS SIGNED, THE CONTRACTOR SHALL SUBMIT FIVE (5) COPIES OF THE SHOP DRAWINGS COVERING LIGHTING FIXTURES, PANELS, CIRCUIT, BREAKERS, AND WIRING DEVICES, AND ALL SPECIAL EQUIPMENT WHICH HE INTENDS TO USE. SHOP DRAWINGS SHALL BE SUBMITTED TO THE OWNER FOR HIS APPROVAL.

ELECTRICAL LEGEND	
SYMBOL	DESCRIPTION
○	LIGHT FIXTURE. REFER TO LIGHTING FIXTURE SCHEDULE.
S	SWITCH, SINGLE POLE, 120VAC, MOUNTED AT 48" AFF TO TOP OF OUTLET BOX
D	DIMMER, SINGLE POLE, 120VAC, MOUNTED AT 48" AFF TO TOP OF OUTLET BOX
Sw	SWITCH, THREE WAY, 120VAC, MOUNTED AT 48" AFF TO TOP OF OUTLET BOX
Sw	SWITCH, FOUR WAY, 120VAC, MOUNTED AT 48" AFF TO TOP OF OUTLET BOX
Di	DIMMER, THREE WAY, 120VAC, MOUNTED AT 48" AFF TO TOP OF OUTLET BOX
SwS	SWITCH/OCCUPANCY SENSOR, 120VAC, MOUNTED AT 48" AFF TO TOP OF OUTLET BOX
DiS	DIMMER/OCCUPANCY SENSOR, 120VAC, MOUNTED AT 48" AFF TO TOP OF OUTLET BOX
⊕	DUPLEX RECEPTACLE, 120VAC, MOUNTED AT 18" AFF TO CENTER OF OUTLET BOX, UNO, TAMPER RESISTANT.
⊕	DOUBLE DUPLEX RECEPTACLE, 120VAC, MOUNTED AT 18" AFF TO CENTER OF OUTLET BOX, UNO, TAMPER RESISTANT.
⊕	250V RECEPTACLE, ## = RATED AMPS OF DEVICE, MOUNT IN SINGLE GANG BOX AT 18" AFF TO CENTER OF OUTLET BOX, UNO
⊕	PHONE/DATA OUTLET, MOUNTED AT 18" AFF TO CENTER OF OUTLET BOX
⊕	JUNCTION BOX
⊕	EXTERIOR PEDESTAL RECEPTACLE, 120VAC, 20A, WP ENCLOSURE
⊕	TELEVISION OUTLET
⊕	ELECTRICAL PANEL, SURFACE
⊕	ELECTRICAL PANEL, RECESSED
⊕	DISCONNECT SWITCH, FUSING AS INDICATED. SIZE FUSES IN ACCORDANCE WITH NAMEPLATE DATA OF EQUIPMENT TO BE PROTECTED.
⊕	FAN BY MECHANICAL CONTRACTOR

ELECTRICAL ABBREVIATIONS	
AFF	ABOVE FINISHED FLOOR
GFI	GROUND FAULT INTERRUPTING
NL	NIGHT LIGHT (UNSWITCHED)
UNO	UNLESS NOTED OTHERWISE
AU	AT UNIT
WP	WEATHERPROOF
AHU	AIR HANDLING UNIT
HP	HEAT PUMP
CLG	MOUNTED IN ABOVE CEILING
	VERTICAL WITH OR

NOTES:  
 1. ALL SERVICE WIRE SHALL BE INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE.  
 2. ALL REQUIRED CONNECTIONS BETWEEN DISCONNECTS SHALL BE MADE IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE. COORDINATE WITH MECHANICAL CONTRACTOR.

LIGHTING FIXTURE SCHEDULE


SYMBOL	DESCRIPTION	LAMP					MANUF.	MODEL	MOUNTING	REMARKS	
		NO.	WATT	LUMENS	TEMP (*K)	TYPE					
A	4' UP/DOWN	-	100	7,500	3,000	LED	120	DAY-BRITE	ALE75L8304D5120D1M1U-HD5R	WALL @ 7'-6"	VERIFY FINISH
B	2' x4' SURFACE	-	39	4,800	3,500	LED	120	DAY-BRITE	2FXP48L835-4-DS-120-01M	CEILING SURFACE	VERIFY FINISH
C	LED DISK	-	23	2,200	3,500	LED	120	LIGHTOLIER	S10R85K22M2	CEILING SURFACE	VERIFY FINISH
D	LED DISK	-	14	1,000	3,000	LED	120	LIGHTOLIER	S7R830K10AL	CEILING SURFACE	VERIFY FINISH WET LOCATION LISTED
F	2' x4' SURFACE	-	58	6,000	3,500	LED	120	DAY-BRITE	2FXP60L835-4-DS-120-01M	CEILING SURFACE	VERIFY FINISH
G	COMPACT BOLLARD	-	19	955	4000K	LED	120	KIM LIGHTING	CB24-15L4K-UV-WH	CONC. BASE SEE A/ED. 1	-
H	NIGHT LIGHT	-	3	23	2850K	LED	120	CHLORIDE	WQ2V1AL-PCC	WALL	INTERNAL PHOTO SENSOR
DA	CHANDELLIER	6	9	-	4,000K	LED	120	ULTRALIGHTS	15347-SP-0A-08	PENDANT	-
DB	MINI PENDANT	-	8	-	3,000K	LED	120	TECH LIGHTING	700MPRVLS5-LEDS830	PENDANT	-
DC	PENDANT	-	25	3,850	4,000K	LED	120	ULTRALIGHTS	11206-24-SP-0A-08	PENDANT	-
DD	FLUSH MOUNT	-	24	-	4,000K	LED	120	ULTRALIGHTS	18360-18-0-0	PENDANT	-
DE	CHANDELLIER	9	9	-	4,000K	LED	120	ULTRALIGHTS	15347-SP-0A-08	PENDANT	-
DF	SEMI FLUSH	-	30	-	4,000K	LED	120	ULTRALIGHTS	0480-30-0-04	SURFACE CEILING	-
DG	SCONCE	1	9	-	4,000K	LED	120	TECH LIGHTING	700MPRVLS5-LEDS830	WALL	-
DH	SURFACE MOUNT	-	39	2,650	3,000K	LED	120	PROGRESS	P7251-0930K9	SURFACE CEILING	-
DJ	SURFACE MOUNT	-	22	1,630	3,000K	LED	120	PROGRESS	P7249-0930K9	SURFACE CEILING	-
DK	VANITY FIXTURE	2	-	-	3,000K	LED	120	HUNLEY	50528N-LED	WALL	-
O	ATTIC LIGHT	1	-	-	3,500K	LED	120	LEVITON	9850-LED	TRUSS/RAFTER	PROVIDE SWITCH AT NEAREST ATTIC ENTRANCE.
⊕	EXTERIOR EMERGENCY	8	-	-	-	LED	120	CHLORIDE	PLEMBZ	WALL @ 9'-0" AFF	NOTE 2
⊕	RECEPTACLE	-	-	-	-	LED	120	CHLORIDE	ER45VXLSC1RC	CEILING SURFACE	VERIFY FACE QUANTITIES AND CHEVRONS, SEE LIGHTING PLANS

- CONTRACTOR SHALL PROVIDE ALL LAMPS.
- FIXTURE SHALL BE CONTROLLED VIA PHOTOCELL/TIMECLOCK UNDER NORMAL OPERATION AND SHALL OVERRIDE CONTROLS FOR EMERGENCY LIGHTING OPERATION. PROVIDE FIRE RATED JUNCTION BOXES AND ENCLOSURES TO MAINTAIN FIRE RATING OF CEILING OR WALLS.

EQUIPMENT CONNECTION SCHEDULE

SYMBOL	DESCRIPTION	HP	KW	AMP	VOLT	PHASE	BKR	FEEDER		CONNECTION	REMARKS
								COND	WIRE		
AHU-1, 3a, 3b	AIR HANDLING UNIT	-	-	14	120	1	15/1	1/2"	2#12, 1#12G	FUSED DISC NEMA 1	-
AHU-2	AIR HANDLING UNIT	-	-	8	120	1	15/1	1/2"	2#12, 1#12G	FUSED DISC NEMA 1	-
AHU-5	AIR HANDLING UNIT	-	-	11	120	1	15/1	1/2"	2#12, 1#12G	FUSED DISC NEMA 1	-
AHU-6, 7	AIR HANDLING UNIT	-	-	9	120	1	15/1	1/2"	2#12, 1#12G	FUSED DISC NEMA 1	-
HP-1, 3a, 3b	HEAT PUMP	-	-	31	208	1	50/2	3/4"	2#8, 1#10G	FUSED DISC NEMA 3R	-
HP-2	HEAT PUMP	-	-	14	208	1	25/2	1/2"	2#12, 1#10G	FUSED DISC NEMA 3R	-
HP-5	HEAT PUMP	-	-	22	208	1	35/2	3/4"	2#8, 1#10G	FUSED DISC NEMA 3R	-
HP-6	HEAT PUMP	-	-	17	208	1	25/2	3/4"	2#12, 1#10G	FUSED DISC NEMA 3R	-
HP-7	HEAT PUMP	-	-	18	208	1	30/2	3/4"	2#10, 1#10G	FUSED DISC NEMA 3R	-
ERV-1, 2, 3, 4	ENERGY RECOVERY VENTILATOR	-	-	17	120	1	25/1	1/2"	2#12, 1#10G	FUSED DISC NEMA 1	-
TW-1	THRU WALL UNIT	-	-	16	208	1	20/2	1/2"	2#12, 1#12G	FUSED DISC NEMA 1	-
DU/DAHU	DUCTLESS SPLIT	-	-	11	208	1	15/2	1/2"	2#12, 1#12G	FUSED DISC NEMA 1	DAHU FED FROM DU BY MC
A⊕	FIREPLACE	-	-	20	208	1	30/2	1/2"	2#10, 1#10G	RECEPTACLE	-

- EQUIPMENT CONNECTION NOTES:  
 1. CONTRACTOR SHALL VERIFY ALL CONNECTIONS BEFORE RUNNING SERVICE OR ORDERING EQUIPMENT.

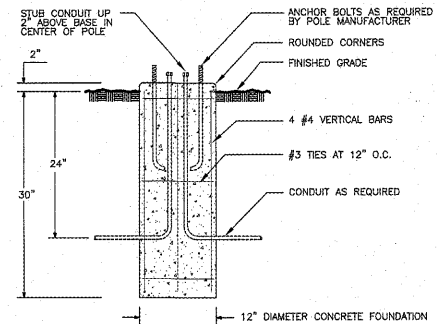

NOTE: ALL CONCRETE WORK SHALL CONFORM TO SPECIFICATIONS AND SHALL BE -3000 PSI MIN. COMPRESSIVE STRENGTH AT 28 DAYS.  
**A TYPE G BOLLARD BASE DETAIL**  
 SCALE: NTS

ARCHITECT  
 TIMOTHY  
 KURMASKIE  
 AIA, NCARB

1030 Washington St  
 Raleigh, NC 27605  
 Phone: 919-846-1600  
 Fax: 919-846-9404  
 ARCHITECTS@TK.COM

CONTRACT 2019  
 (ARCHITECT TIMOTHY KURMASKIE, AIA, NCARB)



DAVID SIMS & ASSOCIATES, P.C.  
 Consulting Engineers  
 Arboretum Centre  
 108 Giles Avenue - Suite 100  
 Wilmington, N.C. 28405  
 (910) 791-8016 (OFFICE)  
 (910) 395-5734 (FAX)

ALTERATION & ADDITION TO:  
**PruittHealth**  
**Savannah**  
 12825 WHITE BLUFF ROAD  
 SAVANNAH, GA 31419

Project Reference Numbers  
 Architect's Project No. 180017

Drawn By:  
 REVISIONS

DATES	
PHASE	ISSUED
PERMIT SET	05/22/19

SCHEDULES, LEGENDS  
 AND DETAILS  
 SHEET NUMBER

**E0.1**

Order Plans @ WWW.ORDERPLANS.COM