
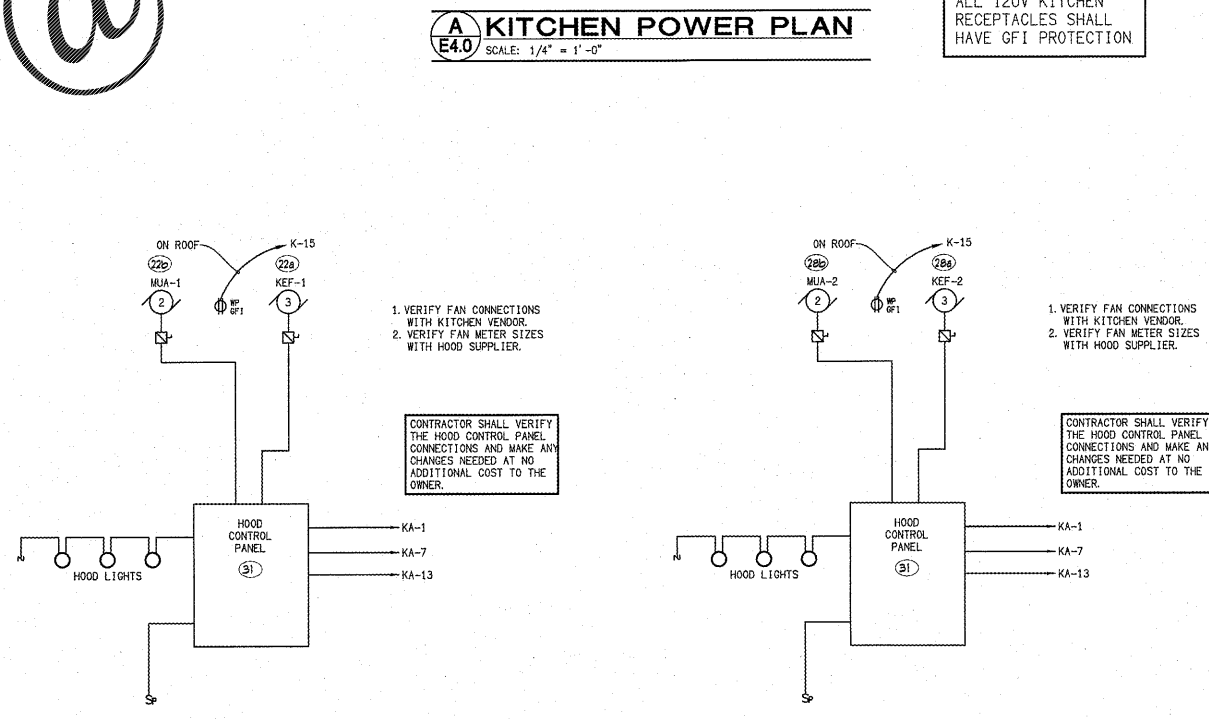


| CIRCUIT | LOAD | DESCRIPTION | NOTES/BREAKER | WIRE | CONDUIT | PHASE | AMP | VOLT | PHASE | BKR | FEEDER | CONNECTION | REMARKS |
|---------|------|-------------------------|---------------|-------------|--------------------|-------|-----|------|-------|-----|--------|------------|--------------------------------|
| 10 | 50 | REFRIGERATOR | | 2#12, 1#12G | 5-15R | | | | | | | | |
| 11 | 50 | MIXER | | 2#12, 1#12G | 5-15R | | | | | | | | |
| 12 | 50 | SLICER | | 2#12, 1#12G | 5-15R | | | | | | | | |
| 13 | 10.5 | BLIXER | | 2#12, 1#12G | 5-15R | | | | | | | | |
| 14 | 11 | ICE CUBER | | 2#12, 1#12G | FUSED DISC NEMA 3R | | | | | | | | |
| 15 | 3 | CONVECTION OVEN | | 2#12, 1#12G | 5-15R | | | | | | | | |
| 16 | 12 | STEAMER | | 2#12, 1#12G | DIRECT | | | | | | | | |
| 17a | 3 | KEF-1 | | 3#10, 1#10G | FUSED DISC NEMA 3R | | | | | | | | |
| 17b | 2 | MUA-1 | | 3#12, 1#12G | FUSED DISC NEMA 3R | | | | | | | | |
| 18 | 8 | TILT SKILLET | | 2#12, 1#12G | 5-20R | | | | | | | | |
| 19a | 3 | KEF-2 | | 3#10, 1#10G | FUSED DISC NEMA 3R | | | | | | | | |
| 19b | 2 | MUA-2 | | 3#12, 1#12G | FUSED DISC NEMA 3R | | | | | | | | |
| 20 | 5 | FIRE SUPPRESSION SYSTEM | | 2#12, 1#12G | CONTROL PANEL | | | | | | | | |
| 21 | 5 | REFRIG. TABLE | | 2#12, 1#12G | 5-15R | | | | | | | | |
| 22 | 12 | COFFEE BREWER | | 2#12, 1#12G | RECEPTACLE | | | | | | | | VERIFY CONNECTION REQUIREMENTS |
| 23 | 5 | TEA BREWER | | 2#12, 1#12G | 5-20R | | | | | | | | |
| 24 | 8 | COFFEE GRINDER | | 2#12, 1#12G | 5-20R | | | | | | | | |
| 25 | 19 | LOW TEMP COMP | | 2#12, 1#12G | FUSED DISC NEMA 3R | | | | | | | | |
| 26 | 7 | MEDIUM TEMP COMP | | 2#12, 1#12G | FUSED DISC NEMA 3R | | | | | | | | |
| 27 | 10 | LOW TEMP UNIT | | 2#12, 1#12G | FUSED DISC NEMA 3R | | | | | | | | |
| 28 | 2 | MED TEMP UNIT | | 2#12, 2#12G | SWITCH | | | | | | | | |
| 29 | 2 | FREEZER/COOLER LTG | | 2#12, 1#12G | DIRECT | | | | | | | | |
| 30 | 8 | DISPOSAL | | 2#12, 1#12G | FUSED DISC NEMA 3R | | | | | | | | |
| 31 | 10 | DISHWASHER HOOD | | 2#10, 1#10G | SWITCH | | | | | | | | |
| 32 | 111 | DISHWASHER | | 3#1/0, 1#6G | FUSED DISC NEMA 3R | | | | | | | | |
| 33 | 22 | TOASTER | | 2#10, 1#10G | 6-30R | | | | | | | | |

| SYMBOL | DESCRIPTION | HP | KW | AMP | VOLT | PHASE | BKR | FEEDER | | CONNECTION | REMARKS |
|--------|-------------------------|-----|----|------|------|-------|-------------|--------|-------------|--------------------|--------------------------------------|
| | | | | | | | | COND | WIRE | | |
| 10 | REFRIGERATOR | - | - | 4 | 120 | 1 | 15/1 | 1/2" | 2#12, 1#12G | 5-15R | - |
| 11 | MIXER | - | - | 6 | 120 | 1 | 15/1 | 1/2" | 2#12, 1#12G | 5-15R | - |
| 12 | SLICER | - | - | 5 | 120 | 1 | 15/1 | 1/2" | 2#12, 1#12G | 5-15R | - |
| 13 | BLIXER | - | - | 10.5 | 120 | 1 | 15/1 | 1/2" | 2#12, 1#12G | 5-15R | - |
| 14 | ICE CUBER | - | - | 11 | 208 | 1 | 20/2 | 1/2" | 2#12, 1#12G | FUSED DISC NEMA 3R | - |
| 15 | CONVECTION OVEN | - | - | 3 | 120 | 1 | 15/1 | 1/2" | 2#12, 1#12G | 5-15R | - |
| 16 | STEAMER | - | - | 12 | 120 | 1 | 20/1 | 1/2" | 2#12, 1#12G | DIRECT | REQUIRES 2 CONNECTIONS, SAME CIRCUIT |
| 17a | KEF-1 | 3 | - | 11 | 208 | 3 | 30/3 | 1/2" | 3#10, 1#10G | FUSED DISC NEMA 3R | - |
| 17b | MUA-1 | 2 | - | 8 | 208 | 3 | 20/3 | 1/2" | 3#12, 1#12G | FUSED DISC NEMA 3R | - |
| 18 | TILT SKILLET | - | - | 8 | 120 | 1 | 20/1 | 1/2" | 2#12, 1#12G | 5-20R | - |
| 19a | KEF-2 | 3 | - | 11 | 208 | 3 | 30/3 | 1/2" | 3#10, 1#10G | FUSED DISC NEMA 3R | - |
| 19b | MUA-2 | 2 | - | 8 | 208 | 3 | 20/3 | 1/2" | 3#12, 1#12G | FUSED DISC NEMA 3R | - |
| 20 | FIRE SUPPRESSION SYSTEM | - | - | 5 | 120 | 1 | 20/1 | 1/2" | 2#12, 1#12G | CONTROL PANEL | - |
| 21 | REFRIG. TABLE | - | - | 5 | 120 | 1 | 15/1 | 1/2" | 2#12, 1#12G | 5-15R | - |
| 22 | COFFEE BREWER | - | - | 12 | 208 | 1 | 20/2 | 1/2" | 2#12, 1#12G | RECEPTACLE | VERIFY CONNECTION REQUIREMENTS |
| 23 | TEA BREWER | - | - | 5 | 120 | 1 | 20/1 | 1/2" | 2#12, 1#12G | 5-20R | - |
| 24 | COFFEE GRINDER | - | - | 8 | 120 | 1 | 20/1 | 1/2" | 2#12, 1#12G | 5-20R | - |
| 25 | LOW TEMP COMP | - | - | 19 | 208 | 1 | 30/2 | 1/2" | 2#12, 1#12G | FUSED DISC NEMA 3R | - |
| 26 | MEDIUM TEMP COMP | - | - | 7 | 208 | 1 | 15/1 | 1/2" | 2#12, 1#12G | FUSED DISC NEMA 3R | - |
| 27 | LOW TEMP UNIT | - | - | 10 | 208 | 1 | 15/1 | 1/2" | 2#12, 1#12G | FUSED DISC NEMA 3R | - |
| 28 | MED TEMP UNIT | - | - | 2 | 120 | 1 | 20/1 | 1/2" | 2#12, 2#12G | SWITCH | - |
| 29 | FREEZER/COOLER LTG | - | - | 2 | 20/1 | 1/2" | 2#12, 1#12G | DIRECT | | | |
| 30 | DISPOSAL | - | - | 8 | 208 | 1 | 15/2 | 1/2" | 2#12, 1#12G | FUSED DISC NEMA 3R | - |
| 31 | DISHWASHER HOOD | 1/2 | - | 10 | 120 | 1 | 30/1 | 1/2" | 2#10, 1#10G | SWITCH | - |
| 32 | DISHWASHER | - | - | 111 | 208 | 3 | 150/3 | 1 1/2" | 3#1/0, 1#6G | FUSED DISC NEMA 3R | - |
| 33 | TOASTER | - | - | 22 | 208 | 1 | 30/2 | 1/2" | 2#10, 1#10G | 6-30R | - |

EQUIPMENT CONNECTION NOTES:
 1. CONTRACTOR SHALL VERIFY ALL CONNECTIONS BEFORE RUNNING SERVICE OR ORDERING EQUIPMENT.
 2. VERIFY LOCATION OF EQUIPMENT AND RUGH IN REQUIREMENTS WITH KITCHEN VENDOR PRIOR TO RUGH IN.
 3. CONTRACTOR SHALL PROVIDE ALL DISCONNECTING MEANS AS INDICATED UNLESS EQUIPMENT IS PROVIDED WITH INTEGRAL DISCONNECT.

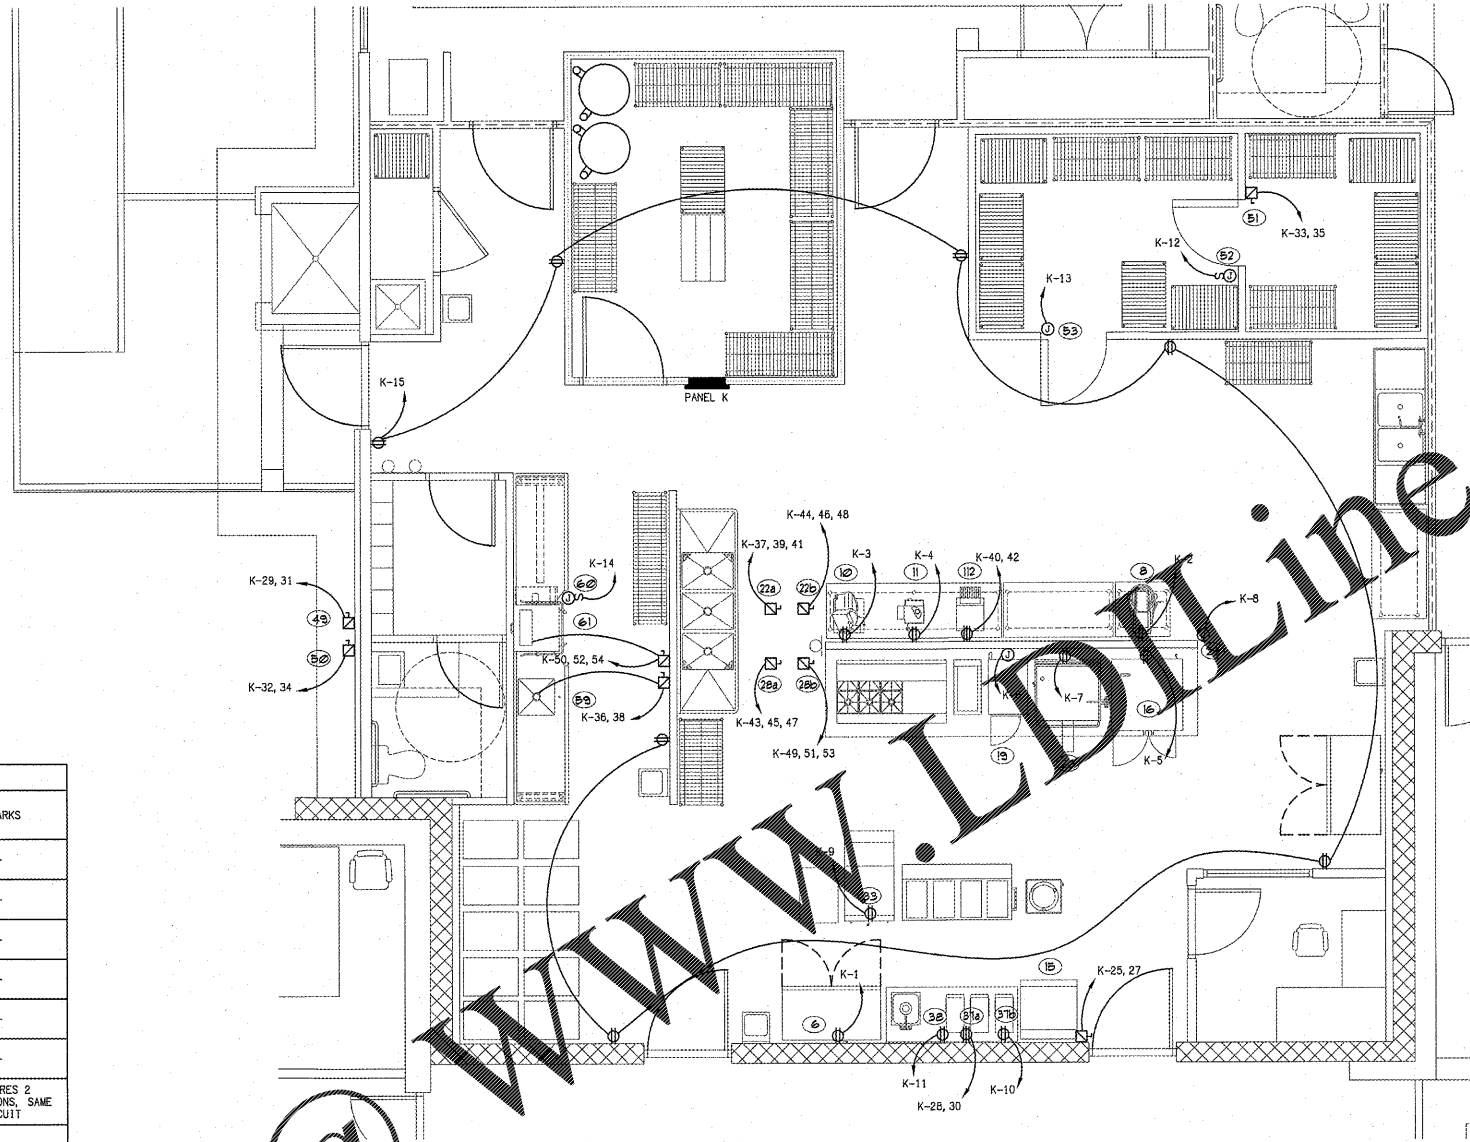

C HOOD FANS WIRING SCHEMATIC
 E4.0 NTS

ARCHITECT
TIMOTHY
KURMASKIE
AIA, NCARB

1030 Washington St
 Raleigh, NC 27605
 Phone: 919-846-1600
 Fax: 919-846-9404
ARCHITECTSKT.COM

THE DRAWINGS AND DESIGN SHOWN ARE THE PROPERTY OF ARCHITECT TIMOTHY KURMASKIE, AIA, NCARB. THE REPRODUCTION OR USE OF THIS PROPERTY WITHOUT THE WRITTEN CONSENT FROM THE ARCHITECT IS PROHIBITED AND ANY INFRINGEMENT OF THESE RIGHTS IS SUBJECT TO LEGAL ACTION.



DAVID SIMS & ASSOCIATES, P.C.
Consulting Engineers
 Arboretum Centre
 108 Giles Avenue - Suite 100
 Wilmington, N.C. 28403
 (910) 791-8016 (OFFICE)
 (910) 395-5734 (FAX)

ALTERATION & ADDITION TO:
PruittHealth
Savannah
 12825 WHITE BLUFF ROAD
 SAVANNAH, GA 31419

Project Reference Numbers
 Architect's Project No. 180017

Drawn By:
REVISIONS

| DATES | |
|------------|----------|
| PHASE | ISSUED |
| PERMIT SET | 05/22/19 |

KITCHEN PLAN
 SHEET NUMBER

E4.0