

Luminaire Schedule							
Symbol	Qty	Label	Arrangement	LMF	Lum. Lumens	Lum. Watts	Part Number
⬇	2	P2	2 @ 90 DEGREES	1.000	22330	160	OSQ-A-NM-4ME-T-57K-UL-BZ + OSQ-B-AABZ
□	3	P1	SINGLE	1.000	22330	160	OSQ-A-NM-4ME-T-57K-UL-BZ + OSQ-B-AABZ

Calculation Summary (Footcandles calculated using predicted lumen values @ 50K hrs of operation)						
Label	Units	Avg	Max	Min	Avg/Min	Max/Min
Off Pavement	Fc	0.92	7.8	0.0	N.A.	N.A.
Pavement	Fc	2.98	8.2	0.8	3.73	10.25

Fixture Mounting Height: 28' AFG (25' Pole + 3.0' Base)



POLE SCHEDULE:

- (5) CL-SSP-4011-25-OT-BZ (25' x 4" STEEL SQUARE POLE, 11ga)
- (3) PB-1A4 SINGLE TENON
- (2) PB-2A4 TWIN TENON
- (3) OSQ-B-AABZ (Adjustable Arm Mount)

PROPOSED POLES MEET 100 MPH SUSTAINED WINDS

***CUSTOMER TO VERIFY MOUNTING, VOLTAGE, AND COLOR PRIOR TO PLACING ORDER

Order Plans @ WINWINLDI.com

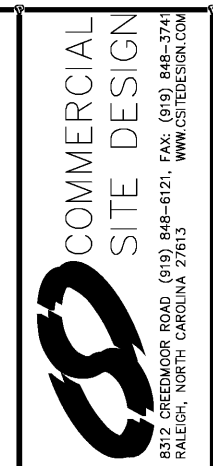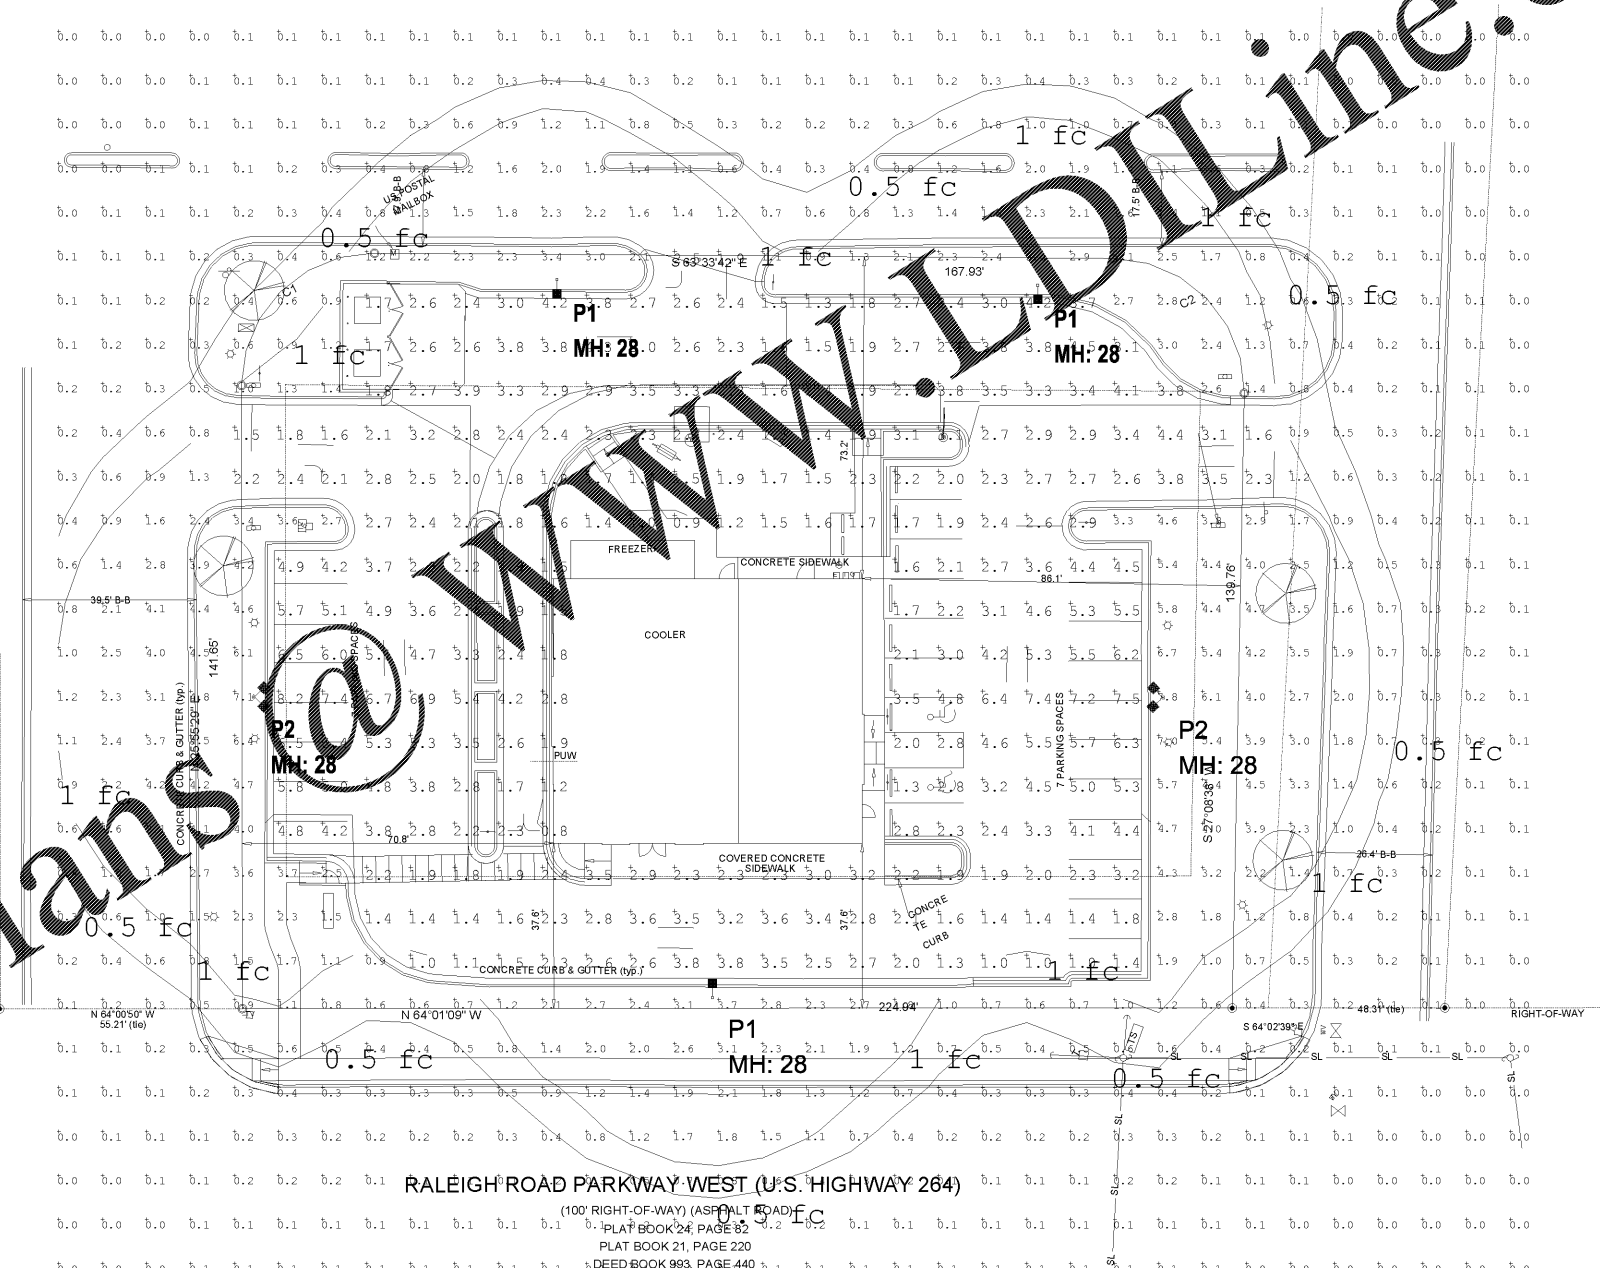

CLIENT:
WILDOR
RESTAURANT GROUP
7408 SIEMENS ROAD
WENDELL,
NORTH CAROLINA 27591

PROJECT:
POPEYES
1702 RALEIGH ROAD PARKWAY WEST
WILSON, NORTH CAROLINA



REVISIONS:	
DATE	COMMENTS
11-12-19	CITY COMMENTS
12-06-19	CITY COMMENTS #2
05-12-20	BUILDING FOOTPRINT

PROJECT NO.	POP-1904
FILENAME	POP1904-LP
DRAWN BY	DDH
SCALE	NTS
DATE	10-02-2019
SHEET NO.	C-10



illumination results shown on this lighting design are based on project parameters provided to Cree, Inc. used in conjunction with luminaire test procedure conducted under laboratory conditions. Actual project conditions differing from these design parameters may affect field results. The customer is responsible for verifying dimensional accuracy along with compliance with any applicable electrical, lighting or energy codes.

Project Name: Popeye's - 1702 Raleigh Road Parkway West, Wilson NC	Layout By: Ben Foster
US HWY 264	Date: 5/28/2020
Footcandles calculated at grade	Filename: POP-200528WINCBFA.GI

LIGHTING PLAN