

**LIGHTING FIXTURE SCHEDULE**

MARK	MANUFACTURER	CATALOG NO.	LAMPS			MOUNTING HEIGHT	MOUNTING TYPE	RECESS DEPTH	REMARKS
			NO.	WATTS	TYPE				
A	CORELITE	BRG-WS-4-L35-L22-UNV-24-11-SID-SWP01	FURNISHED WITH FIXTURE			CEILING	RECESSED	3-7/8"	
A (EM)	CORELITE	BRG-WS-4-L35-L22-UNV-24-11-SID-SWP01-EL14W	FURNISHED WITH FIXTURE			CEILING	RECESSED	3-7/8"	
A1 (EM)	CORELITE	BRG-WS-4-L35-L22-UNV-24-11-SID-SWP01-EL14W	FURNISHED WITH FIXTURE			CEILING	RECESSED	3-7/8"	
B	CORELITE	BRG-WS-2-L35-L22-UNV-24-11-SID-SWP01	FURNISHED WITH FIXTURE			CEILING	RECESSED	3-7/8"	
B (EM)	CORELITE	BRG-WS-2-L35-L22-UNV-24-11-SID-SWP01-EL14W	FURNISHED WITH FIXTURE			CEILING	RECESSED	3-7/8"	
B1 (EM)	CORELITE	BRG-WS-2-L35-L22-UNV-24-11-SID-SWP01-EL14W	FURNISHED WITH FIXTURE			CEILING	RECESSED	3-7/8"	
C	CORELITE	BRG-WS-3-L35-L22-UNV-22-11-SID-SWP01-EL14W	FURNISHED WITH FIXTURE			CEILING	RECESSED	3-7/8"	
C (EM)	CORELITE	BRG-WS-3-L35-L22-UNV-22-11-SID-SWP01-EL14W	FURNISHED WITH FIXTURE			CEILING	RECESSED	3-7/8"	
D1 (EM)	METALUX	48NLD-LDS-478L-UF-UNV-FR04D7903H-LDS-501-U	FURNISHED WITH FIXTURE			CEILING	SURFACE		
D2	FAIL-SAFE	HLB-4-LD4-1-H-35-UNV-C-EDC-1-9-BK	FURNISHED WITH FIXTURE			BOTTOM OF BEAM	SURFACE		
F	HALO COMMERCIAL	HCB20010-14612835-61WC	FURNISHED WITH FIXTURE			CEILING	RECESSED	6-1/2"	
G	SPECTRUM	S258X140-35KMD0510-1/2-112-EM-SC65X15G	FURNISHED WITH FIXTURE			CEILING	RECESSED	5-1/4"	
G (EM)	SPECTRUM	S258X140-35KMD0510-1/2-112-EM-SC65X15G	FURNISHED WITH FIXTURE			CEILING	RECESSED	5-1/4"	
H	SPECTRUM	S258X120-35KMD0510-1/2-112-EM-SC65X15G	FURNISHED WITH FIXTURE			CEILING	RECESSED	5-1/4"	
H (EM)	SPECTRUM	S258X120-35KMD0510-1/2-112-EM-SC65X15G	FURNISHED WITH FIXTURE			CEILING	RECESSED	5-1/4"	
H1	FAIL-SAFE	TR15-LD4-40W-40-DPL-B2-UNV-ED1C	FURNISHED WITH FIXTURE			CEILING	SURFACE		
H1 (EM)	FAIL-SAFE	TR15-LD4-40W-40-DPL-B2-UNV-ED1C	FURNISHED WITH FIXTURE			CEILING	SURFACE		
K	XAL INC	WABO-X-2-P-0P-10007-3P-DAT1	FURNISHED WITH FIXTURE			CEILING	RECESSED	2"	ARMSTRONG CEILING
K(EM)	XAL INC	WABO-X-2-P-0P-10007-3P-DAT1	FURNISHED WITH FIXTURE			CEILING	RECESSED	2"	ARMSTRONG CEILING
L2	SPI LIGHTING	SP12154-2T-15W-120-DIM-7200H-BL	FURNISHED WITH FIXTURE			CABLE HANG AT ANGLES	PENDANT		COORDINATE WITH ARCH. DWG FOR HEIGHT AND ANGLES
L2(EM)	SPI LIGHTING	SP12154-2T-15W-120-DIM-7200H-BL	FURNISHED WITH FIXTURE			CABLE HANG AT ANGLES	PENDANT		COORDINATE WITH ARCH. DWG FOR HEIGHT AND ANGLES
L4	SPI LIGHTING	SP12154-4T-15W-120-DIM-7200H-BL	FURNISHED WITH FIXTURE			CABLE HANG AT ANGLES	PENDANT		COORDINATE WITH ARCH. DWG FOR HEIGHT AND ANGLES
L8	SPI LIGHTING	SP12154-8T-15W-120-DIM-7200H-BL	FURNISHED WITH FIXTURE			CABLE HANG AT ANGLES	PENDANT		COORDINATE WITH ARCH. DWG FOR HEIGHT AND ANGLES
L8	SPI LIGHTING	SP12154-8T-15W-120-DIM-7200H-BL	FURNISHED WITH FIXTURE			CABLE HANG AT ANGLES	PENDANT		COORDINATE WITH ARCH. DWG FOR HEIGHT AND ANGLES
M	LUMENWERK	WAP4-HD-FI-LED-80-1000-30-9P-8V05/07-0V-X-UNV-01-1-018-DIR-X	FURNISHED WITH FIXTURE			CEILING	RECESSED	3-3/4"	
N9	ACCLAM LIGHTING	FLEXI/ALD DRIVER-FLEXI CABLES 9"	FURNISHED WITH FIXTURE			UNDER DESK	TAPE STYLE		
N23	ACCLAM LIGHTING	FLEXI/ALD DRIVER-FLEXI CABLES 23"	FURNISHED WITH FIXTURE			UNDER DESK	TAPE STYLE		
N36	ACCLAM LIGHTING	FLEXI/ALD DRIVER-FLEXI CABLES 36"	FURNISHED WITH FIXTURE			UNDER DESK	TAPE STYLE		
P2	MCGRAW EDISON	GLEON-AF-04-LED-E1(208)-SL4 (1 HEAD)	FURNISHED WITH FIXTURE			+30"	POLE		POLE FESS-2505-4-DU818S COLOR BY ARCHITECT SEE NOTE 5
P3	MCGRAW EDISON	GLEON-AF-04-LED-E1(208)-SL3 (1 HEAD)	FURNISHED WITH FIXTURE			+30"	POLE		POLE FESS-2505-4-DU818S COLOR BY ARCHITECT SEE NOTE 5
P4	MCGRAW EDISON	GLEON-AF-04-LED-E1(208)-SL4 (1 HEAD)	FURNISHED WITH FIXTURE			+30"	POLE		POLE FESS-2505-4-DU818S COLOR BY ARCHITECT SEE NOTE 5
P5	MCGRAW EDISON	GLEON-AF-04-LED-E1(208)-SHO (2 HEADS)	FURNISHED WITH FIXTURE			+30"	POLE		POLE FESS-2505-4-DU818S COLOR BY ARCHITECT SEE NOTE 5
R	LUMENWERK	WAP4-HD-FI-LED-80-1000-30-9P-8V05/07-0V-X-UNV-01-1-018-DIR-X	FURNISHED WITH FIXTURE			CEILING	RECESSED	3-3/4"	
S	HALO COMMERCIAL	HCB30010-14614835-61WC	FURNISHED WITH FIXTURE			CEILING	RECESSED	6-1/2"	
T	LIDMAN LIGHTING	LJLI-10685-27WLED-WX4-01-DF-120/277V	FURNISHED WITH FIXTURE			+3'3"	POLE		BOLLARD
U	LIDMAN LIGHTING	1000-50011-36W-4-W40-01-120/277V	FURNISHED WITH FIXTURE			GROUND	FLOOD		FLAG POLE FLOOD
V	WAC LIGHTING	5212-30-BK	FURNISHED WITH FIXTURE			GROUND	FLOOD		TRIF FLOOD SEE NOTE 5
W	INWUE	VFS-K-840-7-LED-E1-WST-DBZ-VFS-BD-DBZ	FURNISHED WITH FIXTURE			GROUND	FLOOD		SIGN FLOOD
X	SURE-LITES	EUX7-R-UNV	FURNISHED WITH FIXTURE			ABOVE DOOR	BRACKET		

- NOTES:**
- FEED ALL "EM" FIXTURES WITH SWITCHED AND UNSWITCHED HOT LEGS. UNSWITCHED HOT LEG IS USED FOR VOLTAGE SENSING.
  - VERIFY ALL FIXTURE COLORS WITH ARCHITECT PRIOR TO SUBMITTALS.
  - FIXTURE TYPES A(CM), B(EM), AND D(EM) ARE EMERGENCY LIGHTS WITH LONG RUN BATTERY PACKS. THESE LIGHTS ARE SPECIFIED WITH SURE-LITES LED BATTERY PACKS THAT ARE 7 WATTS AND RATED TO RUN FOR 3 HOURS. THERE ARE NO EXCEPTIONS TO THE BATTERY RUN TIMES.
  - ANY FIXTURE EQUALS WILL HAVE TO BE SUBMITTED 3 DAYS PRIOR TO BID DATE FOR REVIEW AND APPROVAL. THERE ARE NO EXCEPTIONS TO THE LIGHT FIXTURES CALLED FOR WITHOUT PRIOR APPROVAL.
  - ON ALL P2, P3, P4, P5, AND V FIXTURES, CONTRACTOR SHALL PROVIDE AND INSTALL A NEMA 7 PIN CONNECTOR FOR THE OWNERS USE. CONTRACTOR SHALL LEAVE NEMA 7 PIN CONNECTOR IN A WEATHERPROOF ENCLOSURE FOR ACCESS. COORDINATE CLOSELY WITH THE OWNER FOR CONNECTION OF CIRCUITS TO THESE NEMA 7 PIN CONNECTORS.


**GENERAL NOTES**

- SERVICE TO PROJECT IS 120/208 VOLTS, 3 PHASE, 4 WIRE.
- VERIFY ALL DOOR SWINGS WITH ARCHITECTURAL DRAWINGS BEFORE ROUGHING IN SWITCHES.
- VERIFY EXACT LOCATION OF ALL MOTORS AND EQUIPMENT BEFORE ROUGHING IN.
- CONTRACTOR TO VERIFY LOCATION OF ALL OUTLETS PRIOR TO INSTALLATION.
- THE ELECTRICAL CONTRACTOR SHALL VERIFY THE EXACT LOCATION OF CONDUIT AND BACKSPASHES ON ARCHITECTURAL DETAILS AND/OR CASEWORK SHOP DRAWINGS. BEST SPECIFIED MOUNTING HEIGHT FOR WALL OUTLETS AS REQUIRED TO AVOID CONFLICTS.
- CONTRACTOR WILL CHECK ALL LIGHTING FIXTURES FOR EXACT TYPE, MOUNTING AND SPACE REQUIRED BEFORE ROUGHING IN.
- FURNISH AND INSTALL PLASTER FINISH FOR ALL RECESSED FIXTURES AS REQUIRED.
- SUPPORT OF ALL LIGHTING FIXTURES IS THE RESPONSIBILITY OF THIS CONTRACTOR. FIXTURES TO BE SUPPORTED INDEPENDENT OF CEILING FROM STRUCTURAL MEMBERS OF THE BUILDING.
- ELECTRICAL CONTRACTOR MUST CHECK THE CORRESPONDING MECHANICAL SHEETS AND BE RESPONSIBLE FOR INCLUDING PROPER SERVICE AND CONNECTIONS TO ALL MECHANICAL SYSTEMS SHOWN THEREON REGARDLESS OF ITS BEING OR NOT BEING SHOWN ON ELECTRICAL SHEETS.
- ALL CONDUIT CONCEALED UNLESS SPECIFICALLY SHOWN EXPOSED.
- COORDINATE SERVICES WITH POWER AND COMMUNICATIONS COMPANIES. REMOVE OR RELOCATE ALL POWER AND COMMUNICATIONS CIRCUITS ABOVE OR BELOW GRADE THAT WOULD OBSTRUCT THE CONSTRUCTION OF THE PROJECT OR CONFLICT IN ANY MANNER WITH THE CONSTRUCTION OF THE PROJECT OR ANY CODE PERTAINING THERETO. IF UTILITY COMPANY REQUIREMENTS ARE AT VARIANCE WITH THESE DRAWINGS AND SPECIFICATIONS, THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING THE NECESSARY PERMITS AND APPROVALS.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY THE COMPLETE SYSTEMS SHOWN EVEN THOUGH EVERY ITEM MAY NOT BE PARTICULARLY MENTIONED IN DETAIL. THE CONTRACTOR SHALL DELIVER TO OTHER TRADES ANY EQUIPMENT THAT MUST BE INSTALLED DURING CONSTRUCTION. CONTRACTOR SHALL BE RESPONSIBLE FOR FIELD MEASUREMENTS AND COORDINATION OF THE PHYSICAL SIZE OF ALL EQUIPMENT WITH THE ARCHITECTURAL REQUIREMENTS OF THE SPACES INTO WHICH THE EQUIPMENT WILL BE INSTALLED.
- THIS CONTRACTOR SHALL INSTALL EQUIPMENT GROUNDS THROUGHOUT THIS PROJECT, USING GREEN INSULATED GROUND WIRE. USE OF CONDUIT AS THE ONLY GROUND CONDUCTOR WILL NOT BE ALLOWED. (SIZE GROUND WIRES PER N.E.C.)

**FIRE ALARM SYSTEM NOTES**

- PROVIDE FIRE ALARM COMPLETION DOCUMENTS AT THE STATE FINAL INSPECTION. THIS ITEM WILL BE REQUIRED BY STATE BUILDING INSPECTOR AT THE TIME OF FINAL INSPECTION (OLD CERTIFICATION FORM).
- ADDITIONS AND ALTERATIONS TO THE FIRE ALARM SYSTEM REQUIRE TESTING, A RECORD OF COMPLETION, AND RECERTIFICATION. ALL FIRE ALARM WORK SHALL BE PERFORMED BY QUALIFIED PERSONNEL AS DEFINED IN NFPA-72 (2013) 10.4.2, 10.5.2, AND 10.18.1.
- ALL WORK SHALL BE PERFORMED BY A CERTIFIED FIRE ALARM CONTRACTOR - SEE SPECS.

**ELECTRICAL SYMBOLS**

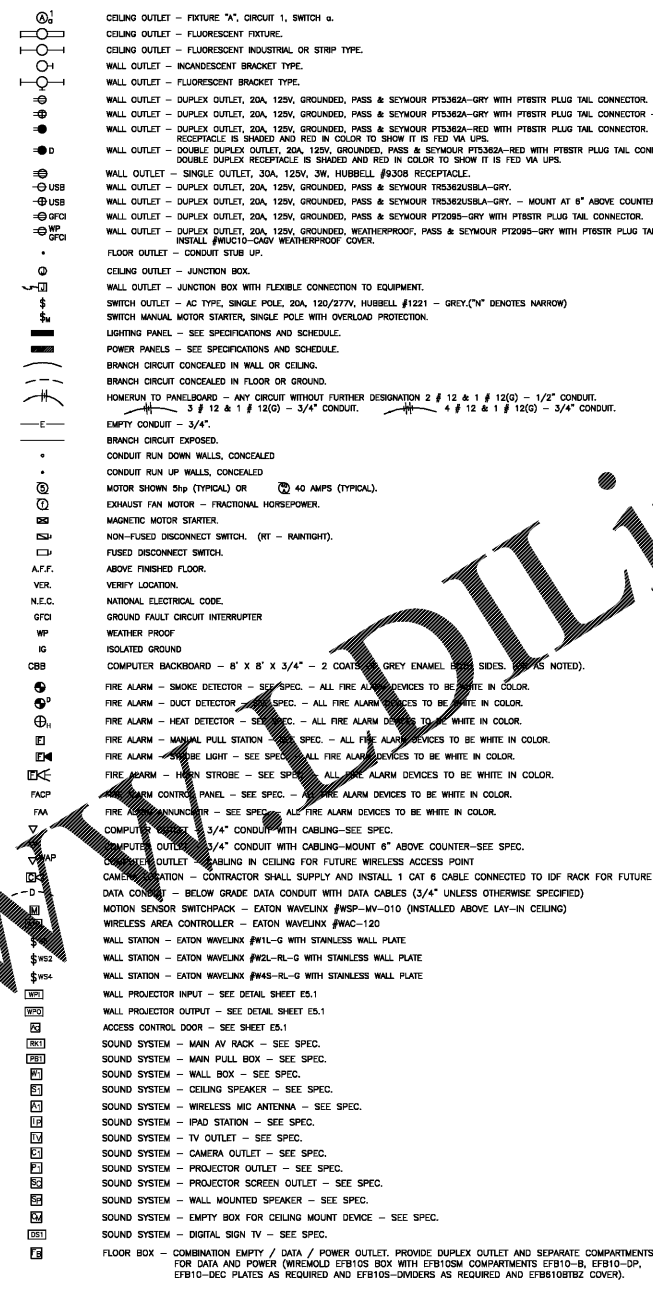

CEILING OUTLET - FIXTURE "A", CIRCUIT 1, SWITCH "a".  
 CEILING OUTLET - FLUORESCENT FIXTURE.  
 CEILING OUTLET - FLUORESCENT INDUSTRIAL OR STRIP TYPE.  
 WALL OUTLET - INCANDESCENT BRACKET TYPE.  
 WALL OUTLET - FLUORESCENT BRACKET TYPE.  
 WALL OUTLET - DUPLEX OUTLET, 20A, 125V, GROUNDED, PASS & SEYMOUR PFS362A-GRY WITH PFS18R PLUG TAIL CONNECTOR.  
 WALL OUTLET - DUPLEX OUTLET, 20A, 125V, GROUNDED, PASS & SEYMOUR PFS362A-GRY WITH PFS18R PLUG TAIL CONNECTOR - MOUNT AT 6" ABOVE COUNTER.  
 WALL OUTLET - DUPLEX OUTLET, 20A, 125V, GROUNDED, PASS & SEYMOUR PFS362A-RED WITH PFS18R PLUG TAIL CONNECTOR. RECEPTACLE IS SHARDED AND RED IN COLOR TO SHOW IT IS FED VIA UPS.  
 WALL OUTLET - DOUBLE DUPLEX OUTLET, 20A, 125V, GROUNDED, PASS & SEYMOUR PFS362A-RED WITH PFS18R PLUG TAIL CONNECTOR. DOUBLE DUPLEX RECEPTACLE IS SHARDED AND RED IN COLOR TO SHOW IT IS FED VIA UPS.  
 WALL OUTLET - SINGLE OUTLET, 30A, 125V, 3W, HUBBELL #9308 RECEPTACLE.  
 WALL OUTLET - DUPLEX OUTLET, 20A, 125V, GROUNDED, PASS & SEYMOUR PFS362A-GRY.  
 WALL OUTLET - DUPLEX OUTLET, 20A, 125V, GROUNDED, PASS & SEYMOUR PFS362A-GRY. - MOUNT AT 6" ABOVE COUNTER.  
 WALL OUTLET - DUPLEX OUTLET, 20A, 125V, GROUNDED, PASS & SEYMOUR PFS362A-GRY WITH PFS18R PLUG TAIL CONNECTOR.  
 WALL OUTLET - DUPLEX OUTLET, 20A, 125V, GROUNDED, WEATHERPROOF, PASS & SEYMOUR PFS362A-GRY WITH PFS18R PLUG TAIL CONNECTOR. INSTALL #WUC10-04V WEATHERPROOF COVER.  
 FLOOR OUTLET - CONDUIT STUB UP.  
 CEILING OUTLET - JUNCTION BOX.  
 WALL OUTLET - JUNCTION BOX WITH FLEXIBLE CONNECTION TO EQUIPMENT.  
 SWITCH OUTLET - AC TYPE, SINGLE POLE, 20A, 120/277V, HUBBELL #1221 - GREY.(Y" DENOTES NARROW)  
 SWITCH MANUAL MOTOR STARTER, SINGLE POLE WITH OVERLOAD PROTECTION.  
 LIGHTING PANEL - SEE SPECIFICATIONS AND SCHEDULE.  
 POWER PANELS - SEE SPECIFICATIONS AND SCHEDULE.  
 BRANCH CIRCUIT CONCEALED IN WALL OR CEILING.  
 BRANCH CIRCUIT CONCEALED IN FLOOR OR GROUND.  
 HOMERUN TO PANELBOARD - ANY CIRCUIT WITHOUT FURTHER DESIGNATION 2 # 12 & 1 # 12(0) - 1/2" CONDUIT.  
 3 # 12 & 1 # 12(0) - 3/4" CONDUIT. 4 # 12 & 1 # 12(0) - 3/4" CONDUIT.  
 EMPTY CONDUIT - 3/4".  
 BRANCH CIRCUIT EXPOSED.  
 CONDUIT RUN DOWN WALLS, CONCEALED.  
 CONDUIT RUN UP WALLS, CONCEALED.  
 MOTOR SHOWN SHY (TYPICAL) OR EXHAUST FAN MOTOR - FRACTIONAL HORSEPOWER.  
 MAGNETIC MOTOR STARTER.  
 NON-FUSED DISCONNECT SWITCH. (RT - RAINWIGHT).  
 FUSED DISCONNECT SWITCH.  
 ABOVE FINISHED FLOOR.  
 VERIFY LOCATION.  
 NATIONAL ELECTRICAL CODE.  
 GROUND FAULT CIRCUIT INTERRUPTER  
 WEATHER PROOF  
 ISOLATED GROUND  
 COMPUTER BACKBOARD - 8" X 8" X 3/4" - 2 COATS GREY ENAMEL BOND SIDES. (AS NOTED).  
 FIRE ALARM - SMOKE DETECTOR - SEE SPEC. - ALL FIRE ALARM DEVICES TO BE WHITE IN COLOR.  
 FIRE ALARM - DUCT DETECTOR - SEE SPEC. - ALL FIRE ALARM DEVICES TO BE WHITE IN COLOR.  
 FIRE ALARM - HEAT DETECTOR - SEE SPEC. - ALL FIRE ALARM DEVICES TO BE WHITE IN COLOR.  
 FIRE ALARM - MANUAL PULL STATION - SEE SPEC. - ALL FIRE ALARM DEVICES TO BE WHITE IN COLOR.  
 FIRE ALARM - SMOKE LIGHT - SEE SPEC. ALL FIRE ALARM DEVICES TO BE WHITE IN COLOR.  
 FIRE ALARM - HORN STROBE - SEE SPEC. ALL FIRE ALARM DEVICES TO BE WHITE IN COLOR.  
 FIRE ALARM CONTROL PANEL - SEE SPEC. - ALL FIRE ALARM DEVICES TO BE WHITE IN COLOR.  
 FIRE ALARM BELL RINGER - SEE SPEC. ALL FIRE ALARM DEVICES TO BE WHITE IN COLOR.  
 COMPUTER BACKBOARD - 3/4" CONDUIT WITH CABLEING-SEE SPEC.  
 COMPUTER OUTLET - 3/4" CONDUIT WITH CABLEING-SEE SPEC. ABOVE COUNTER-SEE SPEC.  
 CAMERA OUTLET - CABLEING IN CEILING FOR FUTURE WIRELESS ACCESS POINT  
 CAMERA MOUNTATION - CONTRACTOR SHALL SUPPLY AND INSTALL 1 CAT 6 CABLE CONNECTED TO IDF RACK FOR FUTURE CAMERA (IN 3/4" CONDUIT WHEN NOT ABOVE CEILING).  
 DATA CONDUIT - BELOW GRADE DATA CONDUIT WITH DATA CABLES (3/4" UNLESS OTHERWISE SPECIFIED)  
 MOTION SENSOR SWITCHPACK - EATON WAVELINK #FSP-140-010 (INSTALLED ABOVE LAY-IN CEILING)  
 WIRELESS AREA CONTROLLER - EATON WAVELINK #WAC-120  
 WALL STATION - EATON WAVELINK #WLL-0 WITH STAINLESS WALL PLATE  
 WALL STATION - EATON WAVELINK #WLL-RL-0 WITH STAINLESS WALL PLATE  
 WALL STATION - EATON WAVELINK #W45-RL-0 WITH STAINLESS WALL PLATE  
 WALL PROJECTOR INPUT - SEE DETAIL SHEET ES.1  
 WALL PROJECTOR OUTPUT - SEE DETAIL SHEET ES.1  
 ACCESS CONTROL DOOR - SEE SHEET ES.1  
 SOUND SYSTEM - MAIN AV RACK - SEE SPEC.  
 SOUND SYSTEM - MAIN PULL BOX - SEE SPEC.  
 SOUND SYSTEM - WALL BOX - SEE SPEC.  
 SOUND SYSTEM - CEILING SPEAKER - SEE SPEC.  
 SOUND SYSTEM - WIRELESS MIC ANTENNA - SEE SPEC.  
 SOUND SYSTEM - IPAD STATION - SEE SPEC.  
 SOUND SYSTEM - TV OUTLET - SEE SPEC.  
 SOUND SYSTEM - CAMERA OUTLET - SEE SPEC.  
 SOUND SYSTEM - PROJECTOR OUTLET - SEE SPEC.  
 SOUND SYSTEM - PROJECTOR SCREEN OUTLET - SEE SPEC.  
 SOUND SYSTEM - WALL MOUNTED SPEAKER - SEE SPEC.  
 SOUND SYSTEM - EMPTY BOX FOR CEILING MOUNT DEVICE - SEE SPEC.  
 SOUND SYSTEM - DIGITAL SIGN TV - SEE SPEC.  
 FLOOR BOX - COMBINATION EMPTY / DATA / POWER OUTLET. PROVIDE DUPLEX OUTLET AND SEPARATE COMPARTMENTS FOR DATA AND POWER (WIRINGMOLD EFB10S BOX WITH EFB10SM COMPARTMENTS EFB10-B, EFB10-OP, EFB10-DEC PLATES AS REQUIRED) AND EFB10S-DIMERS AS REQUIRED AND EFB10STBZ COVER).

**COLOR CODE FOR JUNCTION BOXES**

NOTE: PAINT ALL JUNCTION BOXES AND COVERS WITH COLORS AS SHOWN BELOW. PAINTING COVERS ONLY IS NOT ACCEPTABLE.

FUNCTION:	COLOR:
LIGHTING	BLUE
POWER	GREEN
FIRE ALARM	RED
MISC. AUXILIARIES (SOUND, ETC.)	BROWN

**COLOR CODE FOR ELECTRICAL WIRING**

- 120/208 V, 60Hz, 3 PHASE, 4 WIRE SYSTEM  
 A-BLACK  
 B-RED  
 C-BLUE  
 N-WHITE
- GROUND-GREEN

**ATTIC STOCK NOTES:**

- CONTRACTOR SHALL SUPPLY OWNER WITH ATTIC STOCK FOR WIRELESS LIGHTING CONTROL DEVICES WITH QUANTITIES LISTED BELOW:
  - 2 - MOTION SENSOR SWITCHPACKS
  - 2 - EMERGENCY POWER CONTROLLERS
  - 1 - WAC
  - 5 - WS SWITCHES
  - 5 - WS2 SWITCHES
  - 1 - WS4 SWITCHES
- CONTRACTOR SHALL SUPPLY OWNER WITH ATTIC STOCK FOR ALL LIGHT FIXTURES. CONTRACTOR SHALL ORDER 2 EXTRA LIGHT FIXTURES OF ALL TYPES AND TURN OVER TO OWNER FOR ATTIC STOCK. THESE EXTRA FIXTURES SHALL BE INCLUDED IN BID PACKAGE.

LATHAN ASSOCIATES ARCHITECTS, P.C.  
 300 SHIFF PARK SOUTH, SUITE 200  
 HOUSTON, ALABAMA 35244  
 PH: 205-988-9112 | FX: 205-988-9189

NEW LIBRARY FOR THE CITY OF OPELIKA  
 GLENN STREET  
 OPELIKA, ALABAMA 36801



SHEET TITLE:  
 SCHEDULES, SYMBOLS, AND NOTES

PROJ. MGR.: LANCE JUNKIN  
 DRAWN: SEC  
 DATE: JUNE 1, 2020  
 REVISIONS:

JOB NO. **19-32**  
 SHEET NO:  
**E1.1**  
 1 OF 7  
 SEQUENCE NO: 84/90

**STEWART ENGINEERING ELECTRICAL CONSULTANTS**  
 P.O. Box 2233 (36202)  
 300 East 7th Street (36207)  
 Anniston, Alabama  
 Phone: 256/237-0891  
 Fax No.: 256/237-1077  
 Email: services@stewartengineering.org

Engineer: J. Lance Junkin, P.E. Alabama Reg. 14617  
 Project Number: 19122

