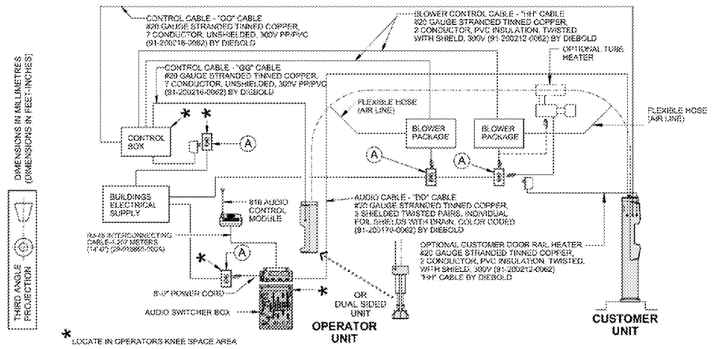

SCHEMATIC FOR CONTROL/AUDIO CABLES OVER TO OVER

DETAIL NOTES:

A. ELECTRICAL CONTRACTOR TO PROVIDE (1) DUPLEX OUTLET AT EACH "A" ON (1) 120 VAC, 60 HZ, SINGLE-PHASE (3W), 20 AMP DEDICATED BRANCH CIRCUIT.

B. SEE MANUFACTURER'S CUT SHEET FILE NUMBER 178-2045 FOR HARD WIRED INSTALLATION REQUIREMENTS. SEE MANUFACTURER'S CUT SHEET FILE NUMBER 178-1953 FOR POWER CONSOLIDATION AND DISTRIBUTION GUIDELINES.

DETAIL FOR VACUUM AIR TUBE CONTROL

SCALE: NONE

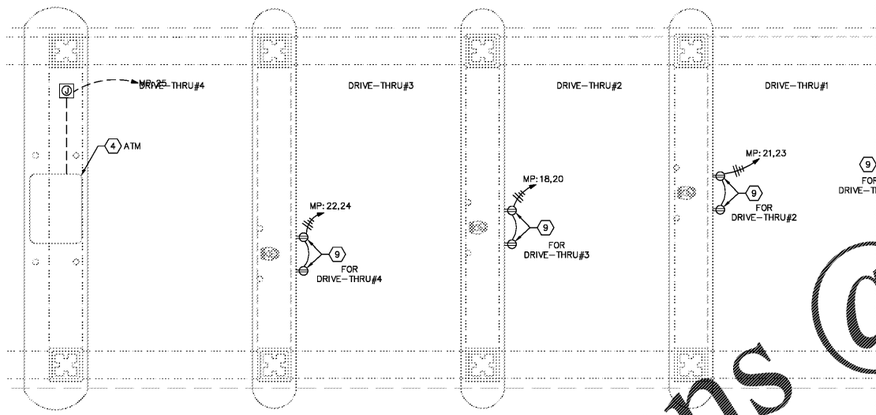

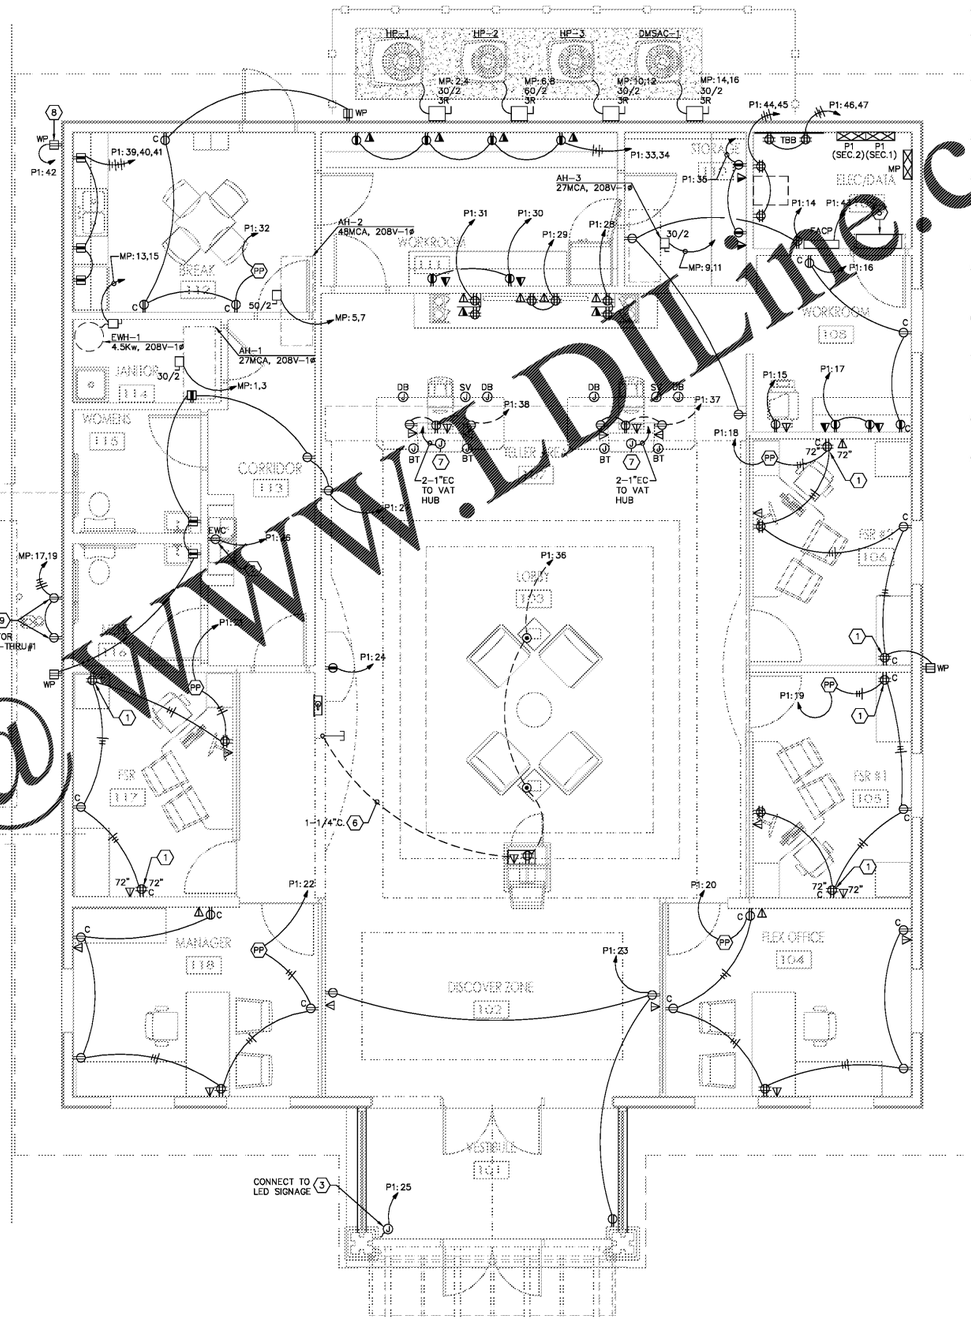

FLOOR PLAN - POWER AND TELECOM

SCALE: 1/4" = 1'-0"

PLAN NOTES THIS SHEET:

1. ONE DUPLEX RECEPTACLE TO BE CONTROLLED BY ROOM OCCUPANCY SENSOR. THE OTHER DUPLEX REPECTACLE TO HAVE CONTINUOUS POWER.
2. RECEPTACLE FOR ELECTRIC WATER COOLER. CONCEAL RECEPTACLE BEHIND ELECTRIC WATER COOLER. ELECTRICAL CONTRACTOR TO OBTAIN MOUNTING TEMPLATE FROM PLUMBING TO DETERMINE LOCATION PRIOR TO ROUGH-IN.
3. ELECTRICAL SIGN CONTRACTOR TO VERIFY EXACT LOCATION AND MOUNTING HEIGHT WITH ARCHITECT PRIOR TO ROUGH-IN.
4. CIRCUIT NUMBER IN (••) TO BE ROUTED THROUGH POWER PACK LOCATED ABOVE ACCESSIBLE CEILING. CONTROLLED RECEPTACLES IN PRE-WIRED FURNITURE TO BE PROPERLY IDENTIFIED WITH SYMBOL. POWER PACKS TO BE CONTROLLED BY ASSOCIATED OCCUPANCY SENSORS IN THIS AREA. CONNECT EACH AS REQUIRED WITH CAT 6 CABLE
5. ELECTRICAL CONTRACTOR TO RUN CONDUIT FROM DMSAC-1 INTO BUILDING TO POWER DMSAH-1. VERIFY EXACT LOCATION AND MOUNTING HEIGHT WITH ARCHITECT PRIOR TO ROUGH-IN.
6. STUB CONDUIT UP TO ABOVE ACCESSIBLE CEILING. INSTALL BUSHING AND PROVIDE PULLSTRING.
7. ELECTRICAL SHALL VERIFY ALL REQUIREMENTS AT TELLER STATIONS PRIOR TO ROUGH-IN OF ANY OUTLETS. EXTEND CONDUITS FROM EACH LOW VOLTAGE OUTLET LOCATION TO ABOVE AN ACCESSIBLE CEILING.
8. RECEPTACLE FOR IRRIGATION CONTROL PANEL. VERIFY LOCATION AND REQUIREMENTS PRIOR TO ROUGH-IN.
9. PROVIDE RECEPTACLES FOR DRIVE-UP VAT BLOWER ABOVE CEILING. SEE DETAIL THIS SHEET. VERIFY ALL REQUIREMENTS PRIOR TO ROUGH-IN.

CONSULTING CONSTRUCTION ENGINEERING, LLC
1028 23rd Street South
Birmingham, Alabama 35205
Phone: (205) 352-2500 Δ Web: www.cce-eng.com

CCE No. 20HHA06 Date: Jun 23, 2020
File: EP-01.dwg Time: 7:17:36 pm

FRANK M. CARTER No. 8068 PROFESSIONAL ENGINEER ALABAMA
6/23/2020

hendon huckestein architects, PC
architecture . planning . interior design
2126 Morris Avenue Birmingham, AL 35203
Phone (205) 322-1751
Fax (205) 322-1778
email info@hpluha.com
www.hpluha.com

A New Branch Bank for
Tyndall FEDERAL CREDIT UNION
Dothan, Alabama

RELEASES / DESCRIPTION / DATES

NOT FOR CONSTRUCTION ☐
RELEASED FOR CONSTRUCTION ■

DATE 06.23.2020
DRAWN ---
CHECKED ---
APPROVED H+HA

PROJECT NUMBER 20012.01

SHEET TITLE
FLOOR PLAN - POWER AND TELECOM

DRAWING NO. E3.01

Order Plans @ WWW.DILine.com

COPYRIGHT © NOTICE - 2020 hendon + huckestein architects, PC