



NOT FOR CONSTRUCTION

COPYRIGHT
THESE PLANS ARE AN INSTRUMENT OF SERVICE AND ARE THE PROPERTY OF GALLOWAY, AND MAY NOT BE REPRODUCED, COPIED, OR REPRODUCED WITHOUT THE WRITTEN CONSENT OF GALLOWAY. COPYRIGHTS AND INFRINGEMENTS WILL BE ENFORCED AND PROSECUTED.


Public Storage

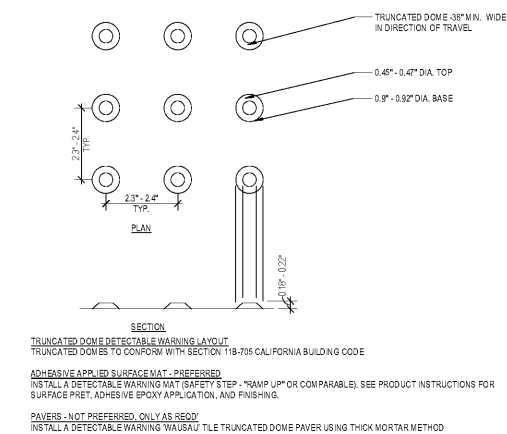


13 TRUNCATED DOME DETAILS
SCALE: NTS

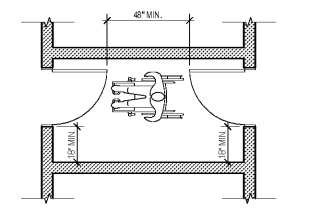


9 ACCESSIBLE VEST, TWO DOORS - OPP.
SCALE: NTS

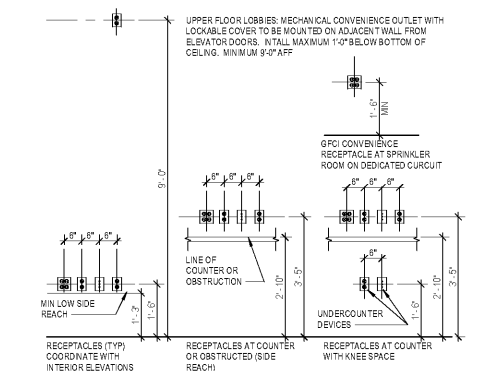


8 DEVICE MOUNTING HEIGHTS
SCALE: 1/2" = 1'-0"

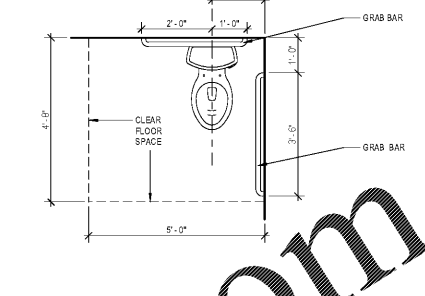


4 TYP. ACCESSIBLE WATER CLOSET PLAN
SCALE: 1/2" = 1'-0"

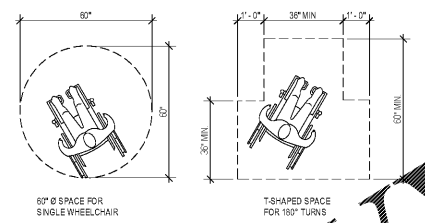


10 WHEELCHAIR TURNING REQUIREMENTS
SCALE: NTS

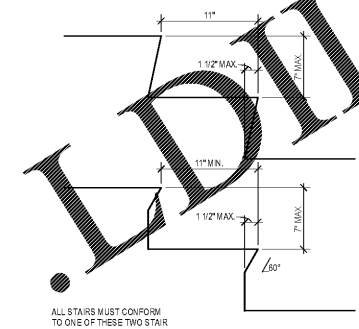


7 ACCEPTABLE DISABLED STAIR CHOICES
SCALE: NTS

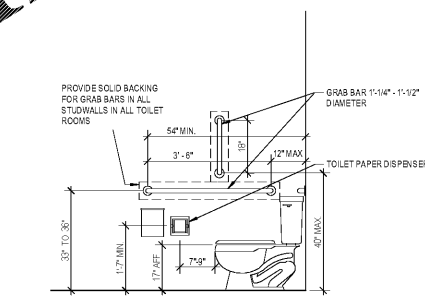

3 ACCESSIBLE W.C. STANDARDS-SIDE
SCALE: NTS




RECESSED FOUNTAINS




- SIGNAGE NOTES PER ANSI 703:**
- PER ANSI 703.4.5 MOUNTING HEIGHT BRILLE SHALL BE 48 INCHES MINIMUM AND 60 INCHES MAXIMUM ABOVE THE FLOOR, MEASURED TO THE BASELINE OF RAISED CHARACTERS.
 - SIGNAGE SHALL BE 1/4" THICK.
 - CHARACTERS, SYMBOLS AND THEIR BACKGROUND SHALL HAVE A NON-GLARE FINISH.
 - VISUAL AND RAISED CHARACTERS ON SIGNS SHALL BE SELECTED FROM FONT WHERE THE WIDTH OF THE UPPERCASE LETTER "O" IS 80% MINIMUM AND 100% MAXIMUM OF THE HEIGHT OF THE UPPERCASE LETTER "I". STROKE THICKNESS OF THE UPPERCASE LETTER "I" SHALL BE 10% MINIMUM AND 20% MAXIMUM OF THE HEIGHT OF THE CHARACTER.
 - RAISED CHARACTERS ON SIGNS SHALL BE RAISED 1/32" MINIMUM AND 1/8" MAXIMUM. RAISED UPPERCASE CHARACTERS ACCENTUATED BY CONTRAST (GRADE 2) SHALL BE 5/16" MINIMUM AND 3/8" MAXIMUM OF THE HEIGHT OF THE CHARACTER.
 - RAISED CHARACTERS SHALL BE 5/16" MINIMUM AND 3/8" MAXIMUM OF THE HEIGHT OF THE CHARACTER.
 - BRILLE SHALL BE PLACED IN MINIMUM 1/4" AND MAXIMUM 1/2" OF CLEAR SPACE TO THE TACTILE CHARACTERS FOR LEFT OR RIGHT ORIENTATION.


15 ACCESSIBLE SIGNAGE
SCALE: NTS

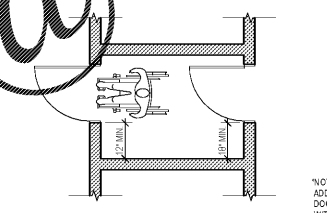

12 ACCESSIBLE VESTIBULES TWO DOORS
SCALE: NTS

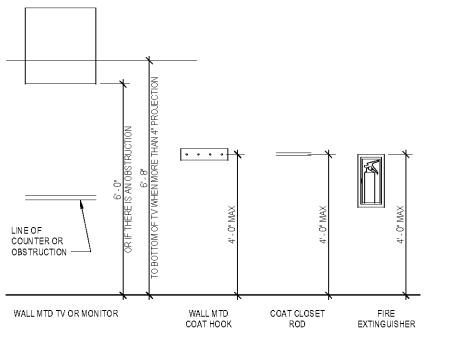


6 MISC MOUNTING HEIGHTS
SCALE: NTS

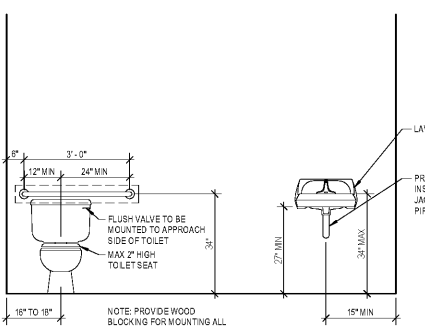


2 ACCESSIBLE FIXTURE STANDARDS-FRONT
SCALE: NTS


- WITHIN ALCOVES MINIMUM 18" DEEP AND 32" MIN. CLR. WHEN A SINGLE FOUNTAIN IS PERMITTED**
- CONTRACTOR SHALL COORDINATE WITH SIZE OF WATER FOUNTAIN TO BE USED AND SIZE ALCOVE ACCORDINGLY COMPLYING WITH REQUIREMENTS AND RECOMMENDATIONS AND COORDINATING WITH THE ARCHITECT.
- SEE TYPICAL ACCESSIBILITY NOTES SHEET SECTIONS "R" & "L" PROJECTED FOUNTAINS**
- WARNING FOR THE VISION IMPAIRED AT A PROJECTED DRINKING FOUNTAIN CAN BE PROVIDED BY EITHER OF THE FOLLOWING MEANS:
 - THE SURFACE OF THE FLOOR OR GROUND AT THE DRINKING FOUNTAIN CAN BE OF CONTRASTING COLOR WITH A TEXTURE THAT CONTRASTS IN RESILIENCY WITH THE ADJACENT FINISHED FLOOR MATERIAL, SO THAT IT CAN BE SENSIBLY DETECTED BY A CANE WITH THE TEXTURE EXTENDING FROM THE WALL TO ONE FOOT BEYOND THE FRONT EDGE OF THE DRINKING FOUNTAIN AND ONE FOOT BEYOND EACH SIDE OF THE FOUNTAIN, OR
 - INSTALL WING WALLS ON EACH SIDE OF THE DRINKING FOUNTAIN TO PROJECT OUT FROM THE MAIN WALL AT LEAST AS FAR AS THE DRINKING FOUNTAIN AND TO WITHIN 6" OF THE PATH OF TRAVEL FLOOR FINISH. THERE MUST BE 32" CLEAR BETWEEN THE WING WALLS, OR
 - GUARDRAILS SHALL BE A MINIMUM OF 32" CLEAR BETWEEN AND PROJECT FROM THE SUPPORT WALL TO THE PROJECTING FACE OF THE FOUNTAIN AND WITHIN 6" OF THE FRONT SURFACE OF THE PATH OF TRAVEL.
 - FOUNTAIN & GUARDRAILS, ETC. SHALL NOT REDUCE THE REQUIRED ACCESSIBLE ROUTE PATH WIDTH.
- NOTE:**
ILLUSTRATIONS SHOWN HERE ARE FOR DIMENSIONAL ACCESSIBILITY PURPOSES ONLY. A SECOND DRINKING FOUNTAIN SHOULD BE PROVIDED AT A MOUNTING HEIGHTS SUITABLE TO PERSONS WITH LIMITED PHYSICAL BENDING ABILITY ADJACENT TO THE ACCESSIBLE FOUNTAIN. MAINTAINING MINIMUM CLEARANCES NOTED AND AS REQUIRED. PROVIDE TEXTURED AREA OF CONTRASTING COLOR TO THE WATER FOUNTAIN LOCATION AS NOTED. WHEN FOUNTAIN IS AT AN INTERSECTION OF TWO DIFFERENT AREAS WITH DIFFERENT REBILIENCEY THAN THAT OF THE ADJACENT FLOOR FINISH, THE TYPICAL ACCESSIBILITY NOTES SHEET FOR ADDITIONAL REQUIREMENTS.

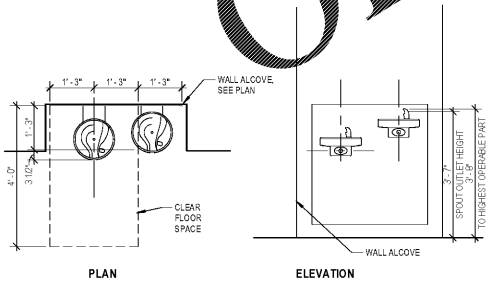


20 DRINKING FOUNTAIN
SCALE: NTS

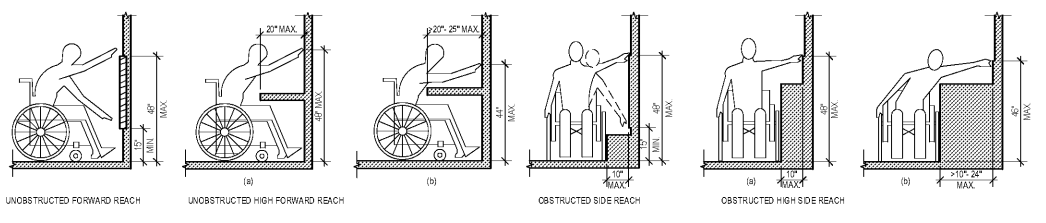

16 GENERAL ACCESSIBILITY REACH RANGES
SCALE: NTS

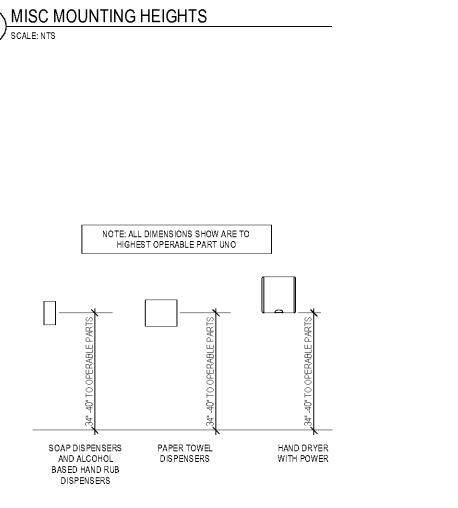

5 DISPENSERS MOUNTING HEIGHTS
SCALE: NTS

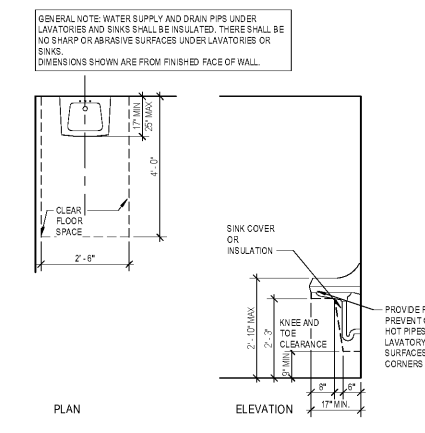

1 ACCESSIBLE LAVATORY
SCALE: NTS

PUBLIC STORAGE
SEMINOLE COUNTY, FL
PS#28091
2431 S. Orange Blossom Trail
Apopka, FL

#	Date	Issue/Description
1	03/02/2020	PERMIT SUBMITTAL
1	04/24/2020	2ND PERMIT SUBMITTAL

Project No: PS000991
Drawn By: AT
Checked By: KKS

BARRIER FREE DETAILS

G1.01

Order Plans

WWW.LDILine.com