


FIRST FLOOR ELECTRICAL KEYNOTES:

1. SITE UTILITY TRANSFORMER. COORDINATE ROUTING OF PRIMARY AND SECONDARY CONDUCTORS WITH UTILITY PROVIDER. SEE CIVIL PLANS FOR ADDITIONAL INFORMATION.
2. UTILITY METER AND SERVICE DISCONNECT. COORDINATE LOCATION WITH UTILITY PRIOR TO ROUGH-IN. SEE EA.01 FOR SERVICE GROUNDS INFORMATION.
3. MOTORIZED GATE CONNECTION WITH BOLLARD MOUNTED ACCESS KEYPAD. COORDINATE CONNECTION REQUIREMENTS WITH GATE PROVIDER. PROVIDE (1) EMPTY 1"Ø BACK TO ELECTRICAL ROOM FOR SECURITY CONNECTIONS.
4. KEYPAD BOLLARD. PROVIDE CONDUIT AS SHOWN. REFER TO CIVIL PLANS FOR EXACT LOCATIONS.
5. CONTRACTOR TO PROVIDE (1)1"Ø AND (1)1/2"Ø TO EXISTING OFFICE LOCATION FOR EXTENSION OF SECURITY AND TELECOM SYSTEMS.
6. WATER ENTRANCE BACKFLOW PREVENTOR LOCATION. PROVIDE 1"Ø TO THIS LOCATION FOR CONNECTION OF FLOW AND TAMPER DEVICES AS REQUIRED.

COPYRIGHT
 THESE PLANS ARE AN INSTRUMENT OF SERVICE AND ARE THE PROPERTY OF GALLOWAY, AND MAY NOT BE DUPLICATED, DISCLOSED OR REPRODUCED WITHOUT THE WRITTEN CONSENT OF GALLOWAY. COPYRIGHTS AND INFRINGEMENTS WILL BE ENFORCED AND PROSECUTED.



1 ELECTRICAL SITE PLAN
 SCALE: 1" = 32'0"

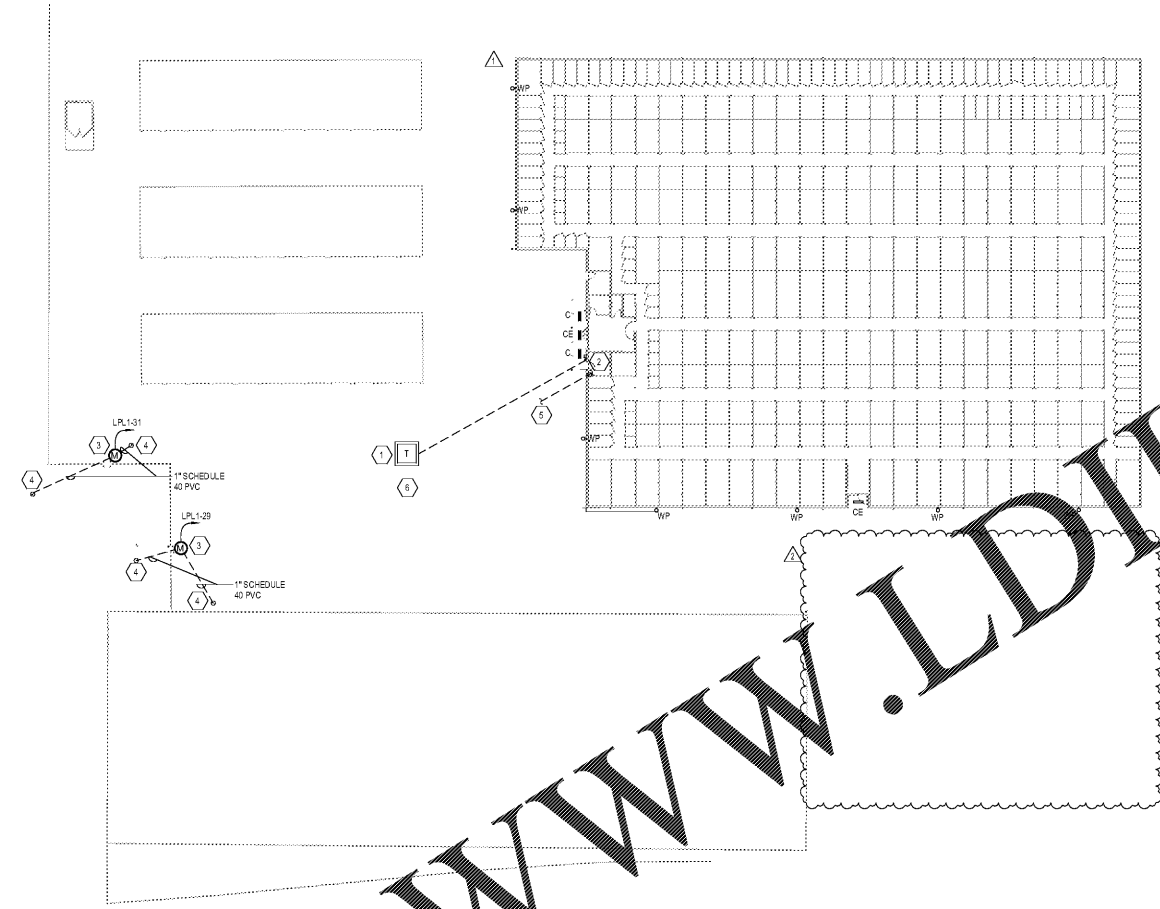

Order Plans @ www.LDILine.com

PUBLIC STORAGE
 SEMINOLE COUNTY, FL

PS#28091
 2431 Orange Blossom Trail
 Apopka, FL

#	Date	Issue/Description
1	03/02/2020	PERMIT SUBMITTAL
1	04/24/2020	SECOND SUBMITTAL
2	06/11/2020	THIRD SUBMITTAL

Project No: P800091
 Drawn By: Author
 Checked By: Checker

ELECTRICAL SITE PLAN

E0.02