


DRAWING NOTES

- 1 REMOVE AND REPLACE EXISTING GAS-FIRED ROOFTOP UNIT. CONTRACTOR SHALL REMOVE ASSOCIATED PERIMETER CURB AND ALL ASSOCIATED PIPING, VALVES AND CONTROLS AS REQUIRED AND RECONFIGURE ROOF PENETRATIONS FOR INSTALLATION OF GAS-FIRED ROOFTOP UNIT. REFER TO HVAC PLAN, SHEET 71.03, FOR ADDITIONAL INFORMATION.
- 2 REMOVE EXISTING GAS-FIRED ROOFTOP UNIT AND ALL ACCESSORIES. CAP ROOF CURB WITH WEATHERPROOF INSULATED PANEL.
- 3 REMOVE EXISTING ELECTRIC PACKAGED ROOFTOP UNIT AND ALL ACCESSORIES. CAP ROOF CURB WITH WEATHERPROOF INSULATED PANEL.
- 4 REMOVE MAKE-UP AIR HANDLING UNIT. CAP ROOF CURB WITH WEATHERPROOF INSULATED PANEL.
- 5 REMOVE ROOF MOUNTED EXHAUST FAN SERVING GREASE HOOD BELOW. CAP ROOF CURB WITH WEATHERPROOF INSULATED PANEL.
- 6 REMOVE SHEET METAL PLENUM. CAP ROOF CURB WITH WEATHERPROOF INSULATED PANEL.
- 7 ALL ABANDONED ROOFTOP UNIT CURBS SHALL BE COVERED IN INSULATED (R-12 MIN) COVER AND FLASHED WEATHER TIGHT.
- 8 REMOVE GAS FLUE PIPING FOR GAS-FIRED WATER HEATER. CONTRACTOR SHALL PATCH AND SEAL ROOF OPENING WEATHER TIGHT TO MATCH ADJACENT SURFACES.
- 9 REMOVE COMBUSTION AIR INTAKE FOR GAS-FIRED WATER HEATER. CONTRACTOR SHALL PATCH AND SEAL ROOF OPENING WEATHER TIGHT TO MATCH ADJACENT SURFACES.
- 10 VENT PIPE THROUGH ROOF TO REMAIN. CONTRACTOR SHALL INSPECT FOR PENETRATION AND VERIFY THAT SEAL IS WEATHER TIGHT AND BE MADE READY FOR RE-USE.
- 11 APPROXIMATE LOCATION OF EXISTING PENETRATIONS (SHOWN FOR INFORMATIONAL PURPOSES ONLY).

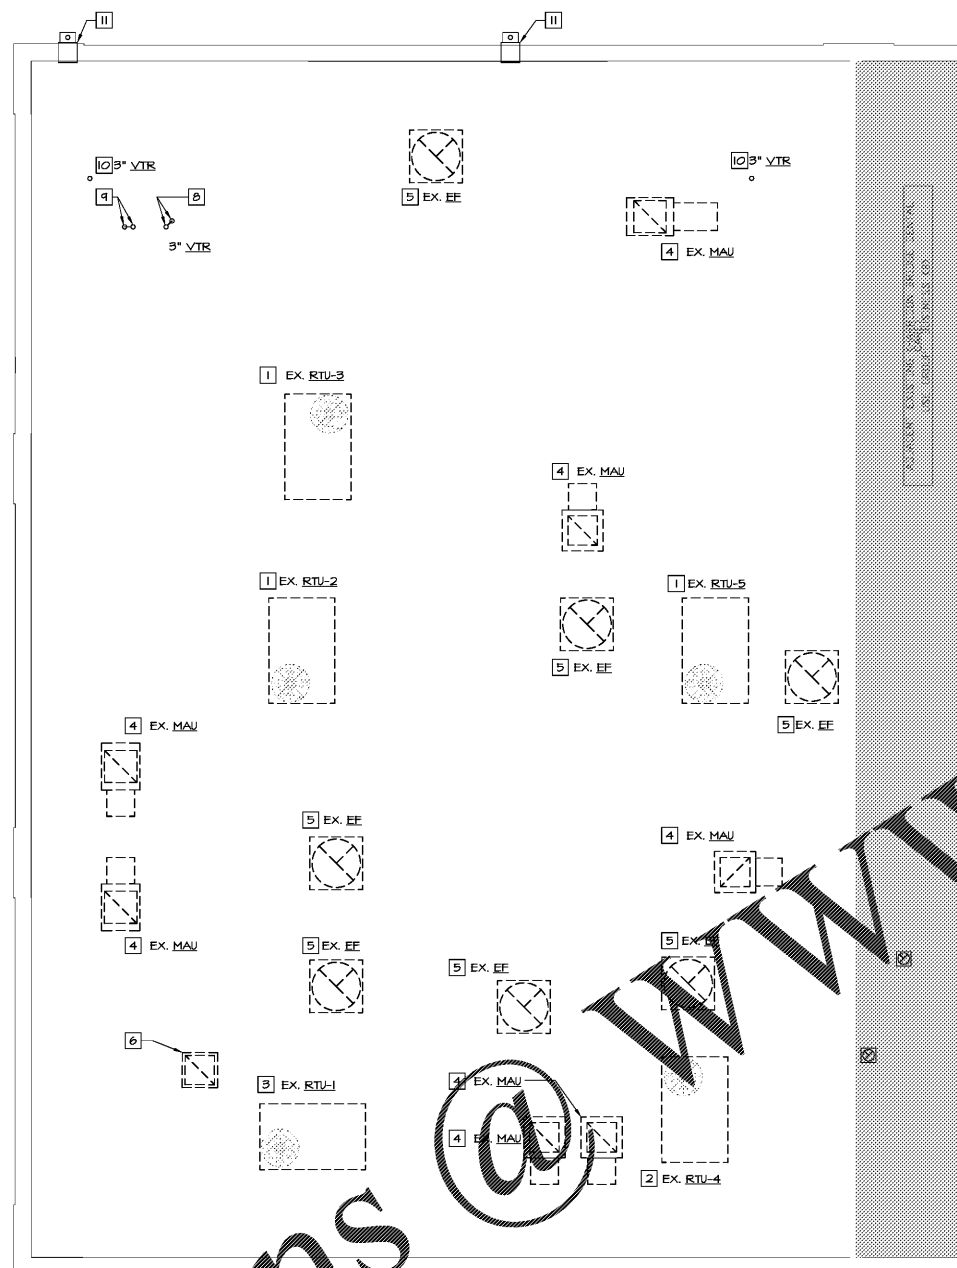

DEMOLITION HVAC ROOF PLAN
SCALE: 1/4" = 1'-0"

GENERAL NOTES:

1. ALL ROOF WORK SHALL BE PERFORMED BY BUILDING OWNER'S ROOFING CONTRACTOR - COORDINATE WITH OWNER PRIOR TO PERFORMING WORK.

DEMOLITION LEGEND:

- EXISTING WORK TO REMAIN.
- EXISTING WORK TO BE DEMOLISHED.

EXISTING RTU SCHEDULE

UNIT #	MANUFACTURER / MODEL NUMBER	NOMINAL CAPACITY
RTU-1	LENNOX KCA03654DN1Y	3.0
RTU-2	CARRIER 40TFE006	5.0
RTU-3	INTERNATIONAL COMFORT PRODUCTS P5E072AEAOAAA	6.0
RTU-4	LENNOX KSA06054DM34	5.0
RTU-5	CARRIER 40TFE006	5.0

GENERAL NOTES:

1. CONTRACTOR SHALL FIELD VERIFY LOCATIONS OF ALL EQUIPMENT, DUCTWORK, AND APPURTENANCES PRIOR TO DEMOLITION.
2. SEE SHEET 70.01 FOR SPECIFIC DIRECTIONS ON THE RE-USE OF ANY MECHANICAL EQUIPMENT.



Order Plans

www.LDILine.com