

8 INVOICING LIGHTING PLAN
1/8" = 1'-0"

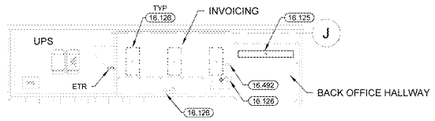

7 INVOICING LIGHTING DEMO PLAN
1/8" = 1'-0"



6 REAR OFFICE AREA LIGHTING PLAN
1/8" = 1'-0"



5 REAR OFFICE AREA LIGHTING DEMO PLAN
1/8" = 1'-0"

CONTRACTOR IS RESPONSIBLE FOR COMPLETE INSTALLATION OF THE LIGHTING SYSTEM AS INDICATED ON PLANS AND/OR AS MODIFIED TO ACCOMMODATE EXISTING OBSTRUCTIONS. IDENTIFY CONFLICTS PRIOR TO ROUGH-IN. WHERE CONFLICTS WITH EXISTING UTILITIES OCCUR, ADJUST FIXTURE LOCATION AS REQUIRED. FIXTURES SHALL BE INSTALLED AS NEAR AS POSSIBLE TO LOCATIONS INDICATED ON PLANS.

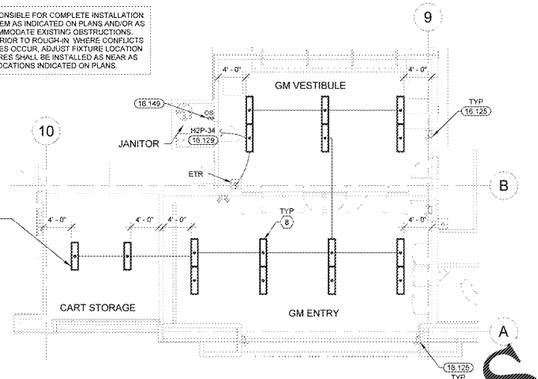

4 GM VESTIBULE LIGHTING PLAN
1/8" = 1'-0"

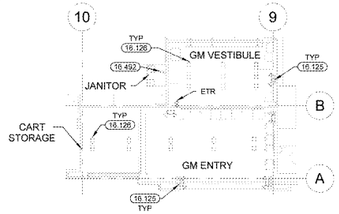

3 GM VESTIBULE DEMO LIGHTING PLAN
1/16" = 1'-0"

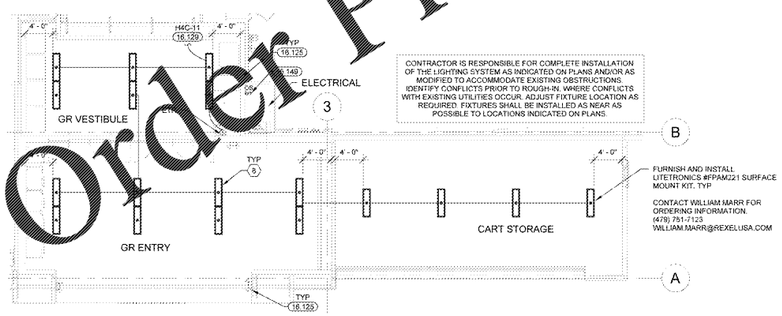

CONTRACTOR IS RESPONSIBLE FOR COMPLETE INSTALLATION OF THE LIGHTING SYSTEM AS INDICATED ON PLANS AND/OR AS MODIFIED TO ACCOMMODATE EXISTING OBSTRUCTIONS. IDENTIFY CONFLICTS PRIOR TO ROUGH-IN. WHERE CONFLICTS WITH EXISTING UTILITIES OCCUR, ADJUST FIXTURE LOCATION AS REQUIRED. FIXTURES SHALL BE INSTALLED AS NEAR AS POSSIBLE TO LOCATIONS INDICATED ON PLANS.

2 GR VESTIBULE LIGHTING PLAN
1/8" = 1'-0"

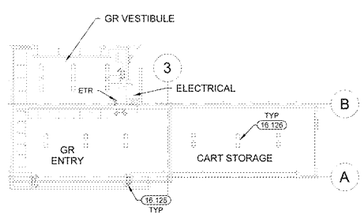

1 GR VESTIBULE DEMO LIGHTING PLAN
1/16" = 1'-0"

KEYNOTES

16.125	EXISTING LIGHT FIXTURES TO REMAIN UNLESS NOTED OTHERWISE
16.126	EXISTING LIGHT FIXTURE TO BE DEMOLISHED.
16.129	CONNECT TO EXISTING CIRCUIT PREVIOUSLY SERVING AREA LIGHTING THAT WAS REMOVED. MAINTAIN EXISTING CIRCUIT CONTROL UNLESS NOTED OTHERWISE. PROVIDE CONSTANT HOT FOR EMERGENCY EXIT AND LOCALLY CONTROLLED LIGHT FIXTURES.
16.131	CONNECT TO EXISTING CIRCUIT.
16.149	REPLACE EXISTING LIGHT SWITCH WITH OCCUPANCY SENSOR.
16.492	E.C. SHALL COORDINATE WITH GENERAL CONTRACTOR AND ARCHITECTURAL DEMOLITION PLANS THE EXTENT OF ELECTRICAL DEMOLITION. REMOVE UNUSED DEVICES, BOXES, CONDUITS, AND WIRING BACK TO ORIGINATING JUNCTION BOXES OR PANELBOARDS. REFERENCE POWER PLANS FOR CIRCUITRY TO BE REUSED. DEMOLITION SHALL NOT AFFECT ACTIVE CIRCUITS. IF CIRCUIT IS DEMOLISHED ALL THE WAY TO PANELBOARD, REMOVE CIRCUIT BREAKER AND REPLACE WITH FILLER. UPDATE TYPEWRITTEN CIRCUIT DIRECTORY IDENTIFYING CIRCUIT AS "SPACE". COORDINATE EXACT REQUIREMENTS WITH EXISTING CONDITIONS PRIOR TO BID.

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

CYNTERGY
1411 SOUTH CINCINNATI
SECOND FLOOR
TULSA, OK 74119
918.877.4000
www.cyntergy.com

STIPULATION FOR REUSE

THIS MATERIAL WAS PREPARED BY AND IS THE PROPERTY OF CYNTERGY ENGINEERING, PLLC AND CANNOT BE USED IN WHOLE OR IN PART FOR ANY PURPOSE WITHOUT THE EXPRESS WRITTEN PERMISSION OF CYNTERGY ENGINEERING, PLLC. ANY UNAUTHORIZED USE SHALL BE AT THE SOLE RISK OF THE USER. ALL RIGHTS RESERVED UNDER THE COPYRIGHT LAWS OF THE UNITED STATES.

CONSULTANTS

Walmart

FAYETTEVILLE, NC

STORE NO.: 1261-246

JOB NUMBER: USRM-067205 | PROTO | 155 PROTO SC

ISSUE BLOCK

CHECKED BY:	DES
DRAWN BY:	BDJ
PROTO CYCLE:	02/28/2020
DOCUMENT DATE:	04/15/2020

DOCUMENTS WITHOUT SIGNATURE AND REQUIRED SEAL OF AOR/EOR ARE NOT FOR CONSTRUCTION

CYNTERGY ENGINEERING, PLLC
CA # P-0894
EXPIRES 06/30/2020
MATTHEW RUTKOWSKI, P.E.
ENGINEER OF RECORD

ENLARGED LIGHTING PLANS

SHEET: E1.2

Order Plans @ www.LDILine.com