


GENERAL NOTES

- REFER TO E1 FOR GENERAL CONTRACTOR RESPONSIBILITIES, E.C. MAY USE CABLE TRAY FOR LOW VOLTAGE CABLES, SEE 2/E2.
- RUN CONDUIT FROM SENSORS TO BOTTOM OF STRUCTURE.
- REFRIGERATION UNITS TO BE CONNECTED TO EMS PANEL BY DOLLAR GENERAL REFRIGERATION CONTRACTOR.

SENSOR PLAN KEYED NOTES

- ALWAYS INSTALL THESE SENSORS AT 8'-0" A.F.F. THE EXACT MOUNTING LOCATION OF THE HVAC SENSORS "TS" MAY VARY DEPENDING ON THE STORE LAYOUT & DUCT CONFIGURATION. REFER TO SITE SPECIFIC MECHANICAL DRAWINGS FOR HVAC ZONED SENSOR MOUNTING LOCATIONS. IF SENSORS ARE MOUNTED ON EXTERIOR WALLS DUE TO DUCT CONFIGURATION, THEY ARE THEN TO BE INSULATED TO PREVENT AIR INFILTRATION. IF ADDITIONAL HVAC UNITS ARE USED, ADD ADDITIONAL TEMPERATURE SENSORS "TS".
- ADD ADDITIONAL HVAC UNIT WHEN REQUIRED.
- PHONE LINE #1 - TWO RJ-11 PORTS. ONE (1) LOCATED IN OFFICE W/RJ-45 DATA JACK COMBO AND ONE (1) AT REGISTER. 24 GA. CAT 5, 4-PAIR TWISTED WIRE ONLY. USE BLUE AND BLUE & WHITE WIRES. HOOK TO LINE #1 TERMINAL IN RJ-11 JACK EACH PHONE JACK TO HAVE DEDICATED. SEPARATE HOME RUN TO DMARC. LABEL AS "PHONE" AT THE DESTINATION AND AT DMARC. PHONE COMPANY PROVIDES FINAL HOOK UP TO DMARC ONLY. PHONE LINE #2 - RJ-11 PHONE JACK SUPPLIED AND WIRED BY CONTRACTOR.

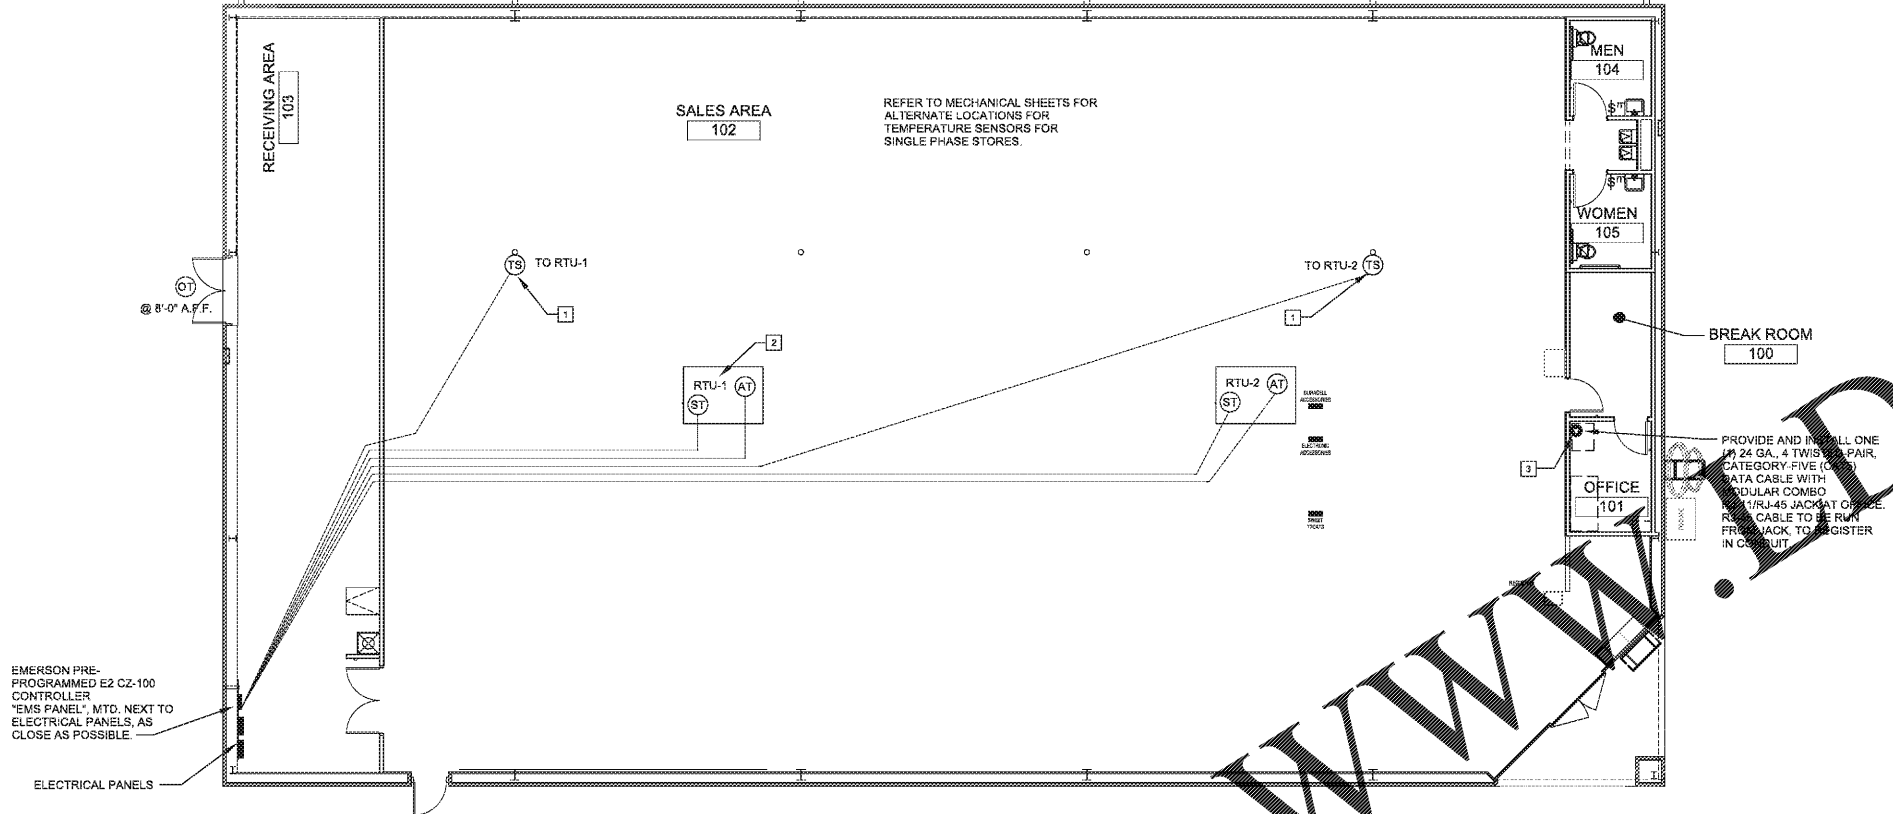

1 EMS/LOW VOLTAGE PLAN
SCALE: NTS

NOTE: PLAN IS DIAGRAMATIC ONLY!! HOLD CONDUIT TIGHT TO EXPOSED MAIN GIRTS AND RUN AS HIGH AS POSSIBLE ALONG PERIMETER WALLS TO RECEIVING AREA.

Order Plans @

DEVICE SCHEDULE					
SYMB	DESCRIPTION	CABLE TYPE	SUPPLIER	INSTALLER	NOTES
(AT)	AHU TERMINAL STRIP	8C T-STAT CABLE	EMS SUPPLIER	GENERAL CONTRACTOR	(1) PER HVAC UNIT
(OT)	OUTDOOR AIR TEMP MOUNTED 8'-0" A.F.F.	BELDEN 8761 OR EQUIVALENT (22AWG, 2C, STRANDED, SHIELDED)	EMS SUPPLIER	GENERAL CONTRACTOR	(1) PER RECEIVING ENTRY
(ST)	SUPPLY TEMP (501-1121) IN SUPPLY DUCT	BELDEN 8761 OR EQUIVALENT (22AWG, 2C, STRANDED, SHIELDED)	EMS SUPPLIER	GENERAL CONTRACTOR	(1) PER HVAC UNIT
(TS)	TEMP SPACE SENSOR (809-8590) 8'-0" A.F.F.	BELDEN 8761 OR EQUIVALENT (22AWG, 2C, STRANDED, SHIELDED)	EMS SUPPLIER	GENERAL CONTRACTOR	(1) PER HVAC UNIT ZONE
o	RJ-11/RJ-45 DATA JACK PHONE COMBO	CAT-5 DATA CABLE (24AWG, 4 TWISTED PAIR)	GENERAL CONTRACTOR	GENERAL CONTRACTOR	(1) AT OFFICE COMPUTER CART
\$m	MOTION SENSOR SWITCH	LEVITON EZ-FIND ODS-10-IDW	GENERAL CONTRACTOR	GENERAL CONTRACTOR	(1) PER RESTROOM (1) PER BREAK ROOM (1) PER OFFICE

DESIGNER ASSUMES RESPONSIBILITY FOR THE DESIGN OF THESE DOCUMENTS BASED ON THE STANDARD PROTOTYPE DRAWINGS PROVIDED TO US BY DOLLAR GENERAL THROUGH THEIR OWNERS REPRESENTATIVE. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR FIELD VERIFYING ALL EXISTING CONDITIONS PRIOR TO COMMENCING WITH ANY SITE WORK, MATERIAL PURCHASES, BUILDING FABRICATION, ETC. ANY DISCREPANCIES BETWEEN THESE DOCUMENTS AND ACTUAL FIELD CONDITIONS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT PRIOR TO ANY WORK BEING DONE. ANY REQUIRED ENGINEERING CHANGES TO MATCH THE EXISTING SITE CONDITIONS SHALL BE TREATED AS ADDITIONAL SERVICES.

Robert E. Walker, IV
Architect
2229 FIRST AVE. SOUTH
SUITE 110
BIRMINGHAM, Alabama
35233
T-205.254.3212
F-205.254.3269

ROBERT M. BEATTIE, PE
2815 SOUTH OAK CREEK - SUITE 111 - DUBLIN, GA 31028
PHONE: 770.254.1400 FAX: 770.254.1401
WWW.RMBC.COM EMAIL: RMBC@GMAIL.COM
STRUCTURAL DEPT.: 404.512.2125 - EMAIL: RMBC@RMBC.COM
ELECTRICAL DEPT.: 404.512.2125 - EMAIL: RMBC@RMBC.COM
MECHANICAL DEPT.: 404.512.2125 - EMAIL: RMBC@RMBC.COM
ROBERT M. BEATTIE, INC. PE #
ROBERT M. BEATTIE, INC. REGISTERED PROFESSIONAL ENGINEER
ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE GEORGIA PROFESSIONAL ENGINEERING ACT AND THE GEORGIA PROFESSIONAL ENGINEERING BOARD RULES AND REGULATIONS. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE GEORGIA PROFESSIONAL ENGINEERING BOARD RULES AND REGULATIONS. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE GEORGIA PROFESSIONAL ENGINEERING BOARD RULES AND REGULATIONS.



DOLLAR GENERAL BUILDING
Prototype 9100 SF E
Store # 22323

DG Villa Rica
101 Prospector Drive
Villa Rica, GA

CONSTRUCTION DOCUMENTS

PROJECT NO.: 8095.89
ISSUED: 07/21/2020

EMS / LOW VOLTAGE PLAN

E4.1