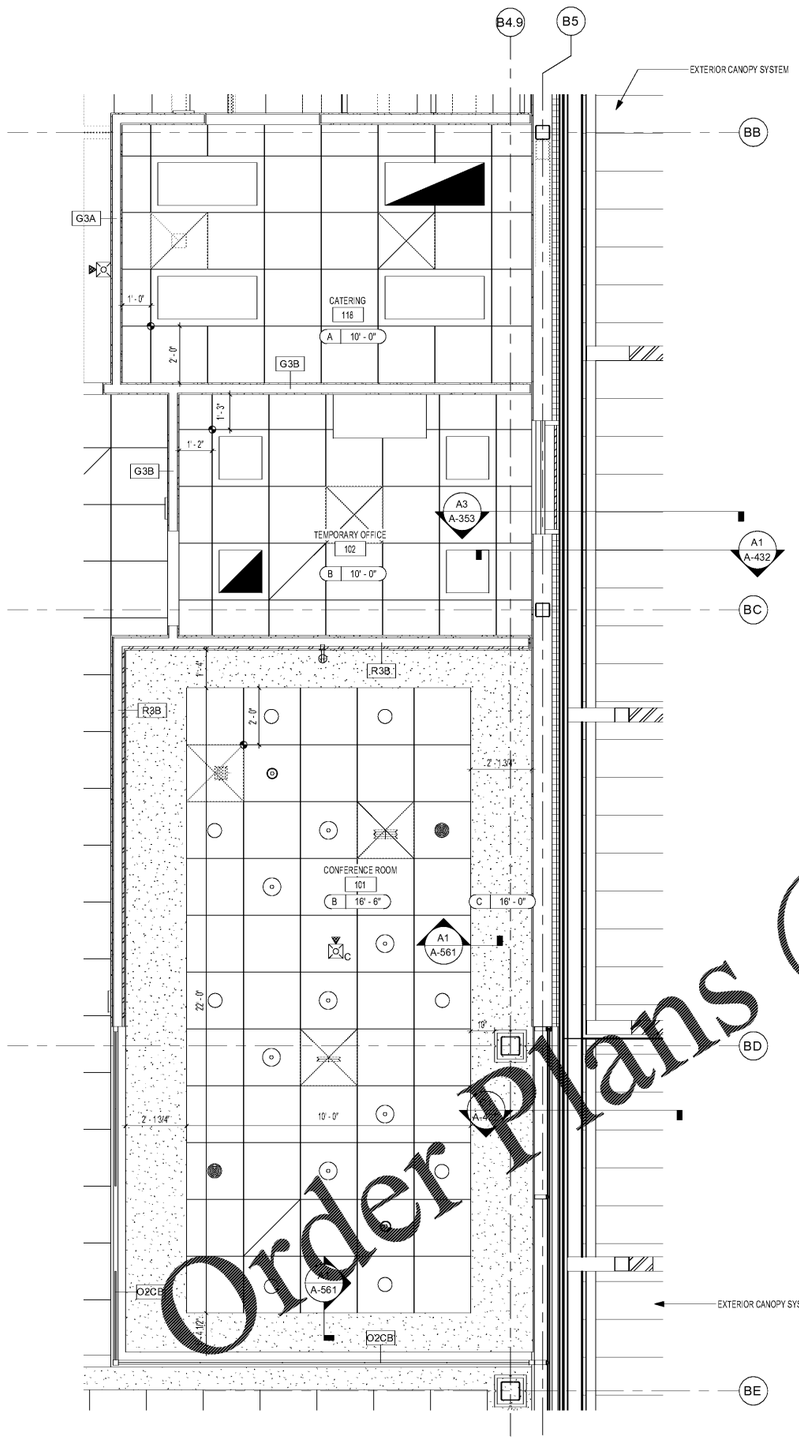

GENERAL RCP SHEET NOTES:

1. ALL MATERIAL EXPOSED WITHIN A RETURN AIR CEILING PLENUM SHALL BE NONCOMBUSTIBLE OR SHALL BE LIMITED IN COMBUSTIBILITY AND HAVE A FLAME SPREAD INDEX OF 25 MAX. AND A SMOKE- DEVELOPMENT INDEX OF 50 MAX., PER ASTM E84.
2. IN LATRINES, TOILETS, LOCKER ROOMS AND JANITOR CLOSETS ALL GYPSUM BOARD CEILINGS SHALL BE WATER RESISTANT GYPSUM BOARD.
3. ALL CEILING MOUNTED DEVICES SHALL BE CENTERED IN BOTH DIRECTIONS IN ACOUSTICAL CEILING PANELS U.N.O. CENTER SPRINKLER HEADS IN ACOUST. CEILING PANELS WHERE THEY OCCUR - COORDINATE THE LOCATION OF THE SPRINKLER HEADS WITH OTHER CEILING FIXTURES AND EQUIPMENT IN ALL CEILING. ENSURE THAT A SYMMETRICAL AND BALANCED ARRANGEMENT IS INSTALLED. CONTRACTING OFFICER IS TO REVIEW INSTANCE OF NON-EQUAL SPACING PRIOR TO INSTALLATION.
4. CEILING HEIGHTS INDICATED (I.E. 10'-0") ARE RELATIVE TO THE FINISH FLOOR ELEVATION OF THE ROOM FOR WHICH THEY ARE INDICATED.
5. CEILING GRIDS SHALL BE ORIENTED WITHIN SPACES AS SHOWN, U.N.O. FULL TILE (FT) WHERE INDICATED, SHALL ABUT DESIGNATED WALL. LIMIT PARTIAL PANELS TO NO LESS THAN 6".
6. DEVICES HAVE BEEN SHOWN FOR COORDINATION PURPOSES. ALL DEVICES MAY NOT BE SHOWN.
7. THE CONTRACTOR SHALL ENSURE THE INSTALLATION OF ALL DEVICES INDICATED ON THE ENGR. DWG. SEE MECHANICAL, ELECTRICAL, PLUMBING AND FIRE PROTECTION DRAWINGS FOR ITEMS NOT SHOWN ON REFLECTED CEILING PLANS. CONTACT THE ARCHITECT IF ANY CONFLICTS OCCUR.
8. AT WALLS WITH SOUND ATTENUATION BLANKETS PROVIDE SOUND ATTENUATION BLANKETS ON CEILING TO 2'-0" ON BOTH SIDES OF WALL EXCEPT AT WALLS WITH SOUND ATTENUATION BLANKETS EXTENDING TO STRUCTURE.
9. COORDINATE ACCESS PANELS WITH MECHANICAL BALANCING DAMPER LOCATIONS.
10. FAN SUPPLIER TO SUPPLY ALL SUPPLEMENTAL SUPPORT FOR ATTACH SYSTEM TO PRIMARY BUILDING FRAME.

CEILING SCHEDULE	
TYPE	DESCRIPTION
A	2'-0" X 2'-0" ACT SYSTEM
B	HIGH FAC 2'-0" X 2'-0" ACT SYSTEM
C	ONE LAYER GYPSUM WALL BOARD
D	1 HOUR RATED ASSEMBLY U419
E	EXPOSED TO STRUCTURE

REFLECTED CEILING PLAN LEGEND

- DOWNLIGHT- CENTER IN ACOUST. CEILING PANELS, AND METAL CEILING TYP., U.N.O.
- EMERGENCY DOWNLIGHT- CENTER IN ACOUST. CEILING PANELS, AND METAL CEILING TYP., U.N.O.
- PENDANT LIGHT FIXTURE, SEE ELEC.
- LINEAR PENDANT LIGHT FIXTURE
- LINEAR EMERGENCY PENDANT LIGHT FIXTURE
- 2' X 2' LAY-IN LIGHT FIXTURE
- 2' X 2' EMERGENCY LAY-IN LIGHT FIXTURE
- 2' X 4' LAY-IN LIGHT FIXTURE
- 2' X 4' EMERGENCY LAY-IN LIGHT FIXTURE
- LINEAR SLOT DIFFUSERS
- 24" X 24" MECH. DIFFUSERS
- 24" X 24" MECH. RETURN AIR GRILLES
- 24" X 24" MECH. EXHAUST
- WALL MOUNTED EXIT SIGN
- CEILING MOUNTED EXIT SIGN
- OCCUPANCY SENSOR, SEE ELEC.
- CEILING MOUNTED STROBE
- SMOKE DETECTOR
- SPEAKER STROBE - SEE FIRE PROTECTION
- WALL PACK LIGHT - SEE ELEC.
- HVAC CASSETTE UNIT - SEE MECH.
- LIGHT FIXTURE, SEE ELEC.

Order Plans @ www.LDLine.com

A1 REFLECTED CEILING PLAN CONEFERENCE
SCALE: 3/8" = 1'-0"

NORTH

2 0 2 4 6
SCALE: 3/8" = 1'-0"

MARK	DESCRIPTION	DATE

DESIGNED BY: E. Arest
DRAWN BY: B. Ulino / J. Im
CHECKED BY: K. Wisek-Teske
SUBMITTED BY: E. Arest
ISSUED FOR CONSTRUCTION: DD-MMM-YYYY

THESE DRAWINGS ARE INTENDED FOR USE WITHIN THE CONSTRUCTION INDUSTRY. THEY ARE NOT INTENDED FOR USE BY OTHERS AND POND & COMPANY ASSUMES NO RESPONSIBILITY FOR SUCH USE.

DOCUMENT CLASSIFICATION: BUSINESS (B) UNDERGRADE (BT)
TYPE OF CONSTRUCTION: TYPE II-B NONCOMBUSTIBLE
TESTS WERE ADJUSTED FOR ELEVATION AND ARE CORRECTED FOR THIS IMAGE AND THE OFFICE.

NORFOLK SOUTHERN CORP
1200 PEACHTREE STREET, NE
ATLANTA, GEORGIA 30309
404-529-1280

POND
3950 Parkway Lane, Suite 500
Peachtree Corners, GA 30092
Phone (770) 209-7744
Fax (770) 209-7747

CORPORATE AIRCRAFT HANGAR FOR NORFOLK SOUTHERN CORPORATION
TOLLYN COUNTY AIRPORT (ROME REGIONAL FLT)
3552 AVIATION CIRCLE, SUITE 200
ATLANTA, GEORGIA 30336

ENLARGED REFLECTED CEILING PLAN CONFERENCE

SHEET ID
A-408

Copyright © 2020 by Pond & Company. All rights reserved. No copying or duplication of these documents is allowed without the express written agreement of Pond & Company.

CONSTRUCTION DOCUMENTS

7/10/2020 3:03:13 AM BIM 360://1190557 - Pegasus/1190557_Pegasus_NS_Arch_CENTAL_v19_R3.rvt