SHEET NOTES:

1. REFER TO P-001 FOR PLUMBING GENERAL NOTES, ABBREVIATIONS, AND LEGENDS.

KEYNOTES:

1. 3/4" NG DN TO UNIT HEATER WITH VALVE, DRIP LEG AND PRESSURE REGULATOR, 30 CFH. SEE DETAIL B4/P-502.

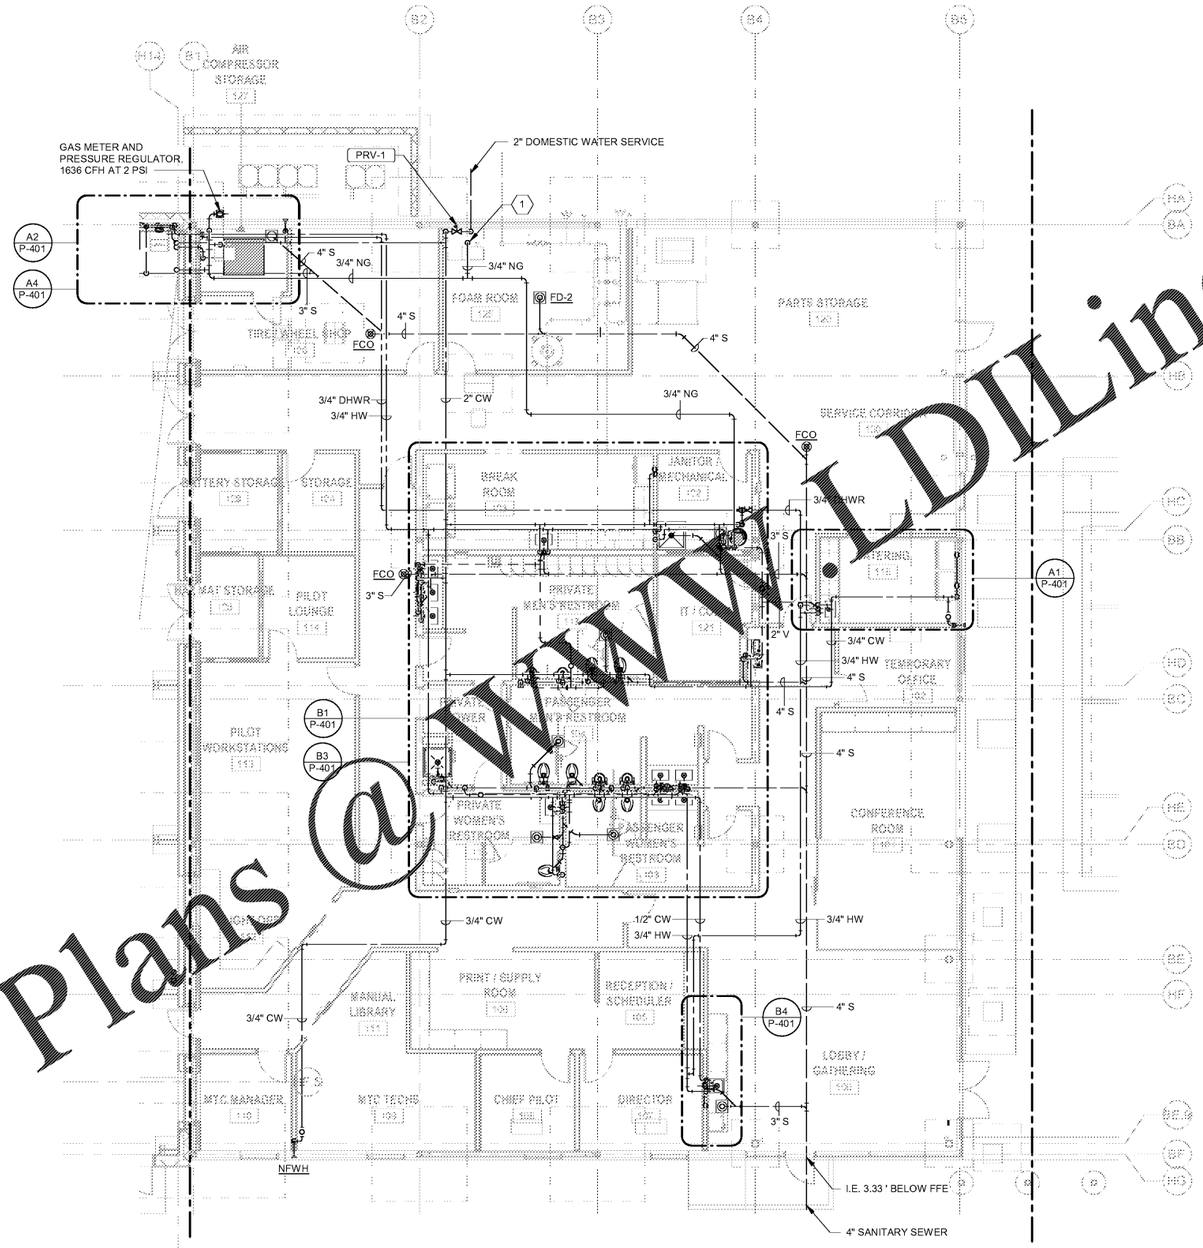

A2 OFFICE PLUMBING PLAN

SCALE: 1/8" = 1'-0"

8 0 8 16

SCALE: 1/8" = 1'-0"

NORTH

Order Plans @ WWW.LDILine.com

MARK	DESCRIPTION	DATE

DESIGNED BY: GWD
DRAWN BY: GWD
CHECKED BY: JML
SUBMITTED BY: JML
ISSUED FOR CONSTRUCTION: 13-JUL-2020

OWNER'S REPRESENTATIVE: HERALD FAIRKLAR
OCCUPANCY CLASSIFICATION: BUSINESS (B) AND STORAGE (S1)*
TYPE OF CONSTRUCTION: TYPE II-B - NON-COMBUSTIBLE
*PER NFPA 409, AS I-HE-1 DESIGNATION PROVIDED BY OWNER'S REPRESENTATIVE AND THE OFFICE

NORFOLK SOUTHERN CORP
1200 PEACHTREE STREET, NE
ATLANTA, GEORGIA 30309

POND
3500 Parkway Lane, Suite 500
Peachtree Corners, GA 30092
Phone (770) 325-7744
Fax (770) 325-7744
GA Reg. 1797

CORPORATE AIRCRAFT HANGAR FOR NORFOLK SOUTHERN CORPORATION
FULTON COUNTY AIRPORT - BROWN FIELD (PDK)
3952 AVIATION CIRCLE, SUITE 200
ATLANTA, GEORGIA 30336

FIRST FLOOR PLUMBING PLAN - OFFICE

SHEET ID

P-101B

CONSTRUCTION DOCUMENTS

Copyright © 2020 by Pond & Company. All rights reserved. No copying or duplication of these documents is allowed without the express written agreement of Pond & Company.

7/9/2020 5:41:45 PM BIM 360://1190557 - Pegasus/1190557_Pegasus_NS_MEP_FP_v19.rvt