SHEET NOTES:

1. REFER TO E-001 & E-002 FOR ELECTRICAL GENERAL NOTES, ABBREVIATIONS & LEGEND.
2. REFER TO E-612 FOR MECHANICAL EQUIPMENT CONNECTION SCHEDULE.
3. REFER TO MECHANICAL DESIGN DOCUMENTS FOR EXACT LOCATION OF EQUIPMENT.

KEY NOTES:

1. MOUNT MOTOR RATED SWITCH TO THE SAME JOIST AS THE INFRARED RADIANT HEATER OR VACUUM PUMP THAT IT IS SERVING.

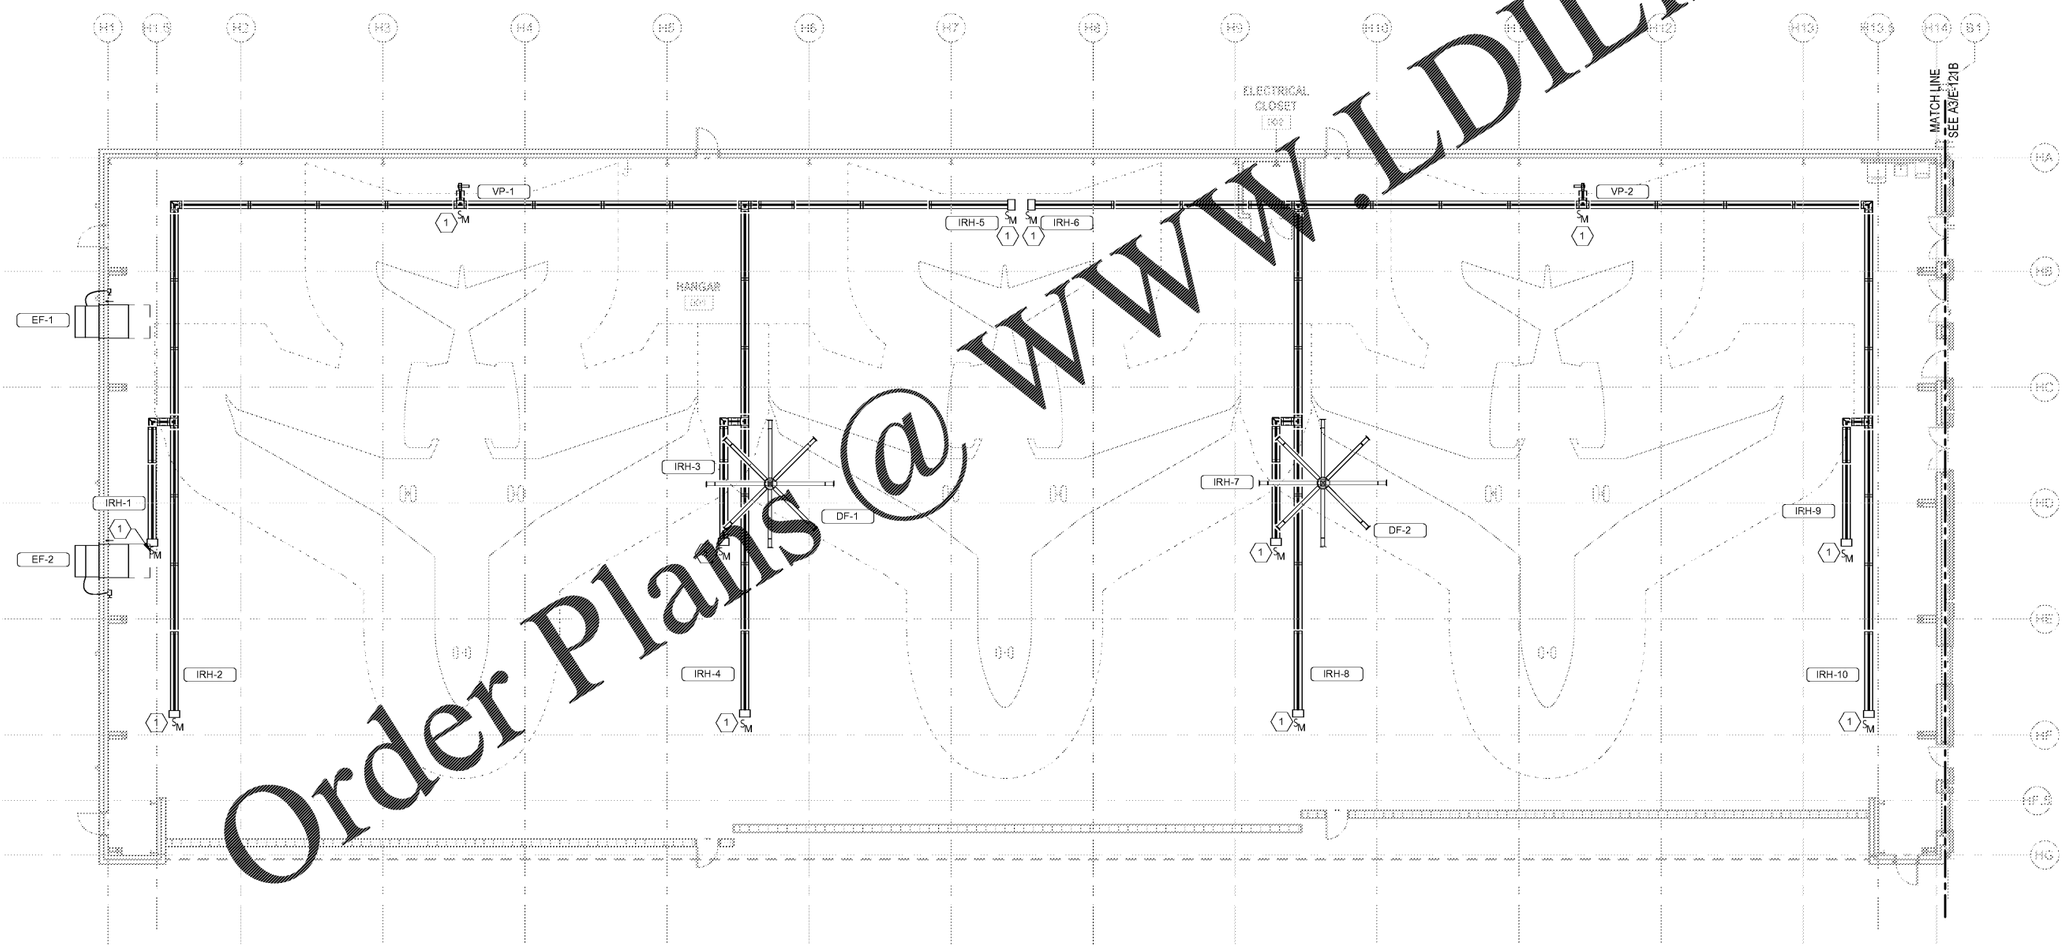

A1 MECHANICAL POWER PLAN - HANGAR AREA

SCALE: 3/32" = 1'-0"

8 0 8 16 24

SCALE: 3/32" = 1'-0"

NORTH

Order Plans @ www.LDILine.com

MARK	DESCRIPTION	DATE

DESIGNED BY:	TCG
DRAWN BY:	TCG
CHECKED BY:	TBH
SUBMITTED BY:	BA
ISSUED FOR CONSTRUCTION:	DD-MMM-YYYY

OWNER'S REPRESENTATIVE:
KENDALL D. HEARN, AIA

OCCUPANCY CLASSIFICATION:
BUSINESS (B) AND STORAGE (S1)*

TYPE OF CONSTRUCTION:
TYPE II-B - NON-COMBUSTIBLE

*PER NFPA 409, A.7.4.3 EXCEPTION, THE AIRCRAFT MAINTENANCE HANGAR AND THE OFFICE

NORFOLK SOUTHERN CORP
1200 PEACHTREE STREET, NE
ATLANTA, GEORGIA 30309

POND
3500 Parkway Lane, Suite 500
Peachtree Corners, GA 30092
Phone (678) 336-7744
Fax (678) 336-7744
CA/FIRM #: 1189557

CORPORATE AIRCRAFT HANGAR FOR NORFOLK SOUTHERN CORPORATION
FULTON COUNTY INTERNATIONAL AIRPORT (FTY)
3952 AVIATION CIRCLE, SUITE 200
ATLANTA, GEORGIA 30336

MECHANICAL POWER PLAN - HANGAR AREA

SHEET ID

E-121A

7/10/2020 11:55:52 AM BIM 360://1190557 - Pegasus//1190557_Pegasus_NS_MEP_FP_v19.rvt

Copyright © 2020 by Pond & Company. All rights reserved. No copying or duplication of these documents is allowed without the express written agreement of Pond & Company.

CONSTRUCTION DOCUMENTS