SHEET NOTES:

1. REFER TO E-001 & E-002 FOR ELECTRICAL GENERAL NOTES, ABBREVIATIONS & LEGEND.

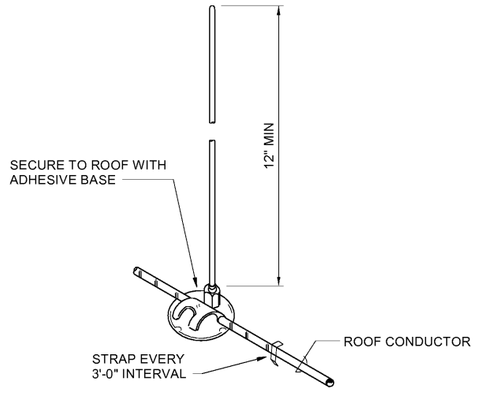

C1 AIR TERMINAL
SCALE: N.T.S.

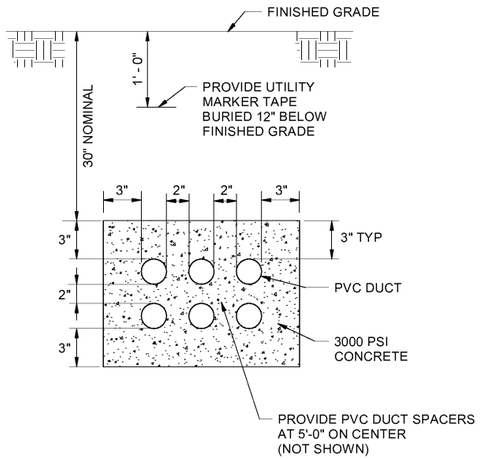

C2 6W DUCTBANK DETAIL
SCALE: N.T.S.

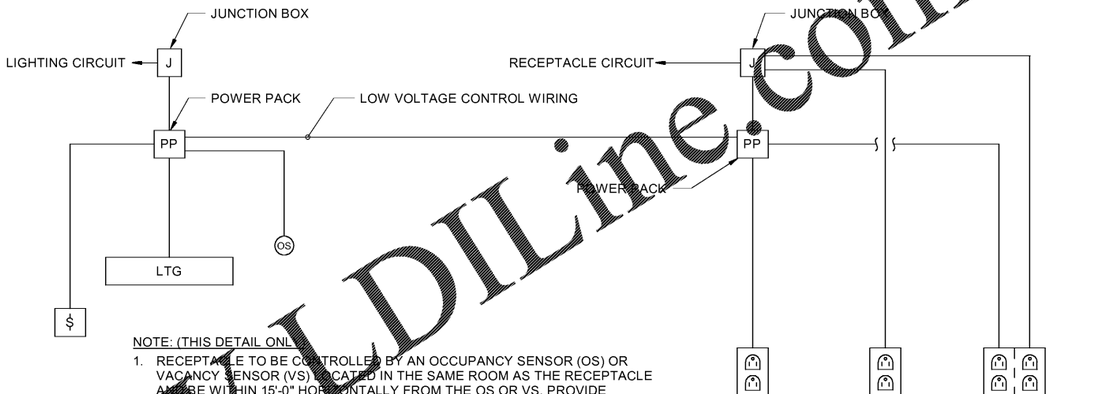

NOTE: (THIS DETAIL ONLY)

1. RECEPTACLE TO BE CONTROLLED BY AN OCCUPANCY SENSOR (OS) OR VACANCY SENSOR (VS) LOCATED IN THE SAME ROOM AS THE RECEPTACLE AND BE WITHIN 15'-0" HORIZONTALLY FROM THE OS OR VS. PROVIDE ADDITIONAL OS OR VS AS REQUIRED.

C3 LIGHTING AND RECEPTACLE CONTROL SCHEMATIC
SCALE: N.T.S.

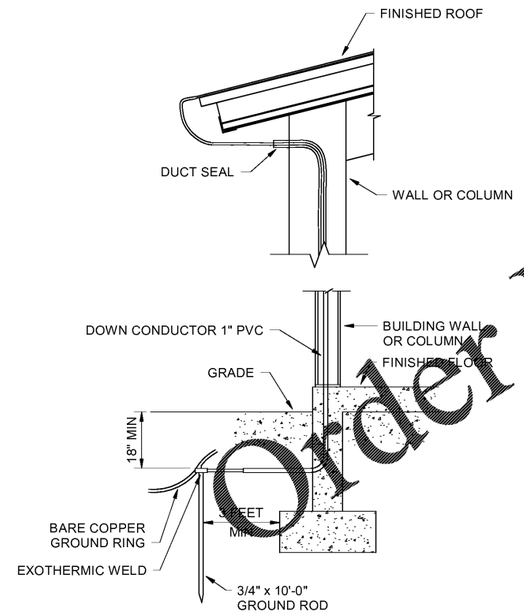

A1 LPS DOWN CONDUCTOR DETAIL
SCALE: N.T.S.

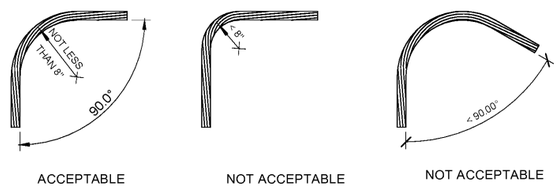

A2 LPS CABLE BENDING DETAIL
SCALE: N.T.S.

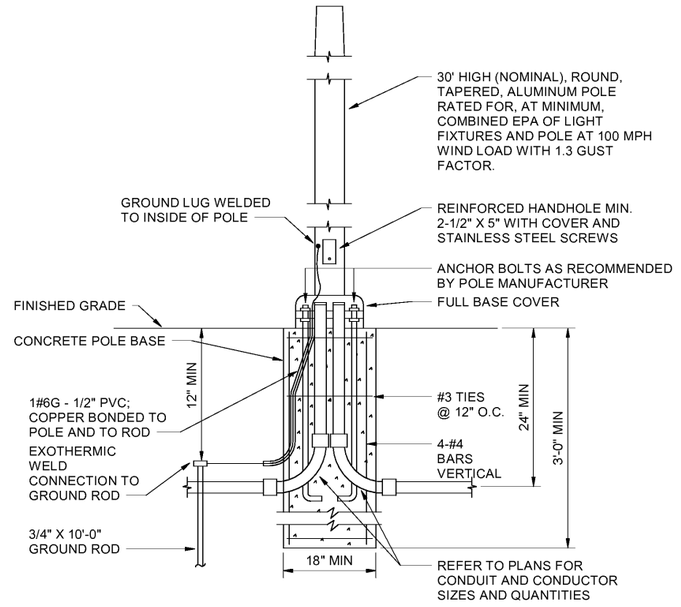

A4 LIGHT POLE FOUNDATION DETAIL
SCALE: N.T.S.

Order Plans @ WWW.DILine.com

CORPORATE AIRCRAFT HANGAR FOR NORFOLK SOUTHERN CORPORATION
FULTON COUNTY AIRPORT - BROWN FIELD (FTY)
3952 AVIATION CIRCLE, SUITE 200
ATLANTA, GEORGIA 30336

ELECTRICAL DETAILS

SHEET ID
E-503

DESIGNED BY: TDG
DRAWN BY: TDG
CHECKED BY: TEH
SUBMITTED BY:
ISSUED FOR CONSTRUCTION: 00-MMM-YYYY

DATE | DESCRIPTION | MARK

NORFOLK SOUTHERN CORP
1200 PEACHTREE STREET, NE
ATLANTA, GEORGIA 30308

POND
3500 Parkway Lane, Suite 500
Peachtree Corners, GA 30092
Phone (770) 368-2744
Fax (770) 368-2745
GA FIRM NO. 1797

DENOTES REPRESENTATIVE
HERALD T. HEARN, AIA

OCCUPANCY CLASSIFICATION
BUSINESS (B) AND STORAGE (S1)*

TYPE OF CONSTRUCTION
TYPE II-B - NON-COMBUSTIBLE

*PER NFPA 409, AS I-HR SEPARATION IS PROVIDED BETWEEN THE HANGAR AND THE OFFICE

Copyright © 2020 by Pond & Company. All rights reserved. No copying or duplication of these documents is allowed without the express written agreement of Pond & Company.

CONSTRUCTION DOCUMENTS

7/10/2020 11:56:05 AM BIM 360://1190557 - Pegasus/1190557_Pegasus_NS_MEP_FP_v19.rvt