KITCHEN EQUIPMENT SCHEDULE - DECK LEVEL - ELECTRICAL										
TAG	DESCRIPTION	FLA	TOTAL VA	VOLTAGE	POLES	DEVICE	PANEL	CIRCUIT NUMBER	CIRCUIT DESCRIPTION	NOTES
E204	MEDIUM TEMP REMOTE CONDENSING UNIT	6 A	1332 VA	208 V	2	30A/2P/3R	K2	36,38	2#12,1#12G,3/4"C	

KEY NOTES: (X)

1. PROVIDE ONE (1) 2"C AND ONE (1) 1"C FOR FUTURE POWER AND LOW VOLTAGE TO ROOF TOP TERRACE. COORDINATE LOCATIONS WITH ARCHITECT. STUB OUT EMPTY CONDUIT WITH NYLON PULL STRING AND CAP.
2. DEVICES LOCATED AT THE TOP OF THE ELEVATOR HOISTWAY. COORDINATE EXACT LOCATIONS AND REQUIREMENTS WITH ELEVATOR MANUFACTURE AND SHOP DRAWINGS PRIOR TO ROUGH-IN.
3. 30A/3P UNFUSED DISCONNECT MOUNTED WITHIN 3' OF MOTOR WITH AUX DRY CONTACT PER MANUFACTURERS SPECIFICATION. COORDINATE ALL FINAL ELECTRICAL REQUIREMENTS WITH ELEVATOR SHOP DRAWINGS PRIOR TO ROUGH-IN.
4. 30A/3/125A DUAL ELEMENT TIME DELAY FUSED DISCONNECT WITH AUX DRY CONTACT AND SHUNT TRIP FOR CONNECTION TO ELEVATOR CONTROLLER. COORDINATE FINAL ELECTRICAL REQUIREMENTS WITH ELEVATOR SHOP DRAWINGS PRIOR TO ROUGH-IN.
5. 30A/2P/15A FUSED DISCONNECT FOR CONNECTION TO ELEVATOR CAB LIGHTING.

SHEET NOTES:

1. PROVIDE ALL POWER AND FIRE ALARM INSTALLATIONS IN ACCORDANCE WITH ELECTRICAL SYSTEM REQUIREMENTS AND SPECIFICATIONS. ALL ELECTRICAL INSTALLATIONS SHALL COMPLY WITH THE 2017 FLORIDA BUILDING AND ENERGY CODES
2. COORDINATE WITH MECHANICAL AND PLUMBING DRAWINGS AND SPECIFICATIONS FOR ALL FINAL EQUIPMENT REQUIREMENTS. REFER TO ELECTRICAL EQUIPMENT SCHEDULES FOR ELECTRICAL CONNECTION REQUIREMENTS. COORDINATE ALL FINAL ELECTRICAL REQUIREMENTS WITH SUBMITTED AND APPROVED EQUIPMENT SHOP DRAWINGS.
3. ALL 125V, SINGLE PHASE, 15A AND 20A RECEPTACLES INSTALLED IN KITCHEN AND BAR AREAS SHALL HAVE READILY ACCESSIBLE GROUND-FAULT CIRCUIT-INTERRUPTER PROTECTION FOR PERSONNEL. ACCESSIBLE RECEPTACLES WITHIN THE KITCHEN AND BAR AREAS HAVE BEEN SHOWN AS GFCI TYPE DEVICES WITHIN PLANS. RECEPTACLES BEHIND FIXED EQUIPMENT HAVE BEEN PROVIDED WITH GFCI TYPE BREAKERS. REFER TO ENLARGED PLANS AND PANEL SCHEDULES FOR REQUIREMENTS.
4. CONTRACTOR SHALL PROVIDE DISCONNECTS OR LOCKABLE BREAKERS FOR HARDWIRED KITCHEN EQUIPMENT NOT WITHIN LINE OF SIGHT FROM THE PANEL PER NEC REQUIREMENTS. COORDINATE FINAL ELECTRICAL REQUIREMENTS WITH SUBMITTED AND APPROVED FOOD SERVICE EQUIPMENT.
5. COORDINATE EXACT LOCATIONS AND MOUNTING HEIGHTS OF ALL ELECTRICAL DEVICES WITH ARCHITECT, INTERIORS AND FOOD SERVICE PLANS AND ELLVATIONS PRIOR TO ROUGH-IN.

Order Plans @ WWW.LDILine.com

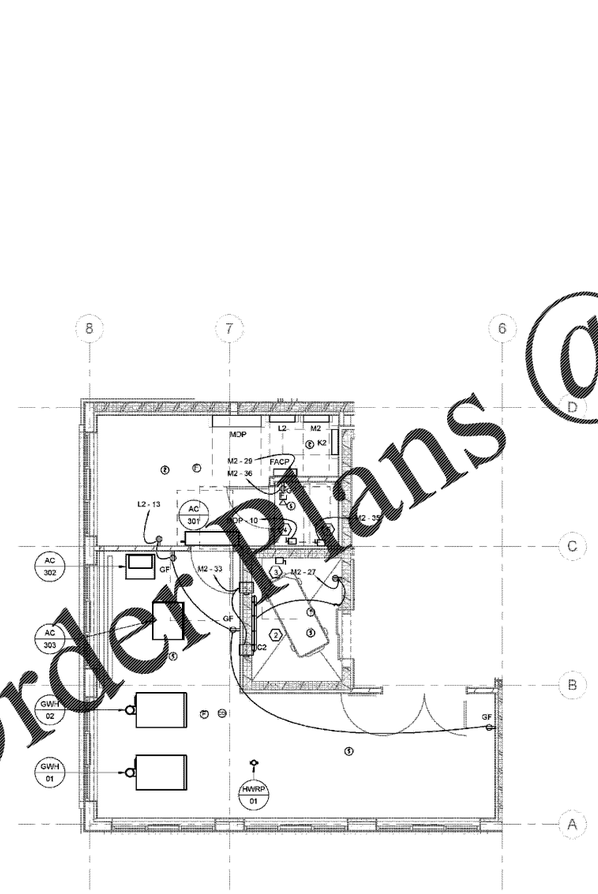

2 E2.02 ENLARGED PLAN - ROOF DECK ELECTRICAL ROOM
1/4" = 1'-0"

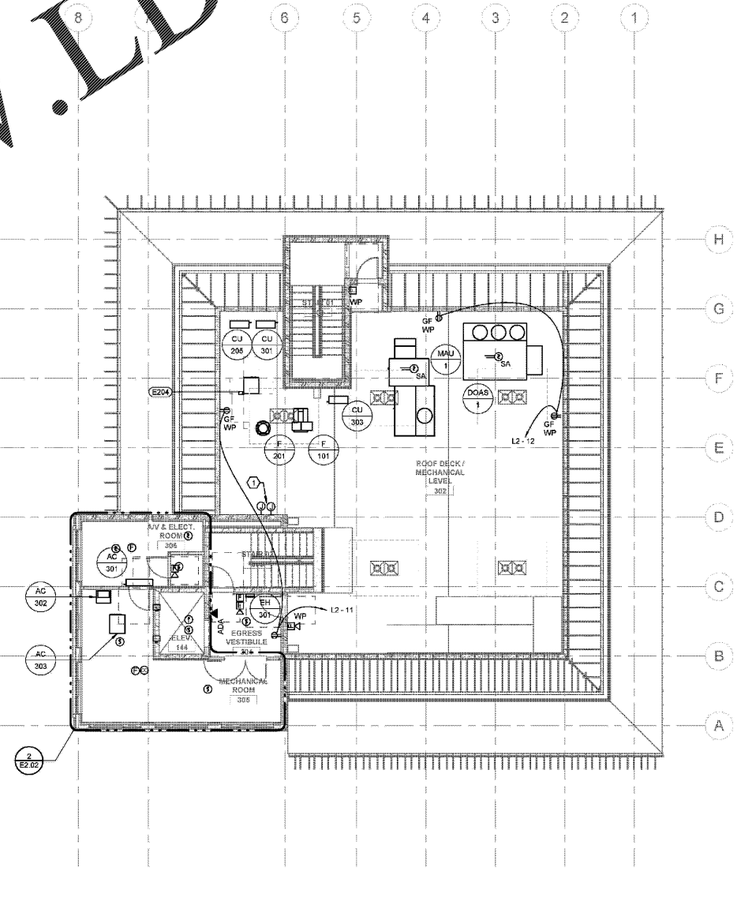

1 E2.02 FLOOR PLAN - DECK LEVEL - POWER
1/8" = 1'-0"

SCALE: 1/8" = 1'-0" 0' 1' 4' 8' 16'

SCALE: 1/4" = 1'-0" 0' 1' 2' 4' 8'

Thompson Ehle Company
www.teceng.org
Tel: (713) 518-1426
TEC Project #219018

© 2019 HKS ARCHITECTS, INC.

PLOT DATE: 5/20/2020 3:48:36 PM TEMPLATE VERSION:

HKS

ARCHITECT
HKS ARCHITECTS, INC.
#AA F000119
201 ALHAMBRA CIRCLE, SUITE 600
CORAL GABLES, FL 33134

CIVIL ENGINEER
KIMLEY-HORN
12740 GRAN BAY PARKWAY WEST
SUITE 2350
JACKSONVILLE, FL 32258

STRUCTURAL CONSULTANT
THORNTON TOMASETTI
101 NE THIRD AVE., SUITE 1170
FORT LAUDERDALE, FL 33301-1129

MEP CONSULTANT
THOMPSON EHLE
60 TECHNOLOGY PKWY S. PEACHTREE CORNERS, GA 30092

KITCHEN CONSULTANT
INNOVATIVE FOOD SERVICES
11101 NORTH 46TH STREET, TAMPA, FL 33617

WATERPROOFING CONSULTANT
CDC USA
6070 Park Ln., Suite 400 Dallas, TX 75231

CODE & LIFE SAFETY CONSULTANT
HOWE ENGINEERS
101 LONGWATER CIR, NORWELL, MA 02061

MARRIOTT SAWGRASS CABANA CLUB

OWNER
WATERMARK CAPITAL PARTNERS, LLC
150 NORTH RIVERSIDE PLAZA SUITE 4200
CHICAGO, IL 60606

OWNER'S CONSULTANT
THE JOHN HARDY GROUP INC.
6085 BARFIELD RD. SUITE 200
ATLANTA, GA 30328

Benjamin Kowalczyk, State of Florida, Professional Engineer, License No. 77531

This item has been electronically signed and sealed by Benjamin Kowalczyk, on the Date and/or Time Stamp using a digital signature.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copy.

KEY PLAN



REVISION
NO. DESCRIPTION DATE

HKS PROJECT NUMBER
22808.001
DATE
05/22/2020
ISSUE
PERMIT SET

SHEET TITLE
FLOOR PLAN - DECK & ROOF LEVEL - POWER
SHEET NO.
E2.02