




BREAK ROOM CONTROL SCHEME
N.T.S.

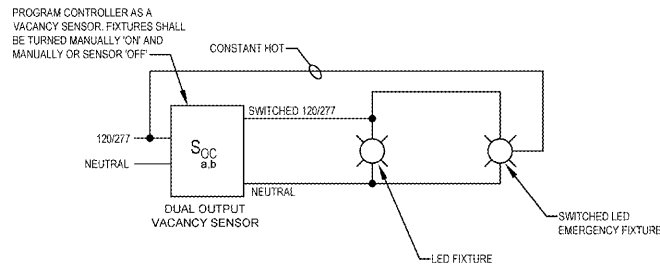


MANAGER'S OFFICE CONTROL SCHEME
N.T.S.

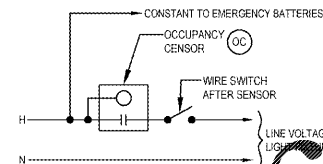

TOILET ROOM OCCUPANCY CONTROL SCHEME
N.T.S.

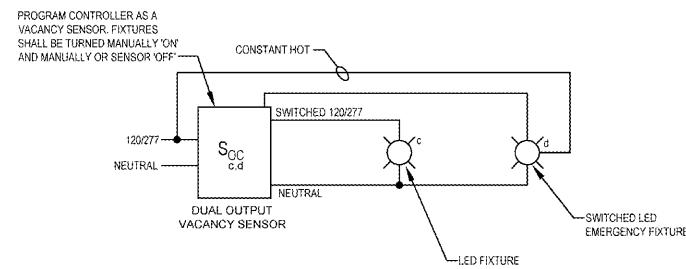


CASH ROOM CONTROL SCHEME
N.T.S.

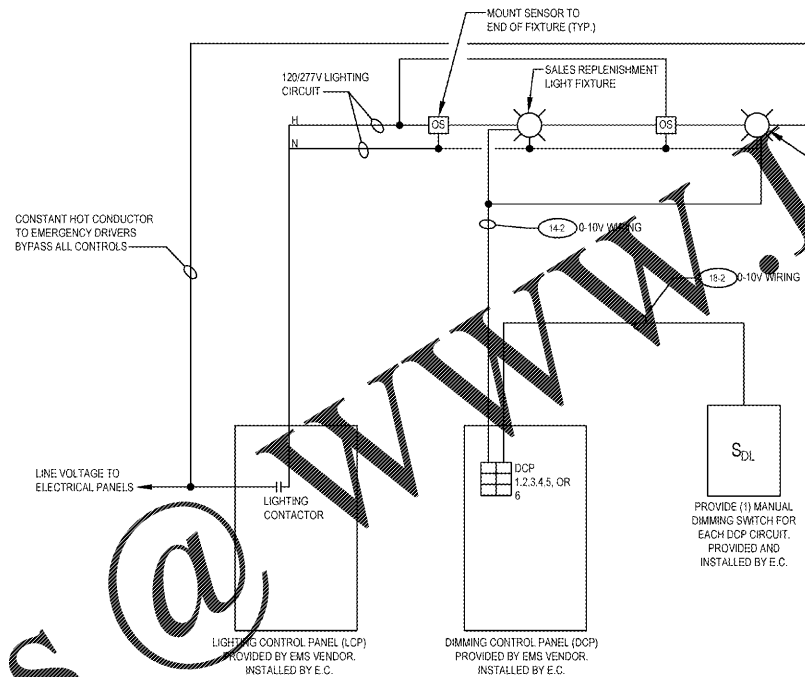

SALES AND SALES REPLENISHMENT CONTROL SCHEME
N.T.S.

Order Plans

ALL DEVICES SHOWN FOR OCCUPANCY / DIMMING CONTROL INDICATED ON THIS DRAWING ARE NOT PART OF THE SIEMENS EMS SYSTEM (U.O.N), THE ELECTRICAL CONTRACTOR SHALL PURCHASE, WIRE, INSTALL LINE VOLTAGE DIMMING SWITCHES, OCCUPANCY/VACANCY SENSORS, RELAYS, ETC.



ARCHITECTS, INC.
17710 Detroit Avenue, Lakewood, Ohio 44107
Phone (216) 521-5134 Fax (216) 521-4824
www.adaarchitects.com

HARBOR FREIGHT TOOLS

705 WYATT ROAD NORTHWEST CLEVELAND, TN 37312

DO NOT SCALE THESE DRAWINGS

#	DATE	TYPE
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		

ROOM LIGHTING CONTROL / DIMMING SYSTEM DETAILS
DATE 06/02/20
JOB NO. 19155
E1.1A
SHEET NO.

This document (instrument of service) was prepared by ADA Architects, Inc. ("ADA") specifically for the referenced project and is not intended for any other use. ADA makes no warranty, express or implied, regarding the accuracy, completeness, or timeliness of the information contained herein. Any use of this document for any purpose other than that intended by ADA is at the user's sole risk and without liability to ADA. ADA makes no warranty, express or implied, of merchantability or of fitness for a particular purpose. Any unauthorized use of this instrument of service shall be at the user's sole risk and without liability to ADA. ADA makes no warranty, express or implied, of merchantability or of fitness for a particular purpose.