FOOTING SCHEDULE

SYMBOL	THICKNESS	SIZE	REINFORCING
F-1	1'-8"	CONTINUOUS	3 - #5 BAR CONTINUOUS
F-2	2'-0"	4'-0" X 4'-0"	4 - #5 @ 12" O.C. EACH DIRECTION (TOP & BOTTOM)

FOUNDATION NOTES

1.FOUNDATIONS ARE DESIGNED FOR A MINIMUM ALLOWABLE SOIL BEARING PRESSURE OF 1500 PSF

2.FOOTING AND SLABS SHALL BEAR ON SUB-GRADE COMPACTED TO MINIMUM 95% PER ASTM D697 PER SPECS

3.ALL WATER SOFTENED SOILS SHALL BE REMOVED FROM FOOTING EXCAVATION PRIOR TO PLACING CONCRETE. REMAINING VOIDS SHALL BE FILLED WITH GRAVEL OR COMPACTED FILL.

4.REINFORCING IN FOOTINGS SHALL BE SUPPORTED WITH CONCRETE BRICKS OR STD. CHAIRS POSITIONED TO MAINTAIN 3" CLEARANCE FROM BOTTOM OF FOOTING.

5.PROVIDE 1/4" P.E.J. FILLER AROUND PERIMETER OF SLABS WHERE THEY ABUT VERTICAL SURFACES.

6.PROVIDE CONTROL JOINTS IN SLAB AT INDICATED LOCATIONS OR SAW CUT SLAB WITHIN 48 HOURS OF PLACEMENT.

7.CONTRACTOR RESPONSIBLE FOR SOIL TESTING FROM QUALIFIED INSPECTOR TO ASSURE SOIL BEARING CAPACITY.

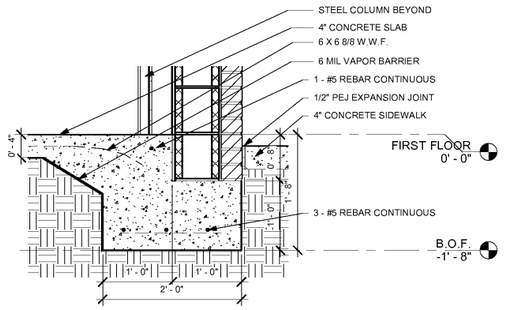

2 S1 FOUNDATION DETAIL F-1
1" = 1'-0"

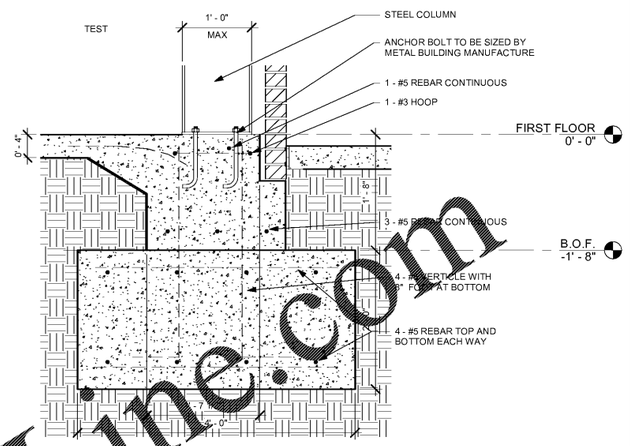

3 S1 FOUNDATION DETAIL F-2
1" = 1'-0"

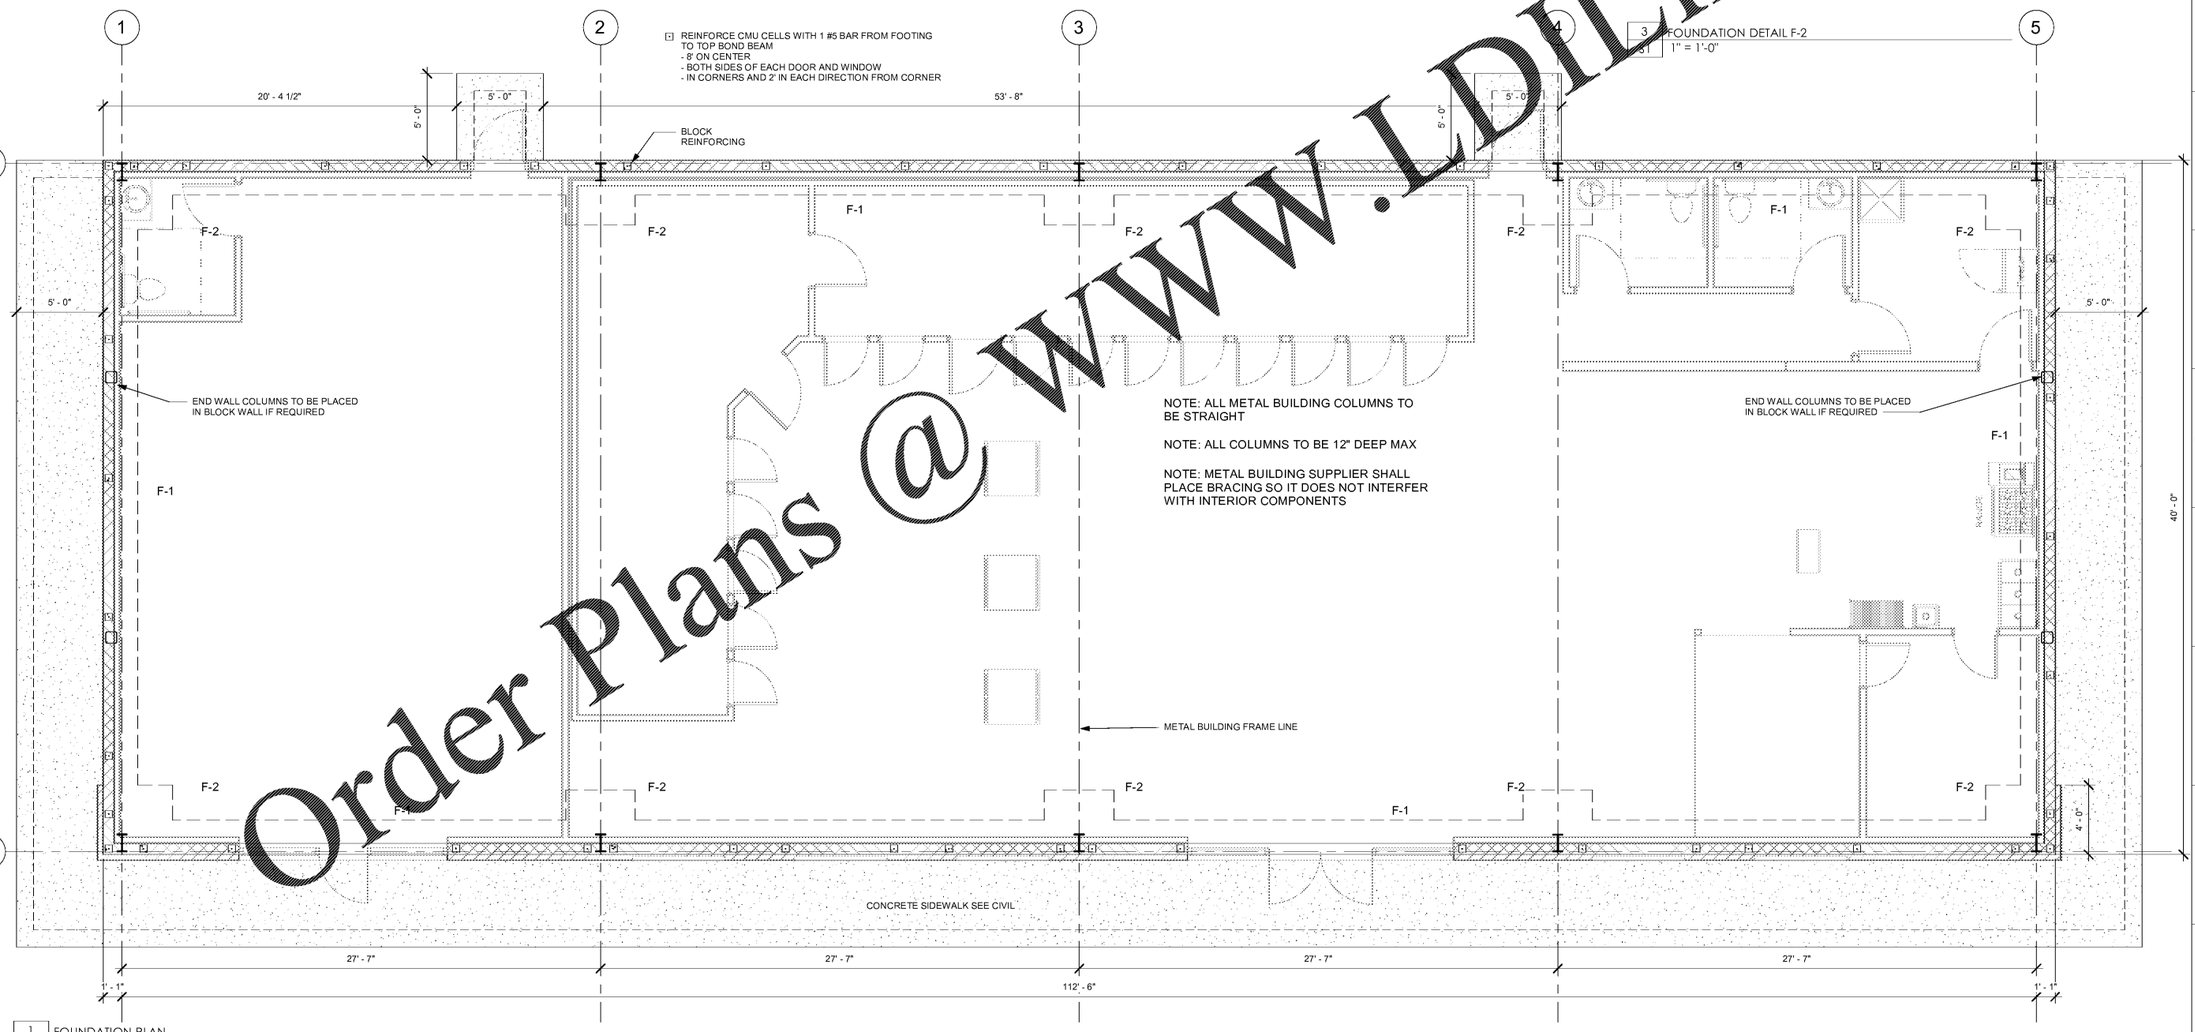

1 S1 FOUNDATION PLAN
1/4" = 1'-0"

Order Plans @ WWW.LDLine.com

DPR ARCHITECTURE
D'ARCANGELO PALMER RILE
12 A E. GRADY STREET
P.O. BOX 1382
912-764-6288
STATESBORO
GEORGIA 30458
www.dprarch.com

COPYRIGHT 2015 - ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS AND DOCUMENTATION MAY NOT BE REPRODUCED IN ANY FORM WITHOUGHT WRITTEN PERMISSION FROM DPR ARCHITECTURE

CONVENIENCE STORE for VIPULKUMAR PATEL
RINCON, GEORGIA

SCHEDULE OF REVISIONS

#	DATE

PROJECT NUMBER: 2009
PROJECT DATE: 4-10-2020
DRAWN BY: Author
APPROVED BY: Approver

S1