


JOIST(S) SUPPORTING	SHEAR REIN. LOCATION		CHORD REIN LOCATION	
	START	FINISH	START	FINISH
PGP-22	0'-0"	5'-6"	0'-0"	5'-6"
PGP-23 & PGP-24	0'-0"	18'-0"	0'-0"	12'-0"


NOTES:
 1. JOIST CONFIGURATION SHOWN IS FOR ILLUSTRATIVE PURPOSES ONLY. ACTUAL JOIST ELEVATION MAY VARY.
 2. LIVE LOAD ON ROOF SHALL BE MINIMIZED DURING REINFORCING OPERATION.
 3. JOIST TO BE REINFORCED SHALL BE SHORED FROM GROUND LEVEL TO ROOF FOR A LOAD OF 180 POUNDS PER LINEAR FOOT. REMOVE SHORING AFTER COMPLETION OF ALL REINFORCING WORK AND REQUIRED INSPECTION BY TESTING AGENCY FOR INDIVIDUAL JOIST. MINIMIZE TIME JOIST IS SHORED.
 4. ALL JOISTS TO BE REINFORCED MUST BE COMPLETED AND ALL SHORING MUST BE REMOVED PRIOR TO INSTALLATION OF NEW RTU.

1 ELEVATION
N.T.S.

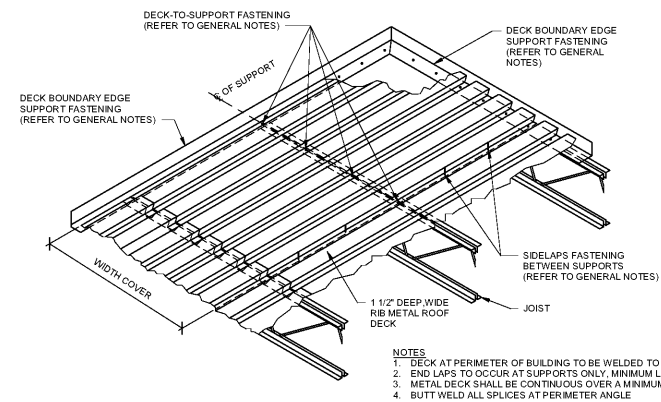


NOTES:
 1. DECK AT PERIMETER OF BUILDING TO BE WELDED TO JOISTS OR ANGLES UNO
 2. END LAPS TO OCCUR AT SUPPORTS ONLY. MINIMUM LAP = 2'
 3. METAL DECK SHALL BE CONTINUOUS OVER A MINIMUM OF 2 SPANS
 4. BUTT WELD ALL SPLICES AT PERIMETER ANGLE


6 1 1/2" ROOF DECK FASTENING ISOMETRIC
N.T.S.

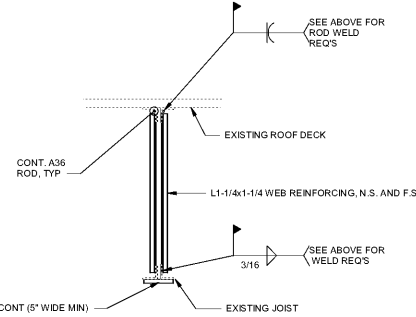


2 TYPICAL BAR JOIST DETAIL
N.T.S.

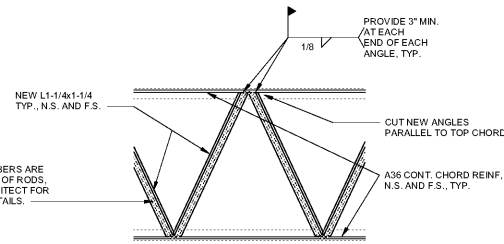


3 WEB REINFORCEMENT
N.T.S.

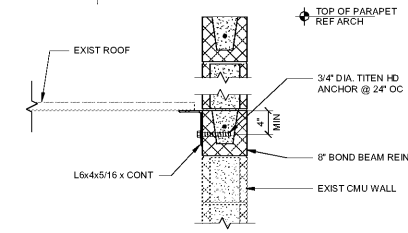


4 DECK SUPPORT
1" = 1'-0"

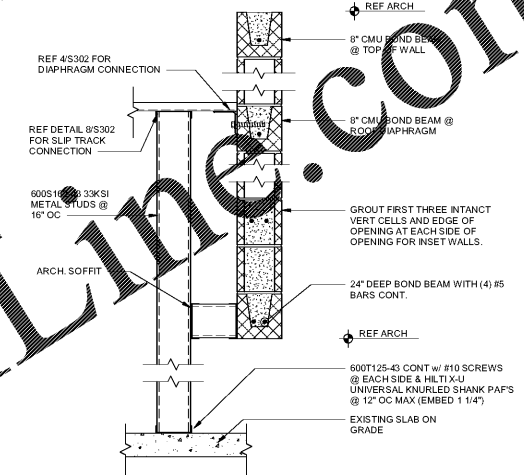


5 CMU LINTEL SECTION
1" = 1'-0"

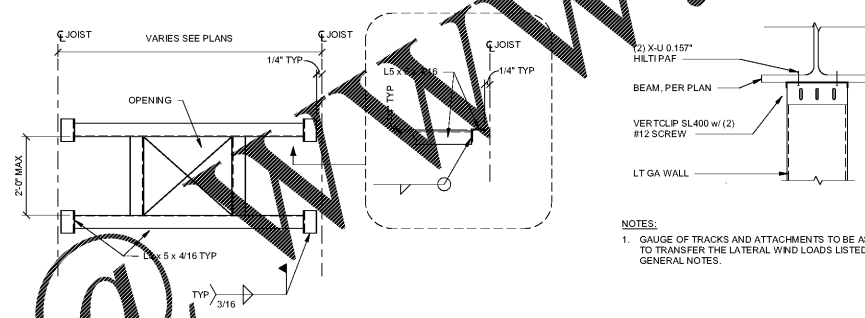


8 TYPICAL SLIP TRACK
N.T.S.

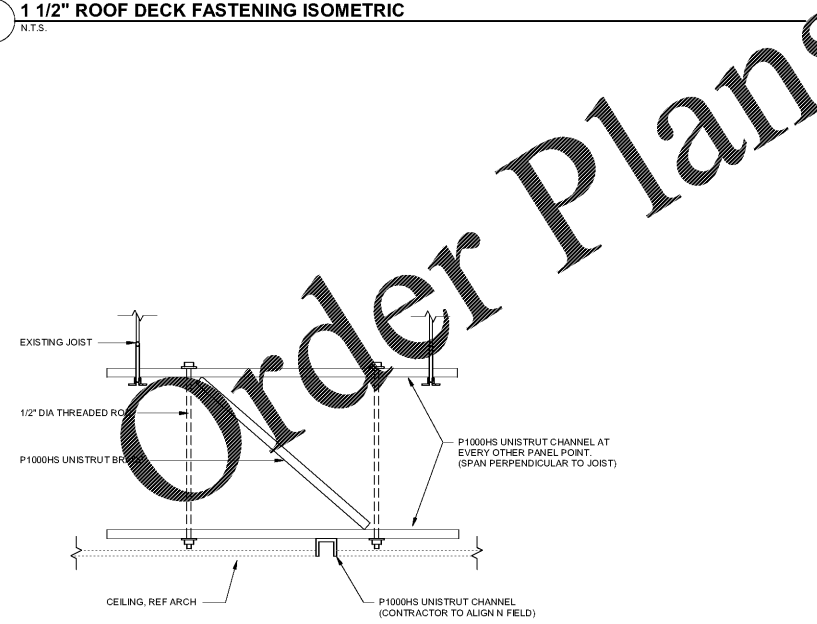


10 UNISTRUT SUPPORT
1" = 1'-0"

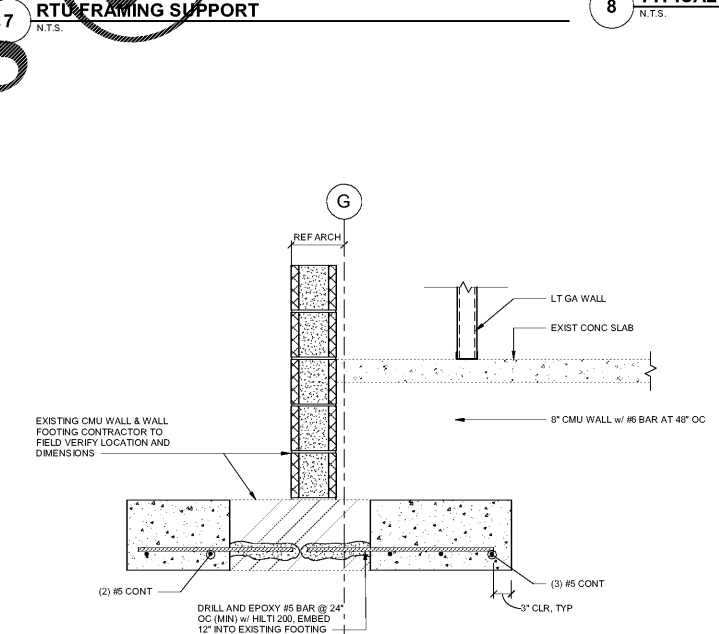

11 FOUNDATION SUPPORT FOR CMU WALL
1" = 1'-0"

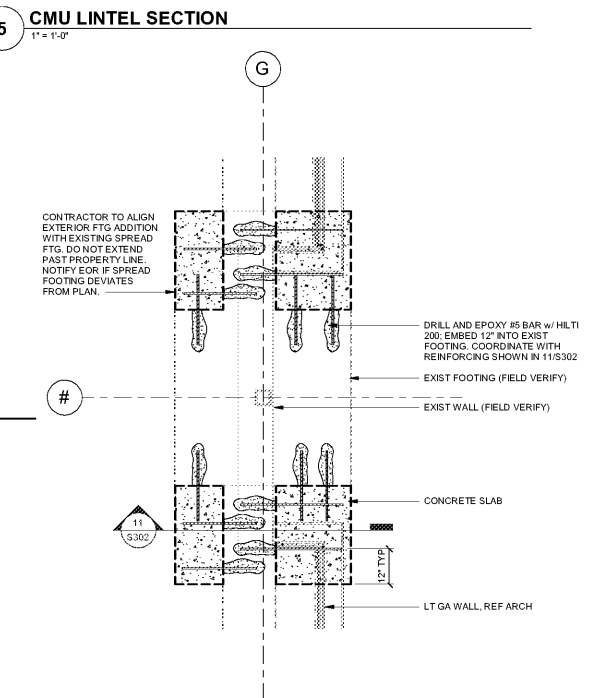

9 SLAB REINFORCEMENT AT CMU JAMB
1/2" = 1'-0"

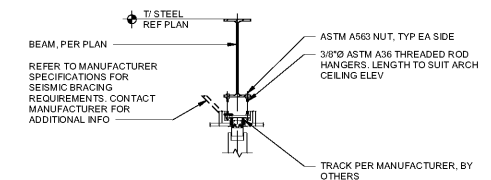

12 TRACK HANGER
3/4" = 1'-0"

mc milian pazdan smith
ARCHITECTURE

BRITT, PETERS & ASSOCIATES
ARCHITECTS

1000 W. BROADWAY
SUITE 2000
ANNAPOLIS, MD 21403
TEL: 410-291-1100
WWW.MCMILIANPAZDANSMITH.COM

PRINCIPAL IN CHARGE: JSR
PROJECT ARCHITECT: JSR
DRAWN BY: TB

SHEET TITLE: SECTIONS & DETAILS

SHEET NO. PROJ. NO. 017348.00

DON OGLESBY
THE OPPORTUNITY CENTER
8570 RIVERS AVE. N CHARLESTON, SC

SHEET ISSUE
Jan. 24, 2020 ISSUED FOR PERMIT

S302