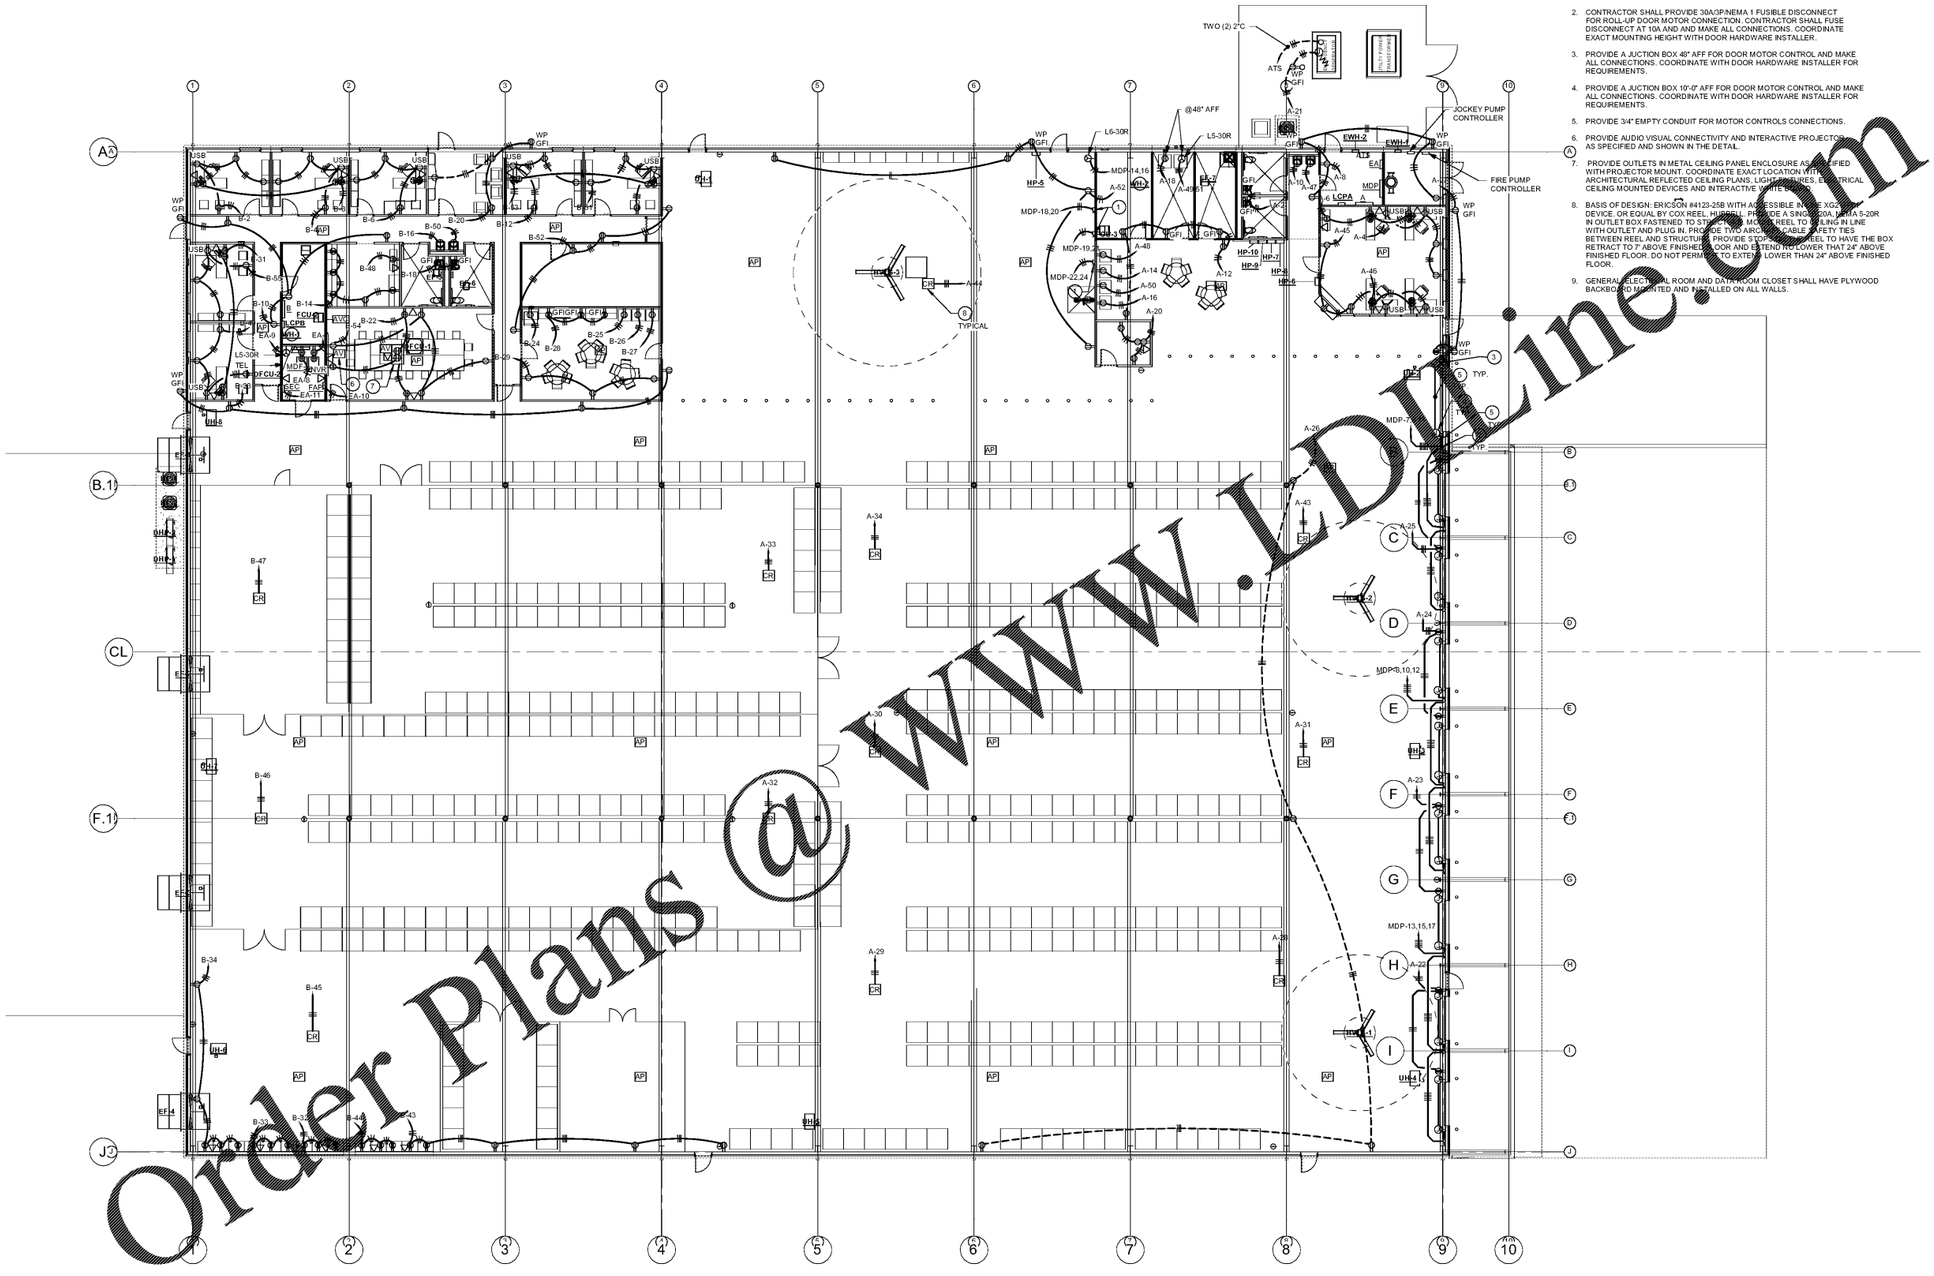

NOTES: (THIS SHEET ONLY)

1. PROVIDE 60A,2P,NEMA 1 FUSIBLE DISCONNECT FOR FORKLIFT CHARGING STATION. CONTRACTOR SHALL FUSE DISCONNECT AT 40A.
2. CONTRACTOR SHALL PROVIDE 30A/3P,NEMA 1 FUSIBLE DISCONNECT FOR ROLL-UP DOOR MOTOR CONNECTION. CONTRACTOR SHALL FUSE DISCONNECT AT 10A AND AND MAKE ALL CONNECTIONS. COORDINATE EXACT MOUNTING HEIGHT WITH DOOR HARDWARE INSTALLER.
3. PROVIDE A JUCTION BOX 48" AFF FOR DOOR MOTOR CONTROL AND MAKE ALL CONNECTIONS. COORDINATE WITH DOOR HARDWARE INSTALLER FOR REQUIREMENTS.
4. PROVIDE A JUCTION BOX 10'-0" AFF FOR DOOR MOTOR CONTROL AND MAKE ALL CONNECTIONS. COORDINATE WITH DOOR HARDWARE INSTALLER FOR REQUIREMENTS.
5. PROVIDE 3/4" EMPTY CONDUIT FOR MOTOR CONTROLS CONNECTIONS.
6. PROVIDE AUDIO VISUAL CONNECTIVITY AND INTERACTIVE PROJECTOR AS SPECIFIED AND SHOWN IN THE DETAIL.
7. PROVIDE OUTLETS IN METAL CEILING PANEL ENCLOSURE AS SPECIFIED WITH PROJECTOR MOUNT. COORDINATE EXACT LOCATION WITH ARCHITECTURAL REFLECTED CEILING PLANS, LIGHT FIXTURES, ELECTRICAL CEILING MOUNTED DEVICES AND INTERACTIVE WHITE BOARD.
8. BASIS OF DESIGN: ERICSON #4123-25B WITH ACCESSIBLE IN LINE XG2 DEVICE, OR EQUAL BY COX REEL, HUBBELL. PROVIDE A SINGLE 20A, NEMA 5-20R IN OUTLET BOX FASTENED TO STRUCTURE. MOUNT REEL TO CEILING IN LINE WITH OUTLET AND PLUG IN. PROVIDE TWO AIRCRAFT CABLE SAFETY TIES BETWEEN REEL AND STRUCTURE. PROVIDE STOP SCREW ON REEL TO HAVE THE BOX RETRACT TO 7" ABOVE FINISHED FLOOR AND EXTEND NO LOWER THAT 24" ABOVE FINISHED FLOOR. DO NOT PERMIT IT TO EXTEND LOWER THAN 24" ABOVE FINISHED FLOOR.
9. GENERAL ELECTRICAL ROOM AND DATA ROOM CLOSET SHALL HAVE PLYWOOD BACKBOARD MOUNTED AND INSTALLED ON ALL WALLS.

POWER FLOOR PLAN

SCALE: 3/32" = 1'-0"

Order Plans @ WWW.LDLine.com

ISSUANCES

DATE	Description

KEY PLAN

AH&P CONSULTING ENGINEERS

ANDREWS, HAMMOCK & POWELL, INC.
250 Charter Lane
Suite 100
MACON, GEORGIA 31210
MACON (478) 405-8301
FAX (478) 405-8210
WWW.AHPENGR.COM

Manley Spangler Smith Architects
A Professional Corporation

525 East Taylor St.
P.O. Box 880
Griffin, Georgia 30224

Office 770.227.5473
Fax 770.228.3442

PROJECT:
HENRY COUNTY SCHOOLS - DISTRIBUTION CENTER

CLIENT:
HENRY COUNTY BOARD OF EDUCATION

SHEET TITLE:
POWER FLOOR PLAN

PROJECT NUMBER:	201827
DATE:	08.13.20
SCALE:	AS SHOWN
DRAWN BY:	SMN
CHECKED BY:	NHO

SHEET NO.: E2.21