

GENERAL NOTES - FIRE ALARM DEMOLITION	
A.	REFER TO DRAWING FAD.01 FOR LEGEND AND SYMBOLS.
B.	CONTRACTOR SHALL MAKE SURE TO MAINTAIN CONTINUITY OF FIRE ALARM DEVICES THAT ARE OUTSIDE AREA OF WORK THAT ARE INTENDED TO REMAIN OPERATIONAL.
C.	MAINTAIN CONTINUITY OF BRANCH CIRCUITRY ASSOCIATED WITH ALL FIRE DEVICES TO REMAIN.
D.	REMOVE ALL WIRING AND CONDUIT ASSOCIATED WITH FIRE ALARM DEVICES BEING REMOVED. RETURN ALL FIRE ALARM DEVICES BEING REMOVED TO OWNER.


ARCHITECTURE
INTERIORS
PLANNING

WTS
WATSON TATE SAVORY

NC STATE
UNIVERSITY



Jordan Hall Library Renovation
Watson Tate Savory
NCSU Jordan Hall

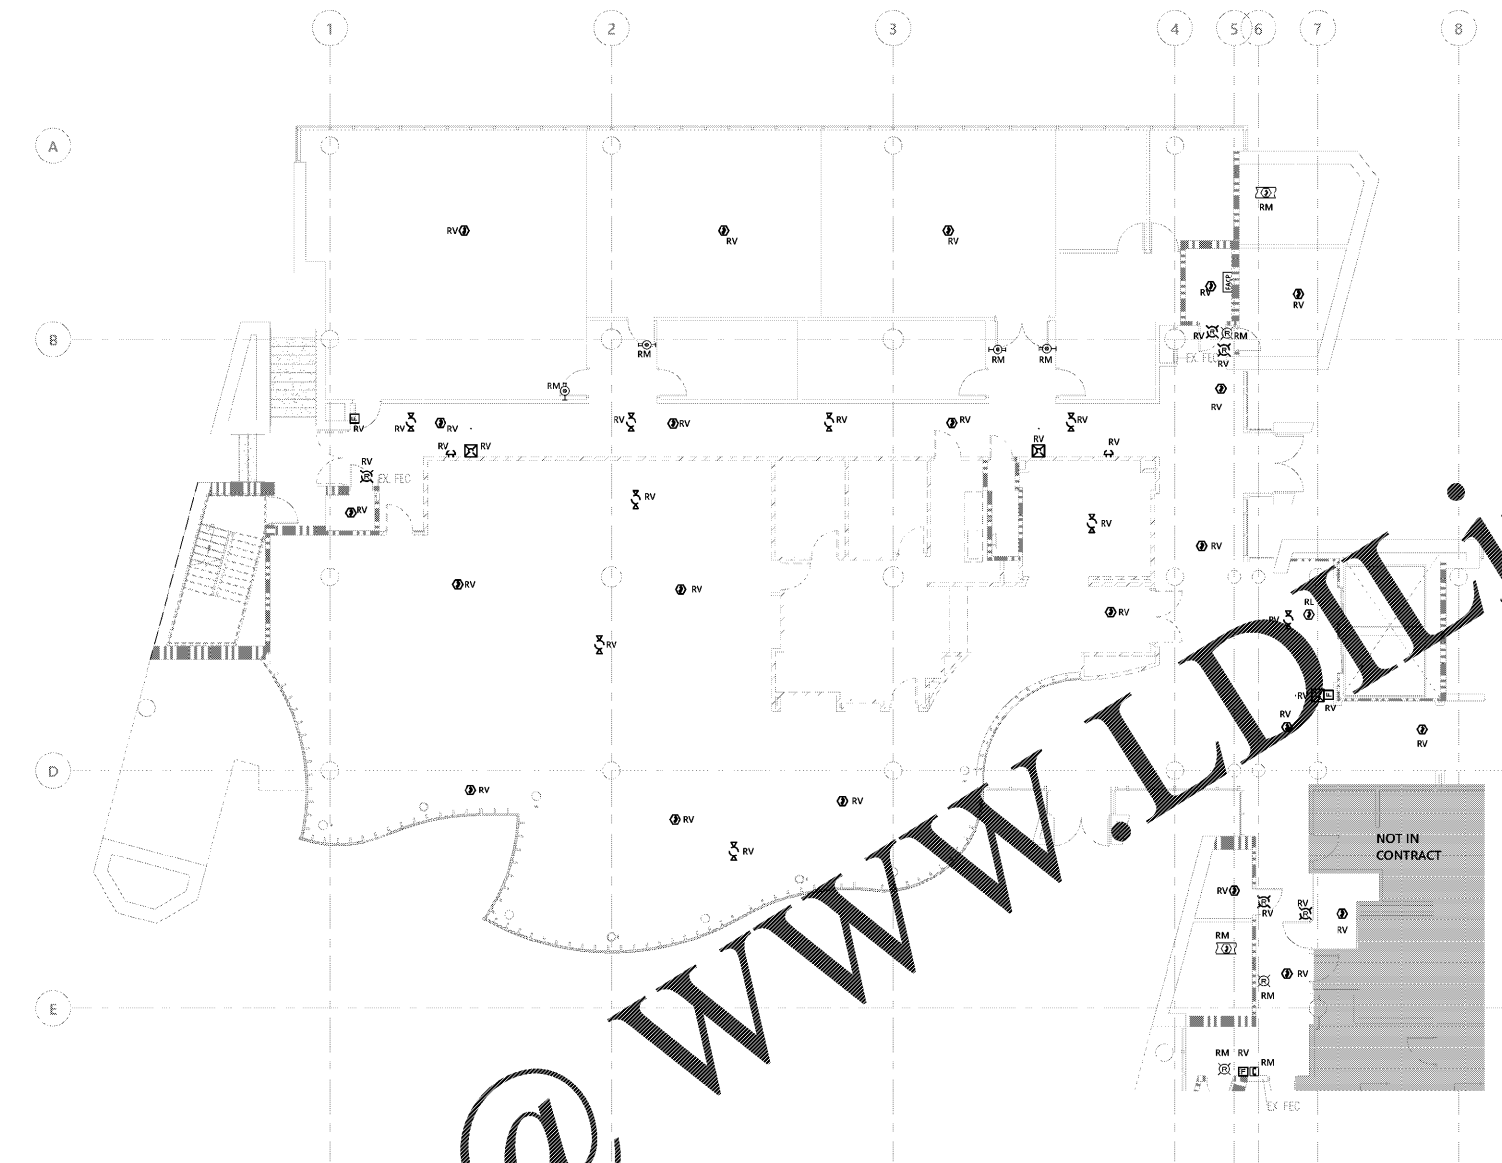

1 LEVEL 01 - DEMOLITION FIRE ALARM FLOOR PLAN
1/8" = 1'-0"


ABBREVIATIONS	
RE	EXISTING ITEM RELOCATED TO THIS LOCATION.
RL	EXISTING ITEM TO BE RELOCATED.
RM	EXISTING ITEM TO REMAIN.
RP	EXISTING ITEM TO BE REPLACED.
RV	EXISTING ITEM TO BE REMOVED.



ISSUE DATE	08/24/2020	
PHASE	Bid Set	
#	DATE	REVISION

DEMOLITION FIRE
ALARM PLAN -
LEVEL 01

19244
A/E PROJECT NO. SHEET
Optima # 19-0360 Sheet 2 of 3



Order Plans @ www.LDILine.com