
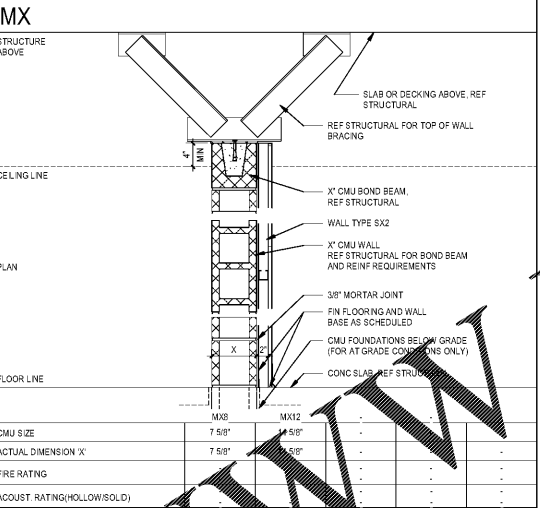
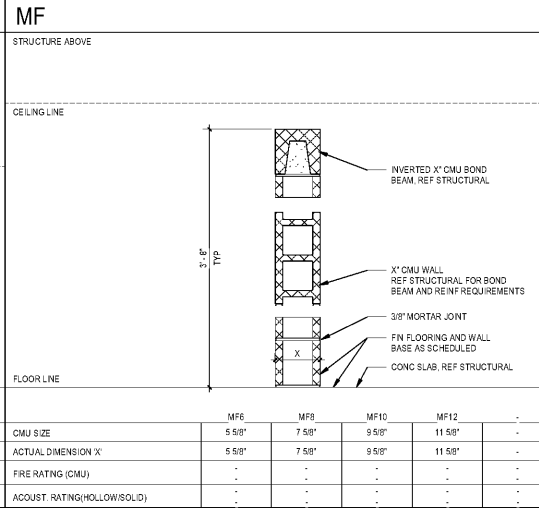


GENERAL PARTITION NOTES

1. PLAN DIMENSIONS ARE FACE OF STUD, CMU OR FINISH FACE OF EXISTING WALL CONSTRUCTION UNLESS SPECIFICALLY NOTED OTHERWISE.
2. GYPSUM WALL BOARD LAYERS ON RATED WALLS SHALL BE CONTINUOUS THROUGH ALL INTERSECTIONS WITH NON-RATED WALLS. REFER TO FIRE WALL PRIORITY DIAGRAM.
3. REFERENCE ALL FLOOR PLANS AND LIFE SAFETY PLANS FOR RATED WALL LOCATIONS AND RATINGS.
4. PROVIDE TYPE X MOLD AND MOISTURE RESISTANT GYPSUM BOARD IN ALL TOILET AND JANITOR ROOMS. *Architect's note: verify with specs & call as required for specific project.
5. PROVIDE CEMENT BOARD IN ALL WET SHOWER AREA WALLS WITH TILE FINISH. *Architect's note: verify with specs & call as required for specific project.
6. PROVIDE IMPACT RESISTANT GYPSUM BOARD UP TO 4'-0" IN ALL LOBBIES, CORRIDORS, & STAIRWELLS. *Architect's note: verify with specs & call as required for specific project.
7. AT ALL UL RATED WALLS THAT EXTEND TO THE STRUCTURE ABOVE, FILL VOIDS SOLID WITH MINERAL WOOL INSULATION WHERE WALL IS FRAMED AROUND BEAMS, BAR JOISTS, SLABS, AND ROOF DECK. MAINTAIN SCHEDULED SOUND RATING. AT ALL SOUND RATED WALLS PROVIDE FLEXIBLE SEALANT OR AN ACOUSTICAL GASKET BETWEEN THE RATED SYSTEM AND ALL DISJUNCTION SURFACES (IE PENETRATIONS) AND ALSO BETWEEN THE SYSTEM AND SIMILAR SURFACES WHERE PERIMETER RELIEF IS REQUIRED. ALL OPENINGS THROUGH THE SYSTEM AND ITS ENTIRE PERIMETER SHALL BE SEALED AIRTIGHT. TYPING GYPSUM BOARD WALL AND WALL-CEILING INTERSECTIONS PROVIDES AN ADEQUATE AIR SEAL AT THESE LOCATIONS.
8. AT ALL JOINTS AT TOP OF ALL FIRE RATED PARTITIONS PROVIDE COMPLETE UL LISTED FIRE RESISTIVE JOINT SYSTEM TO MATCH FIRE RESISTIVE JOINT SYSTEM ASSEMBLY AND THAT IS ALSO COMPATIBLE WITH JOINT SYSTEM WITH COMPLETE JOINT SYSTEM PRODUCT INFORMATION FOR THE CONDITION.
9. PROVIDE CONTINUOUS ICE AND WATER SHIELD BETWEEN UL STUD TRUSS & CONCRETE OR DECK AT TOP AND BOTTOM. UL STUD TRUSS & CONCRETE SPACES EXIST ABOVE (OR BELOW).
10. PROVIDE DEFLECTION TRACK AT TOP OF WALL AND CONNECT TO THE STRUCTURE ABOVE. *Architect's note: verify with specs & call as required for specific project.
11. ANY PORTION OF GYPSUM BOARD THAT SHOWS SIGNIFICANT SIGNS OF MOISTURE DAMAGE, EITHER BEFORE OR AFTER INSTALLATION, IS TO BE REMOVED IMMEDIATELY AND REPLACED WITH NEW DRY GYPSUM BOARD.
12. MANY INTERSECTIONS REQUIRE SUCH AS WALL TILES OR WOOD PANELING. SEE FINISH SCHEDULE FOR DETAIL SHEETS FOR ADDITIONAL INFORMATION.
13. ALL CONCRETE BLOCK (IN FIRE RATED WALLS) MUST BEAR THE UL CLASSIFICATION MARK OR BE EQUIVALENT TESTING DATA.
14. GENERAL CONTRACTOR SHALL VERIFY SPACING AND CAUSE OF INTERIOR STUDS. MINIMUM HEIGHT, MINIMUM DEFLECTION FOR SPECIFIC APPLICATIONS BASED ON MANUFACTURER'S REQUIREMENTS. AT A MINIMUM STUDS SHALL BE 20 GAUGE OR GREATER.
15. GENERAL CONTRACTOR SHALL COORDINATE ROOF DRAIN LINE LOCATIONS WITHIN WALLS AND ATTENUATION BLANKET IS REQUIRED AT ALL INTERIOR PARTITIONS AND SHALL RUN FULL HEIGHT OF PARTITION UNLESS NOTED OTHERWISE. SOUND ATTENUATION BATT SHALL BE MADE OF MINERAL WOOL OR OTHER UL APPROVED MATERIAL.
17. IT IS NOT THE INTENT OF THE DOCUMENTS TO IDENTIFY EACH INDIVIDUAL WALL WITH A WALL TAG. MINOR WALLS OR OTHER WALLS NOT TAGGED WILL BE OF THE SAME WALL TYPE AS ADJACENT WALLS.
18. GENERAL CONTRACTOR IS TO COORDINATE AND PROVIDE ALL REQUIRED BLOCKING WITHIN THE WALLS. THIS INCLUDES BUT IS NOT LIMITED TO ALL MILLWORK, CASEWORK, GRAB BARS, LCD MONITORS, AND TOILET PARTITIONS.
19. GYPSUM BOARD ON WALLS SHALL BE APPLIED WITH A MINIMUM 1/4" GAP BETWEEN THE GYPSUM BOARD AND THE FLOOR AND SHALL NOT BE APPLIED OVER OTHER BUILDING MATERIALS WHERE CONDITIONS EXIST THAT ARE FAVORABLE TO MOLD GROWTH.

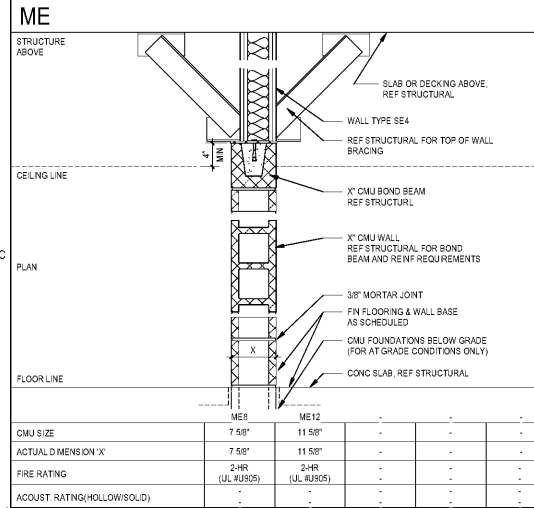

CONTROL JOINT NOTES

CMU:

1. LOCATE CMU CONTROL JOINTS AS FOLLOWS:
 - A. ON ONE SIDE OF ALL WALL OPENINGS SMALLER THAN 6'-0" IN WIDTH (1'-4" FROM ROUGH OPENING)
 - B. ON BOTH SIDES OF ALL WALL OPENINGS LARGER THAN 6'-0" IN WIDTH (1'-4" FROM ROUGH OPENING)
 - C. SO THAT NO SINGLE LENGTH IS GREATER THAN 30'-0"
 - D. NO CLOSER THAN 4'-0" AND NO FARTHER THAN 10'-0" FROM CORNERS.
 - E. WHEREVER ABRUPT CHANGES IN WALL HEIGHTS OR THICKNESS OCCUR.
 - F. ADDITIONAL LOCATIONS WHERE ADVISED BY MASONRY CONTRACTOR.
2. MASONRY CONTRACTOR TO VERIFY LOCATION OF ALL CONTROL JOINTS WITH ARCHITECT PRIOR TO START OF CONSTRUCTION.

GYPSUM BOARD:

1. PROVIDE CONTROL JOINTS IN WIDTH NO GREATER THAN 20'-0" OC, BUT NO LESS THAN 16'-0". INSTALL CONTROL JOINTS ACCORDING TO ASTM C 840 AND IN SPECIFIC LOCATIONS APPROVED BY ARCHITECT FOR VISUAL EFFECT. SUBMIT CONTROL JOINT LOCATION PLAN TO ARCHITECT FOR REVIEW PRIOR TO INSTALLATION.

CMU SIZE	ME8	ME12	-	-	-
ACTUAL DIMENSION 'X'	7'5 1/8"	11'5 1/8"	-	-	-
FIRE RATING	2-HR (UL #R305)	2-HR (UL #R305)	-	-	-
ACOUST. RATING(HOLLOW/SOLID)	-	-	-	-	-

CMU SIZE	MF6	MF8	MF10	MF12	-
ACTUAL DIMENSION 'X'	5'5 1/8"	7'5 1/8"	9'5 1/8"	11'5 1/8"	-
FIRE RATING (CMU)	-	-	-	-	-
ACOUST. RATING(HOLLOW/SOLID)	-	-	-	-	-

CMU SIZE	MX8	MX12	-
ACTUAL DIMENSION 'X'	7'5 1/8"	11'5 1/8"	-
FIRE RATING	-	-	-
ACOUST. RATING(HOLLOW/SOLID)	-	-	-

WALL TAG LEGEND

WALL VARIANT - ALPHABETICALLY SEQUENTIAL

WALL TYPE

- M - MASONRY
- S - STEEL STUD
- W - WOOD STUD
- C - CHASE WALL
- E - SHARP WALL

MEMBER THICKNESS

FURRING	STEEL STUD	WOOD STUD	SHARP WALL	MASONRY
L - UNRATED	1 - 1 1/2" STUD	1 - 1 1/2" WALL	2 - 2 1/2" CH STUD	2" CMU
D - 7/8" HAT	2 - 2 1/2" STUD	3 - 2 x 4" STUD	4 - 4" CH STUD	6 - 6" CMU
1 - 1 1/2" HAT	3 - 3 1/2" STUD	6 - 2 x 6" STUD	6 - 6" CH STUD	8 - 8" CMU
	4 - 4" STUD	4 - 4" STUD	6 - 2 x 6" STUD	
	6 - 6" STUD			
	8 - 8" STUD			

WALL FRAMING PRIORITY

PARTITIONS SHALL BE PRIORITIZED BASED ON FIRE AND SMOKE RATING. PARTITIONS SHALL BE CONSTRUCTED SUCH THAT HIGHER PRIORITY IS FRAMED BEFORE LOWER PRIORITY. LOWER PRIORITY PARTITIONS SHALL BE FRAMED TIGHT TO, BUT NOT INTERRUPT HIGHER PRIORITY CONSTRUCTION (SEE THE EXAMPLES BELOW).

2 HOUR FIRE RATED WITH SMOKE BARRIER	PRIORITY 1 (HIGHEST)
2 HOUR FIRE RATED	PRIORITY 2
1 HOUR FIRE RATED WITH SMOKE BARRIER	PRIORITY 3
1 HOUR FIRE RATED	PRIORITY 4
NONE RATED	PRIORITY 5 (LOWEST)

SHEET ISSUE	NO.	DATE	DESCRIPTION	BY
D	04/10/2020	PERMIT SET		
E	07/02/2020	ISSUED FOR BIDS		

ISSUED FOR BIDS	07/02/2020
PRINCIPAL IN CHARGE	DRM
PROJECT ARCHITECT	TA
DRAWN BY	JTP

SHEET TITLE
PARTITION TYPES - CMU

SHEET NO.	PROJECT NO.
A003	018477.01

CMU SIZE	ME8	ME12	-	-	-
ACTUAL DIMENSION 'X'	7'5 1/8"	11'5 1/8"	-	-	-
FIRE RATING	2-HR (UL #R305)	2-HR (UL #R305)	-	-	-
ACOUST. RATING(HOLLOW/SOLID)	-	-	-	-	-

CMU SIZE	MF6	MF8	MF10	MF12	-
ACTUAL DIMENSION 'X'	5'5 1/8"	7'5 1/8"	9'5 1/8"	11'5 1/8"	-
FIRE RATING (CMU)	-	-	-	-	-
ACOUST. RATING(HOLLOW/SOLID)	-	-	-	-	-

CMU SIZE	MX8	MX12	-
ACTUAL DIMENSION 'X'	7'5 1/8"	11'5 1/8"	-
FIRE RATING	-	-	-
ACOUST. RATING(HOLLOW/SOLID)	-	-	-

CMU
1. LOCATE CMU CONTROL JOINTS AS FOLLOWS: <ul style="list-style-type: none"> A. ON ONE SIDE OF ALL WALL OPENINGS SMALLER THAN 6'-0" IN WIDTH (1'-4" FROM ROUGH OPENING) B. ON BOTH SIDES OF ALL WALL OPENINGS LARGER THAN 6'-0" IN WIDTH (1'-4" FROM ROUGH OPENING) C. SO THAT NO SINGLE LENGTH IS GREATER THAN 30'-0" D. NO CLOSER THAN 4'-0" AND NO FARTHER THAN 10'-0" FROM CORNERS. E. WHEREVER ABRUPT CHANGES IN WALL HEIGHTS OR THICKNESS OCCUR. F. ADDITIONAL LOCATIONS WHERE ADVISED BY MASONRY CONTRACTOR.
2. MASONRY CONTRACTOR TO VERIFY LOCATION OF ALL CONTROL JOINTS WITH ARCHITECT PRIOR TO START OF CONSTRUCTION.

CMU SIZE	ME8	ME12	-	-	-
ACTUAL DIMENSION 'X'	7'5 1/8"	11'5 1/8"	-	-	-
FIRE RATING	2-HR (UL #R305)	2-HR (UL #R305)	-	-	-
ACOUST. RATING(HOLLOW/SOLID)	-	-	-	-	-

CMU SIZE	MF6	MF8	MF10	MF12	-
ACTUAL DIMENSION 'X'	5'5 1/8"	7'5 1/8"	9'5 1/8"	11'5 1/8"	-
FIRE RATING (CMU)	-	-	-	-	-
ACOUST. RATING(HOLLOW/SOLID)	-	-	-	-	-

CMU SIZE	MX8	MX12	-
ACTUAL DIMENSION 'X'	7'5 1/8"	11'5 1/8"	-
FIRE RATING	-	-	-
ACOUST. RATING(HOLLOW/SOLID)	-	-	-

CMU
1. LOCATE CMU CONTROL JOINTS AS FOLLOWS: <ul style="list-style-type: none"> A. ON ONE SIDE OF ALL WALL OPENINGS SMALLER THAN 6'-0" IN WIDTH (1'-4" FROM ROUGH OPENING) B. ON BOTH SIDES OF ALL WALL OPENINGS LARGER THAN 6'-0" IN WIDTH (1'-4" FROM ROUGH OPENING) C. SO THAT NO SINGLE LENGTH IS GREATER THAN 30'-0" D. NO CLOSER THAN 4'-0" AND NO FARTHER THAN 10'-0" FROM CORNERS. E. WHEREVER ABRUPT CHANGES IN WALL HEIGHTS OR THICKNESS OCCUR. F. ADDITIONAL LOCATIONS WHERE ADVISED BY MASONRY CONTRACTOR.
2. MASONRY CONTRACTOR TO VERIFY LOCATION OF ALL CONTROL JOINTS WITH ARCHITECT PRIOR TO START OF CONSTRUCTION.


Order Plans @ WWW.LDILine.com

WWW.LDILine.com

WWW.LDILine.com

WWW.LDILine.com

WWW.LDILine.com

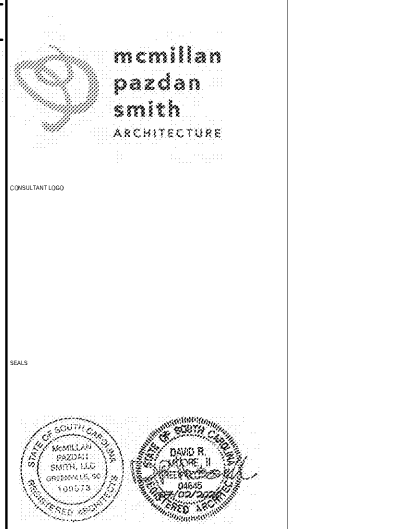

AIKEN COUNTY
 AIKEN PUBLIC LIBRARY & NORTH WING
 RENOVATION
 314 CHESTERFIELD ST. S. AIKEN, SC

ISSUED FOR BIDS 07/02/2020
 PRINCIPAL IN CHARGE DRM
 PROJECT ARCHITECT TA
 DRAWN BY JTP
 SHEET TITLE: PARTITION TYPES - CMU
 SHEET NO. PROJECT NO. 018477.01
 A003