DESIGN No. UL 301
June 13, 2017
LOAD BEARING 2 HR.

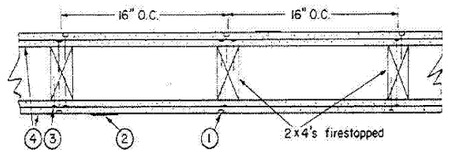

1. Nail heads — Exposed or covered with joint compound.
2. Joints — Exposed joints covered with joint compound and paper tape. Joint compound and paper tape may be omitted when square edge boards are used. As an alternate, nom 3/32 in. thick gypsum veneer plaster may be applied to the entire surface of classified veneer baseboard with the joints reinforced with paper tape.

3. Nails — 6d cement coated nails 1-7/8 in. long, 0.0915 in. shank diam, 1/4 in. diam heads, and 8d cement coated nails 2-3/8 in. long, 0.113 in. shank diam, 9/32 in. diam heads.

4. Gypsum Board* — 5/8 in. thick, two layers applied either horizontally or vertically. Inner layer attached to studs with the 1-7/8 in. nails spaced 6 in. OC. Outer layer attached to studs over inner layer with the 2-3/8 in. long nails spaced 8 in. OC. Vertical joints located over studs. All joints in face layers staggered with joints in base layers. Joints of each base layer offset with joints of base layer on opposite side. When used in walls other than 45 hr., gypsum board to be installed horizontally.

ACADIA DRYWALL SUPPLIES LTD — Type X, 5/8 Type X Moisture Resistant Type X, Gypsum Sheathing Type X, Mold 4 Mildew Resistant Type X and Mold 4 Mildew Resistant AR Type X, Type Bluglass Exterior Sheathing
AMERICAN GYPSUM CO — Types AGX-1, M-Glass, AG-C, AGX-1I
BEIJING NEW BUILDING MATERIALS PUBLIC LTD CO — Type DEX-1
CERTAINTEED GYPSUM NC — Types 1, FRPC, BGRG, GlasRoc, Type C, Type X, Type X-1
CGC INC — Types AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, ULIX, USGX, XRC, XRX
CONTINENTAL BUILDING PRODUCTS OPERATING CO, L L C — Types LGFCGA, LGFCGA, LGFC-G/A, LGFC-WD, LGLLX
GEORGIA PACIFIC GYPSUM L L C — Types 5, 6, 9, C, DAR, DD, DA, DARS, DGG, DS, GPFBS, LB, TG-C, Type X, Veneer Plaster Base-Type X, Xeter Rated-Type X, Sheathing Type-X, BdFit-Type X, GreenGlass Type X, Type LNX, Veneer Plaster Base-Type LNX, Xeter Rated-Type LNX, Sheathing Type-LNX, BdFit-Type LNX, Type DGLN, Xeter Rated-Type DGLN, Sheathing Type- DGLN, BdFit-Type DGLN, Type LNDX, Veneer Plaster Base - Type LNDX, Xeter Rated - Type LNDX, Sheathing - Type LNDX, BdFit - Type LNDX, Type DGLDX, Xeter Rated - Type DGLDX, Sheathing - Type DGLDX
NATIONAL GYPSUM CO — Types EHPC, FSK, FSK-C, FSK-G, FSK, FSK-G, FSK-C, FSK-G, FSK-C, FSK-G, FSK-C, FSK
PABCO BUILDING PRODUCTS, L L C, DBA PABCO GYPSUM — Types C, PS-2, PS-3, PS-3A, PS-4, PS-5, PS-5A, PS-5AR, PS-6, PS-11, PS-C or PS6-XRS
PANEL REY S A — Types PRG, PRGC, PRX, PRX, HDX, ETX, GREX
SAM GYPSUM INDUSTRY (BARABURI) CO LTD — Type EX-1
THAI GYPSUM PRODUCTS PCL — Type C or Type X
UNITED STATES GYPSUM CO — Types AR, C, FRX-G, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, ULIX, ULSX, USGX, XRC, XRX
USG BORAL ZAMAN DRYWALL L L C SPZ — Types C, SCX
USG MEXICO S A DE C V — Types AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, ULIX, USGX, XRC, XRX

4A-4G ALTERNATES - SEE FULL UL A600-EELY DETAILS

5. Molded Plastic* — Not Shown. Optional — Solid vinyl siding mechanically secured over the outer layer to framing members in accordance with manufacturer's recommended installation details.
ALSIDE, DIV OF ABBOGATED MATERIALS INC
GENTEK BUILDING PRODUCTS LTD
VYTEC CORP

6. Steel Framing Members - Optional, refer to UL for details.
7. Furring channels - optional, refer to UL for details

8. Batts and Blankets* — Required for use with resilient channels, item 7, min. 3 in. thick mineral wool batts, placed to Fill Interior of wall, attached to the nom 4 in. face of the studs with staples placed 24 in. OC.
OWENS CORNING — Type SAFB
THERMAFIBER, INC — Type SAFB

9. Batts and Blankets* — (As an alternate to item 8) — Min. 3 in. thick, glass Fiber batts bearing the UL Classification Marking as to Surface Burning and/or Fire Resistance, friction-fitted to Fill the stud cavities. See Batts and Blankets (BKNV or BIZ_Z) Categories for names of Classified companies.
9A. Fiber, Sprayed* — (Optional) — As an alternate to Batts and Blankets (Item 8). Required for use with resilient channels, item 7, Not for use with item 6, or 6A. — Spray applied mineral wool insulation. The fiber is applied with adhesive, at a minimum density of 4.0 pcf, to completely Fill the enclosed cavity in accordance with the application instructions supplied with the product. See Fiber, Sprayed (CSAZ).
AMERICAN ROCKWOOL MANUFACTURING, LLC — Type Rockwool Premium Plus

10. Wall and Partition Facings and Accessories* — (Optional, Not Shown) — Nominal 1/2 in. thick, 4 ft wide panels, for optional use as an additional layer on one or both sides of the assembly. Panels attached in accordance with manufacturer's recommendations. When the GR-500 or GR-510 panel is installed between the wood framing and the UL Classified gypsum board, the required UL Classified gypsum board layer(s) is/are to be installed as indicated as to fastener type and spacing, except that the required fastener length shall be increased by a minimum of 1/2 in. Not evaluated or intended as a substitute for the required layer(s) of UL Classified Gypsum Board.
PABCO BUILDING PRODUCTS, L L C, DBA PABCO GYPSUM — Type GuleRock GR-500 or GR-510

11. Cementitious Backer Units* — (Optional Item Not Shown — For use On Face of 2 hr Systems With All Standard Items Required) — 7/16 in., 1/2 in., 5/8 in., 3/4 in. or 1 in. thick, min. 32 in. wide. Applied vertically with vertical joints centered over studs. Face layer fastened over gypsum board to studs and runners with cement board screws of adequate length to penetrate stud by a minimum of 3/8 in. For steel framing members, and a minimum of 3/4 in. For wood framing members spaced a max of 8 in. OC.
NATIONAL GYPSUM CO — Type DuraBacker, PermaBase, DuraBacker Plus, or PermaBase Plus

12. Wall and Partition Facings and Accessories* — (Optional, Not Shown) - When the Wall Assembly is used as an External Wall, on the External side of the wall one of the following Wall and Partition and Facing Accessories may be used, refer to Items (A) to (G) below.
A. Non insulated system with metal channels — Install moisture barrier over the Gypsum Board Item 4 and install Acry Metal Channels vertically at a horizontal spacing not greater than 24 inches OC, over the moisture barrier. Acry Metal Channels attached through the moisture barrier and the Gypsum Board to the Wood Studs using fasteners specified by the manufacturer and fasteners spaced max. 24 in. OC. Install Acrylec Panels on Acry Metal Channels using 1-1/4" long corrosion coated stainless steel screws spaced at a max spacing of 24 inches OC, along with manufacturer's approved adhesive (SH 940 or Tremco Vulcum 116) Adhesive to be applied in a zigzag pattern along every channel. Joint treatment in between panels shall be Tremco Ilmad 600 pre compressed polyurethane foam sealant.
B. Insulated system with metal channels — Install moisture barrier over the Gypsum Board Item 4. Install galvanized Z girt channels specified by the manufacturer over the moisture barrier and the Gypsum Board Item 4. Z girt channels to be installed horizontally, at a max. spacing of 24" OC. Z girt channels attached through the Gypsum Board and the moisture barrier to the wood studs with screws provided by the manufacturer at a max spacing of 24 inches OC. Install mineral wool insulation between the Z girts. Maximum thickness of mineral wool insulation not to exceed 6 in. As per manufacturer's instructions Install Acry Metal Channels vertically over the Z girts at a max horizontal spacing of 24 in. OC. Acrylec Panels installed on Acry channel with 1-1/4" long corrosion coated stainless steel screws at a max spacing of 24 in. OC, along with manufacturer's approved adhesive (SH 940 or Tremco Vulcum 116). Adhesive to be applied in a zigzag pattern along every channel. Joint treatment in between panels to be Tremco Ilmad 600 pre compressed polyurethane foam sealant.
C. Non insulated wood strapping system — Install moisture barrier over the Gypsum Board Item 4 and install 1" x 3" wood strapping vertically at a horizontal spacing not greater than 24 inches OC, over the moisture barrier. 1" x 3" wood strapping attached through the moisture barrier and the Gypsum Board to the Wood Studs using Fasteners specified by the manufacturer and Fasteners spaced max. 24 in. OC. Acrylec Panels to be installed on the 1" x 3" wood strapping using manufacturers approved stainless steel Fasteners spaced at maximum 24 inches OC along with Tremco Vulcum 116 adhesive applied in a zigzag pattern along every wood strap. Joint treatment in between panels to be Tremco Ilmad 600 pre compressed polyurethane foam sealant.
D. Insulated Wood Strapping System — Install moisture barrier over the Gypsum Board Item 4. Install Extruded Polystyrene insulation over moisture barrier and the Gypsum Board Item 4, max thickness of insulation not to exceed 4 inches. Install 1" x 3" wood strapping vertically at a horizontal spacing not greater than 24 inches OC. Wood strapping attached through the insulation, the Gypsum Board and moisture barrier to the Wood Studs using fasteners specified by the manufacturer and Fasteners spaced max. 24 in. OC. Acrylec Panels to be installed over the wood strapping using manufacturers approved stainless steel Fasteners at a max spacing of 24 in. OC and Tremco Vulcum 116 adhesive applied in a zigzag pattern along every wood strap. Joint treatment in between panels to be Tremco Ilmad 600 pre compressed polyurethane foam sealant.
AGRITEC PANEL INDUSTRIES — Nominal 5/8 inch thick Acrylec Panel.

13. Foamed Plastic* — (Optional - For use with Item 4G) — Spray applied, foamed plastic insulation, at any thickness from partial Fill to completely Filling stud cavity.
EBS FOAM INC — EBS 2 lb. Spray Foam and Eucraseal 0.5 lb. Spray Foam. For use in Bearing and Non-Load Bearing Walls.

TYPE F - STAGGERED EXTERIOR (TOWNHOUSE)

SCALE: 12" = 1'-0"

GA FILE NO. WP 3620
LOAD BEARING WALL
STC Ratings - 53 to 54 STC

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3820	GENERIC	1 HOUR FIRE	55 to 59 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

Base layer: ⅝" type X gypsum wallboard or gypsum veneer base applied at right angles to each side of double row of 2 x 4 wood studs 16" o.c. on separate plates 1" apart with 6d coated nails, 1⅞" long, 0.0915" shank, ¼" heads, 24" o.c. **Face** layer: ⅝" type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 8d coated nails, 2⅜" long, 0.120" shank, ¼" heads, 8" o.c.

Joints staggered 16" each layer and side. Tested without insulation. ⅝" glass fiber insulation stapled to studs in stud spaces on one side through nail holes in base layer. Tested for 1 hr. Horizontal bracing required at mid-height. (LOAD BEARING)

Thickness: 10¾"
Approx. Weight: 13 psf
Fire Test: See WP 4135 (FM WP 360, 9-27-74); UL R4024, 10-31-68
Sound Test: NGC 3696, 4-7-70

ADDITION OF WOOD STRUCTURAL PANEL ALLOWABLE PER THE GYPSUM ASSOCIATION FIRE RESISTANCE DESIGN MANUAL, SECTION 1 ITEM 22. When not specified as a component of a fire-resistance rated wall or partition system, wood structural panels shall be permitted to be added to one or both sides. Such panels shall be permitted to be applied either as a base layer directly to the framing (under the gypsum board), as a face layer (over the face layer of gypsum board), or between layers of gypsum board in multi-layer systems. When such panels are applied under the gypsum board or between layers of gypsum board the length of the fasteners specified for the attachment of the gypsum board applied over the wood structural panels shall be increased by not less than the thickness of the wood structural panels. Fastener spacing for the gypsum board and the number of layers of gypsum board shall be as specified in the system description.

AND ANY ADDITIONAL GYPSUM (Ie MOISTURE OR MOLD RESISTANT GYPSUM) ALLOWABLE PER ITEM 22. Additional layers of type X or regular gypsum panels shall be permitted to be added to any system

TYPE D - DEMISING (TOWNHOUSE)

SCALE: 12" = 1'-0"

DESIGN No. U341
July 14, 2016
Bearing Wall Rating - 1 HR.
Finish Rating - Min. 20 minutes

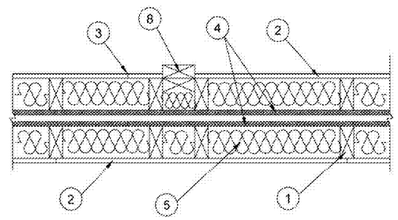

1. Wood Studs — Nom 2 by 4 in., spaced 24 in. OC max. Cross braced at mid-height and effectively Firestopped at top and bottom of wall. No min. air space between stud rows except to accommodate attachment of sheathing, where required. See Items 4 and 5.

2. Gypsum Board* — Any 5/8 in. thick UL Classified Gypsum Board that is eligible for use in Design Nos. U301, U312 or U305. Nom 5/8 in. thick 4 ft. wide, Gypsum board or ceiling applied horizontally or vertically, unless specified below, and nailed to studs and bearing plates 7 in. OC with 6d cement coated nails, 1-7/8 in. long, 0.0915 in. shank diam and 1/4 in. diam head. As an alternate, No. 6 bugle head drywall screw, 1-7/8 in. long, may be substituted for the 6d cement coated nails.

When Steel Framing Members* (Item 6-6B) are used, wallboard attached to furring channels with 1 in. long Type S bugle-head steel screws spaced 12 in. OC.
When used in walls other than 45 hr., gypsum board to be installed horizontally.
ACADIA DRYWALL SUPPLIES LTD (View Classification) — CNNXR25870
AMERICAN GYPSUM CO (View Classification) — CNNXR14786
BEIJING NEW BUILDING MATERIALS PUBLIC LTD CO (View Classification) — CNNXR19314
CERTAINTEED GYPSUM NC (View Classification) — CNNXR3660
CGC INC (View Classification) — CNNXR19151
CONTINENTAL BUILDING PRODUCTS OPERATING CO, L L C (View Classification) — CNNXR18462
GEORGIA-PACIFIC GYPSUM L L C (View Classification) — CNNXR2171
LOADMASTER SYSTEMS INC (View Classification) — CNNXR10091
NATIONAL GYPSUM CO (View Classification) — CNNXR3501
PABCO BUILDING PRODUCTS, L L C, DBA PABCO GYPSUM (View Classification) — CNNXR17094
PANEL REY S A (View Classification) — CNNXR21786
SIAM GYPSUM INDUSTRY (BARABURI) CO LTD (View Classification) — CNNXR19262
THAI GYPSUM PRODUCTS PCL (View Classification) — CNNXR23977
UNITED STATES GYPSUM CO (View Classification) — CNNXR1319
USG BORAL ZAMAN DRYWALL L L C SPZ (View Classification) — CNNXR36436
USG MEXICO S A DE C V (View Classification) — CNNXR16084

2A. Gypsum Board* — (As an alternate to Item 2, not shown) — Nominal 5/8 in. thick, 4 ft wide panels, applied vertically to studs and bearing plates on one side of the assembly with 1-5/8 in. long Type S screws spaced 12 in. OC at perimeter of panels and 24 in. OC in the Field. Horizontal joints of vertically applied panels need not be backed by studs. Panel joints covered with paper tape and two layers of joint compound. Screwheads covered with two layers of joint compound. Batts and Blankets placed in stud cavity as described in Item 8C. Not evaluated For use with Steel Framing Members, Furring Channels or Fiber, Sprayed.
PABCO BUILDING PRODUCTS L L C, DBA PABCO GYPSUM — Type GuleRock GR-5810 (Finish rating 15 min).

2B. Gypsum Board* — (As an alternate to Item 2, not shown) — Any 5/8 in. thick gypsum panels that are eligible for use in Design Nos. U301, U312 or U305, supplied by the Classified companies listed below shown in the Gypsum Board* (CKNX) category. Applied horizontally or vertically and attached to studs and bearing plates with 1-1/4 in. long Type N coarse threaded gypsum panel steel screws spaced a max 8 in. OC, with last screw 1 in. from edge of board. When used in walls other than 45 hr., gypsum board to be installed horizontally.
UNITED STATES GYPSUM CO
USG MEXICO S A DE C V

2C. Gypsum Board* — (As an alternate to Item 2, Not Shown) — 5/8 in. thick gypsum panels, applied horizontally or vertically and attached to studs and bearing plates with 1-1/4 in. long Type N coarse threaded gypsum panel steel screws spaced a max 8 in. OC, with last screw 1 in. from edge of board. When used in walls other than 45 hr., gypsum board to be installed horizontally.
AMERICAN GYPSUM CO — Types AGX-1, AG-C, AGX-1I
CERTAINTEED GYPSUM NC — Type GP-Lite, Type X
THAI GYPSUM PRODUCTS PCL — Type C or Type X

2D. Gypsum Board* — (As an alternate to Items 2 through 2G) — 5/8 in. thick gypsum panels, with square edges, applied either horizontally or vertically. Gypsum panels fastened to framing with 1-1/4 in. long Type W drywall steel screws spaced a max 8 in. OC, with last screw 1 in. from edge of board and 4 in. from edge of board or nailed as described in Item 2. When used in walls other than 45 hr., gypsum board to be installed horizontally.
GEORGIA-PACIFIC GYPSUM L L C — Greenglass Type X, Type DGG.

2E. Gypsum Board* — (As an alternate to Items 2 through 2D) — 5/8 in. thick, 4 ft. wide, paper surfaced applied vertically only and fastened to the studs and plates with 6d cement coated nails 1-7/8 in. long, 0.0915 in. shank diam and 1/4 in. diam heads, 7 in. OC. Not for use with Item 4B.
GEORGIA-PACIFIC GYPSUM L L C — Type X ComfortGuard Sound Deadening Gypsum Board.

2F. Gypsum Board* — (As an alternate to Items 2 through 2E) — Installed as described in Item 2, 5/8 in. thick, 4 ft. wide, paper surfaced, applied vertically only and fastened to the studs and plates with 6d cement coated nails 1-7/8 in. long, 0.0915 in. shank diam and 1/4 in. diam heads, 7 in. OC. Not for use with Item 4B.
NATIONAL GYPSUM CO — SoundBreak XP Type X Gypsum Board

2G. Gypsum Board* — (As an alternate to Items 2 through 2F) — Nominal 5/8 in. thick, 4 ft wide panels, applied vertically and secured as described in Item 2.
PABCO BUILDING PRODUCTS L L C, DBA PABCO GYPSUM — Types GuleRock ES.

2H. Gypsum Board* — (As an alternate to Items 2 through 2G) — Installed as described in Item 2, 5/8 in. thick, 4 ft. wide, paper surfaced, applied vertically only and fastened to the studs and plates with 6d cement coated nails 1-7/8 in. long, 0.0915 in. shank diam and 1/4 in. diam heads, 7 in. OC. Not for use with Item 4B.
CERTAINTEED GYPSUM NC — SoundBreak XP

2I. Gypsum Board* — (As an alternate to Items 2 through 2H) — Nominal 5/8 in. thick, 4 ft wide panels, applied vertically and secured as described in Item 2.
PABCO BUILDING PRODUCTS L L C, DBA PABCO GYPSUM — Type GuleRock 5121.

2J. Gypsum Board* — (As an alternate to 5/8 in. Type FBN in Item 2) — 2 layers nom. 5/16 in. thick gypsum panels applied vertically or horizontally. Horizontal joints on the same side need not be staggered. Inner layer attached with fasteners, as described in Item 2, spaced 24 in. OC. Outer layer attached per Item 2.
NATIONAL GYPSUM CO — Type FSN

2K. Gypsum Board* — (As an alternate to Item 2) — 5/8 in. thick gypsum panels, with beveled, square, or tapered edges, applied either horizontally or vertically. Gypsum panels fastened to framing with 1-1/4 in. long Type N coarse threaded gypsum panel steel screws spaced a maximum 10 in. OC with the last two screws 4 and 1 in. from the edges of the board. When used in walls other than 45 hr., gypsum panels are to be installed horizontally.
CONTINENTAL BUILDING PRODUCTS OPERATING CO, L L C — Type LGFCGA (Finish rating 21 min), Type LGFC2A, Type LGFC-C/A, Type LGFC-WD, Type LGLLX

3. Joints and Nailheads — Gypsum board joints of outer layer covered with tape and joint compound. Nail heads of outer layer covered with joint compound. As an alternate, nom 3/32 in. thick gypsum veneer plaster may be applied to the entire surface of Classified veneer baseboard with joints reinforced with paper tape.

4. Sheathing — (Optional) — Gypsum may be sheathed with min 7/16 in. thick wood structural panels min grade 'C' or 'Sheathing' or min 1/2 in. thick Mineral and Fiber Boards*.

See Mineral and Fiber Boards (CERZ) category for names of Classified companies.

5. Batts and Blankets* — 3-1/2 in. nom thickness glass or mineral Fiber batt insulation. Optional when sheathing (Item 4) is used on both faces of wall.
See Batts and Blankets (BKZJZ) category for list of Classified companies.

5A. Fiber, Sprayed* — As an alternate to Batts and Blankets (Item 5) — Spray applied cellulose material. The Fiber is applied with water to completely Fill the enclosed cavity in accordance with the application instructions supplied with the product with a nominal dry density of 2.1 lb per cu. ft. As an alternate to the wet application method. The Fiber is applied without water or adhesive at a nominal dry density of 3.5 lb per cu. ft. in accordance with the application instructions supplied with the product.
U S GREENFIBER L L C — N8735, N8745 for use with Wall cavity application, N8515LD, N8515LD, N8541LD, N8735, N8745, N8765LD, and N8775 are for use in Ceiling application only.

5B. Fiber, Sprayed* — As an alternate to Batts and Blankets (Item 5) and Item 5A when Sheathing (Item 4) is used on both faces of wall — Spray applied cellulose insulation material. The Fiber is applied with water to interior surfaces in accordance with the application instructions supplied with the product. Applied to completely Fill the enclosed cavity. Minimum dry density of 4.3 pounds per cubic Ft.
NU-WOOL CO INC — Close Insulation

5C. Batts and Blankets* — Required for use with Wall and Partition Facings and Accessories, Item 2A. Use of Batts and Blankets, Item 5C, to Fulfill requirement of Item 5C for use with Item 2A) — Glass Fiber insulation, nom 3-1/2 in. thick, min. density of 0.6 pcf, with a Flame spread of 25 or less and a smoke developed of 50 or less, friction-fitted to completely Fill the stud cavities. See Batts and Blankets Category (BKNV) for names of manufacturers.

5D. Fiber, Sprayed* — As an alternate to Batts and Blankets (Item 5) and Item 5A when Sheathing (Item 4) is used on both faces of wall — Spray applied cellulose Fiber. The Fiber is applied with water to completely Fill the enclosed cavity in accordance with the application instructions supplied with the product. The minimum dry density shall be 4.30 pcf.
INTERNATIONAL CELLULOSE CORP — Celser-IRL

6. Steel Framing Members* — (Optional, Not Shown) — Furring channels and Steel Framing Members as described below:

A. Furring Channels — Formed of No. 25 MSG galv steel, 2-9/16 in. or 2-23/32 in. wide by 7/8 in. deep, spaced 24 in. OC perpendicular to stude. Channels secured to studs as described in item b. Ends of adjoining channels are overlapped 6 in. and tied together with double strand of No. 18 BWG galv steel wire near each end of overlap. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping No framing screws, min. 7/16 in. long at the midpoints of the overlap, with one screw on each flange of the channel. Wallboard attached to furring channels as described in Item 2.
B. Steel Framing Members* — Used to attach furring channels (Item a) to studs (Item 1) . Clips spaced 48 in. OC. and secured to studs with No. 8 x 2-1/2 in. coarse drywall screw through the center grommet. Furring channels are Friction Fitted into clips. RSIC-1 clip for use with 2-9/16 in. wide furring channels. RSIC-1 (2.75) clip for use with 2-23/32 in. wide furring channels.
PAC INTERNATIONAL L L C — Types RSIC-1, RSIC-1 (2.75).

6A. Steel Framing Members* — (Optional, Not Shown) — Furring channels and Steel Framing Members as described below:
a. Furring Channels — Formed of No. 25 MSG galv steel, 2-5/8 in. wide by 7/8 in. deep, spaced 24 in. OC perpendicular to studs. Channels secured to studs as described in item b. Ends of adjoining channels are overlapped 6 in. and tied together with double strand of No. 18 BWG galv steel wire near each end of overlap. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping No framing screws, min. 7/16 in. long at the midpoints of the overlap, with one screw on each flange of the channel. Wallboard attached to furring channels as described in Item 2.
b. Steel Framing Members* — Used to attach furring channels (Item a) to studs. Clips spaced 48 in. OC. Gerle clips secured to studs with No. 8 x 1-1/2 in. coarse drywall screw through the center hole. Furring channels are friction fitted into clips.
RUTTER INC — Type Gerle Clip

6B. Steel Framing Members* — (Optional, Not Shown) — Furring channels and Steel Framing Members as described below:
a. Furring Channels — Formed of No. 25 MSG galv steel. Spaced 24 in. OC perpendicular to studs. Channels secured to studs as described in item b. Ends of adjoining channels overlapped 6 in. and secured together with four self-tapping No. 8x1/2 Self Drilling screws (2 per side 1 in. and 4 in. from overlap edge). Gypsum board attached to furring channels as described in Item 2. Side joint furring channels shall be attached to studs with RESILIMOUNT Sound Isolation Clips - Type A22R located approximately 2 in. from each end of length of channel. Both Gypsum Boards at side joints fastened into channel with screws spaced 6 in. OC, approximately 1/2 in. from joint edge.

b. Steel Framing Members* — Used to attach furring channels (Item 6Ba) to studs. Clips spaced 24 in. OC., and secured to studs with No. 10 x 2-1/2 in. coarse drywall screw through the center hole. Furring channels are friction fitted into clips.
STUDIO BUILDING SYSTEMS — RESILIMOUNT Sound Isolation Clips - Type A22R

7. Wall and Partition Facings and Accessories* — (Optional, Not shown) — Nominal 1/2 in. thick, 4 ft wide panels, for optional use as an additional layer on one or both sides of the assembly. Panels attached in accordance with manufacturer's recommendations. When the GR-500 or GR-510 panel is installed between the wood framing and the UL Classified gypsum board, the required UL Classified gypsum board layer(s) is/are to be installed as indicated as to fastener type and spacing, except that the required fastener length shall be increased by a minimum of 1/2 in. Not evaluated or intended as a substitute for the required layer(s) of UL Classified Gypsum Board.
PABCO BUILDING PRODUCTS, L L C, DBA PABCO GYPSUM — Type GuleRock GR-500 and GR-510

8. Non-Bearing Wall Partition Intersection — (Optional) — Two nominal 2 by 4 in. stud or nominal 2 by 6 in. stud nailed together with two 8in. long 10d nails spaced a max. 16 in. OC. vertically and fastened to one side of the minimum 2 by 4 in. stud with 3 in. long 10d nails spaced a max 16 in. OC. vertically. Intersection between partition wood studs to be Flush with the 2 by 4 in. studs. The wall partition wood studs are to be framed by with a second 2 by 4 in. wood stud fastened with 3 in. long 10d nails spaced a max. 16 in. OC. vertically. Maximum one non-bearing wall partition intersection per stud cavity. Non-bearing wall partition stud depth shall be at a minimum equal to the depth of the bearing wall.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The guide information, Assemblies, Constructions, Designs, Systems, and/or Certifications (Files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2016 UL LLC".

TYPE C - DEMISING (GARDENS)

SCALE: 12" = 1'-0"

Order Plans @ LRK-DLine.com

LRK
Looney Ricks Kiss
Architecture Planning Interiors Research
50 South B.B. King Boulevard
Memphis, Tennessee 38103
Telephone 901 521 1440
Fax 901 525 2760
E-mail info@lrk.com

Client:

McCormack Baron Salazar

720 Olive St Suite 2500

St. Louis, MO 63101

Issues and Revisions

	Date	Issued / Revised
	3/16/2020	50% CONSTRUCTION DOCS
	5/18/2020	80% CONSTRUCTION DOCS
	7/13/2020	PERMIT SUBMISSION

BUILDING ADDRESSES

TYPE G-B
442, 444, 446, 448 RATLIFF LANE
324, 236, 238, 350 ISRAEL PLACE
TYPE H-A
373, 443 VANCE AVE
316, 364 FOOTE LANE
398 S DANNY THOMAS BLVD
TYPE I-C
368, 431 VANCE AVE
315 ISRAEL PLACE
TYPE L-A
321 ISRAEL PLACE
420, 380 FOOTE LANE
348 S DANNY THOMAS BLVD
TYPE M-A
402, 406 FOOTE LANE

©2020 LRK Inc
Drawings, written material, and design concepts shall not be used or reproduced in whole or part in any form or format without prior written consent of LRK Inc. Do not scale drawings. Use given dimensions only. If not shown, verify correct dimensions with the Architect. Contractor shall check and verify all dimensions and conditions at job site.

Seal

LRK Project Number: 01.15100.43

Project Name:

South City CNI Phase 4

Memphis TN

Drawing Name:

WALL ASSEMBLIES

Drawn By: ADB

Checked By: HU

G-006