


Order Plans @ [www.LDILine.com](http://www.LDILine.com)

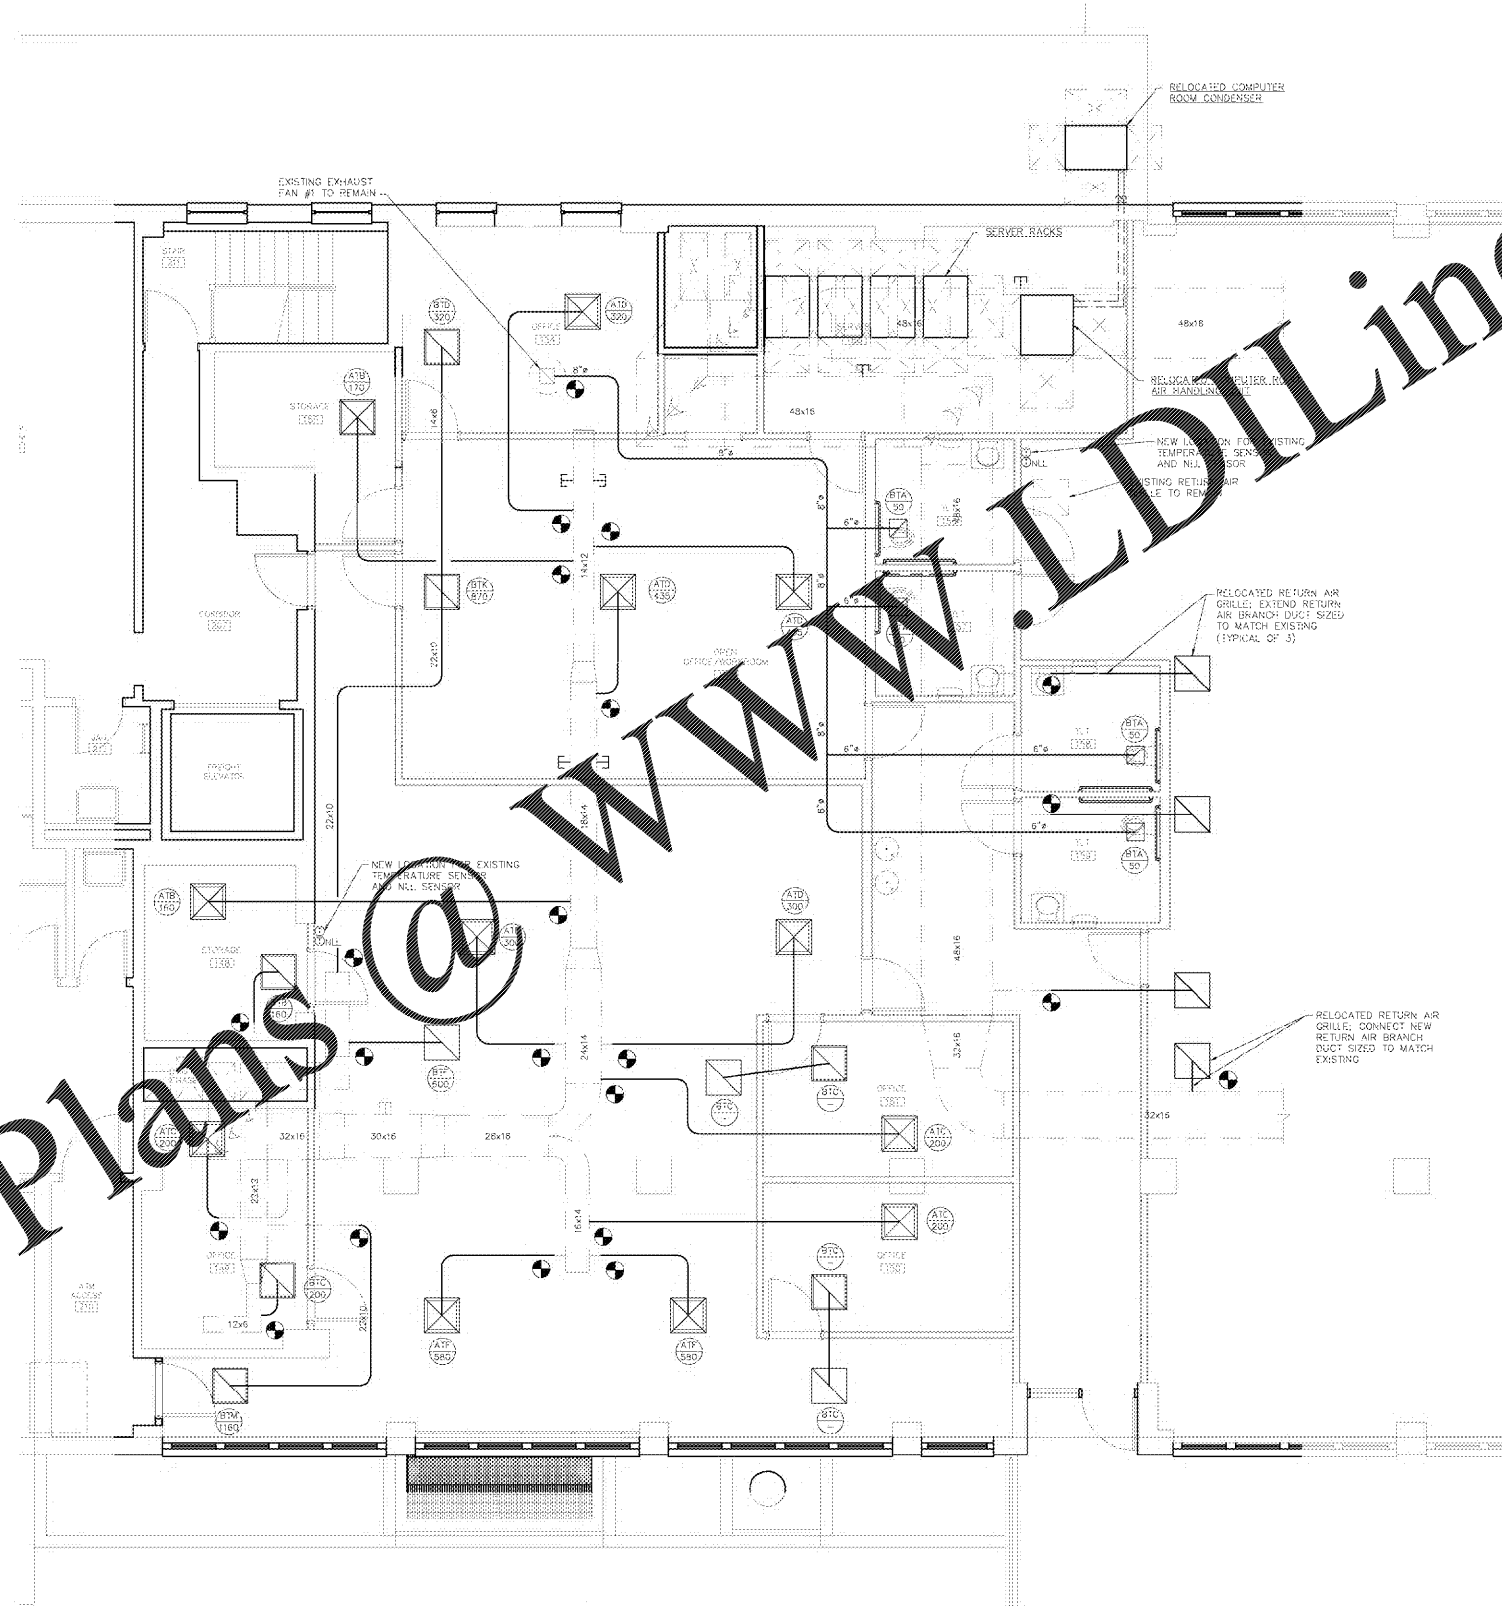

ADD ALTERNATE #3: THE CONTRACTOR SHALL REPLACE EXISTING AHU-3 IN BASEMENT MECHANICAL ROOM INCLUDING CONTROLS TO MATCH EXISTING. EXISTING DUCT AND PIPE MAINS SHALL REMAIN. THE CONTRACTOR SHALL ENSURE THAT AHU-3 IS FULLY FUNCTIONAL.

**1 FLOOR PLAN -- RENOVATION**  
SCALE: 1/4" = 1'-0"


NOTE: THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL EXISTING CONDITIONS. SUBMISSION OF BIDS IS CONSIDERED VERIFICATION THAT THE CONTRACTOR HAS VISITED THE SITE. NO EXTRAS WILL BE ALLOWED DUE TO LACK OF KNOWLEDGE OF THE EXISTING CONDITIONS.

RENOVATION LEGEND	
	NEW EQUIPMENT
	EXISTING
	EXISTING RELOCATED
	EXISTING THERMOSTAT
	CONNECT TO EXISTING

WALL RATING LEGEND	
	2 HOUR FIRE RATED PARTITION

**Biloba Architecture, PLLC**  
 8801 JM Keynes Drive  
 Suite 300  
 Charlotte, NC 28262  
 704.249.2822  
 www.biloba.com

ELECTRICAL and Electrical Engineer  
**McKnight Smith Ward Griffin Engineers**  
 4223 South Boulevard  
 Charlotte, NC 28209  
 704.527.2112  
 NC Certificate of Licensure: F-0595  
 MSWG PROJECT #20-027



Drawn	MGC
Checked	BSC
Date	August 7, 2020
Revisions	

Copyright 2020. All rights reserved. Printed or electronic drawings and documentation may not be reproduced in any form without written permission from Biloba Architecture, PLLC.

**Brown Hall Renovation**  
 1601 E. Market Street  
 Greensboro, NC 27411  
 SCO ID No. 20-22082-01A

Project Number 109  
 Title  
**Mechanical Renovation**

Sheet  
**M201**

Plate of