


GENERAL PLAN NOTES

1. REFER TO DENTAL EQUIPMENT PLANS FOR ELECTRICAL REQUIREMENTS AT DENTAL CHAIRS AND EQUIPMENT.
2. PROVIDE HOSPITAL GRADE MC CABLE IN PATIENT CARE AREAS.

KEYNOTE LEGEND

MARK	KEYNOTE TEXT
1	PANEL IS FLUSH MOUNTED IN WALL WITH FACE IN CORRIDOR. THE GENERAL CONTRACTOR IS TO ENSURE THAT THIS WALL SECTION IS 6" THICK, MINIMUM.
2	PANEL IS FLUSH MOUNTED IN WALL WITH FACE BEHIND DOOR. THE GENERAL CONTRACTOR IS TO ENSURE THAT THIS WALL SECTION IS 6" THICK, MINIMUM.
3	PROVIDE EMPTY SINGLE GANG BOX FLUSH IN WALL AT 84" A.F.F. FOR USE WITH NITROUS OXIDE & OXYGEN SYSTEM ALARM. FIELD VERIFY EXACT LOCATION. RUN AN EMPTY 1" C. (WITH PULL ROPE) TO LOCATION OF NITROGEN MANFOLD SYSTEM IN THE ADJACENT EQUIPMENT CLOSET. NOTE THAT A 120V CONNECTION MAY BE REQUIRED (FIELD VERIFY EXACT LOCATION).
4	PROVIDE 120V CONNECTION AT DOOR FRAME WITH DOOR POWER. WIRE AS PER MANUFACTURER SPECS.
5	PROVIDE EMPTY BOX (SIZE AS REQUIRED) FLUSH IN WALL AT 60" A.F.F. FOR USE WITH REMOTE CONTROL PANEL (BY OTHERS). RUN 1" C. (WITH PULL STRING) TO ABOVE NEAREST LAY-IN CEILING. VERIFY QUANTITY OF CONDUIT NEEDED WITH DENTAL EQUIPMENT VENDOR. FIELD VERIFY LOCATION.
6	PROVIDE EMPTY BOX (SIZE AS REQUIRED) FLUSH IN WALL AT ADA HEIGHT FOR USE WITH HANDICAPPED (STAND) OUTLET 1" C. (WITH PULL STRING) TO ABOVE NEAREST LAY-IN CEILING. FIELD VERIFY QUANTITY OF CONDUIT NEEDED WITH DENTAL EQUIPMENT VENDOR. PROVIDE 120V CONNECTIONS REQUIRED.
7	OUTLET FOR USE WITH DRINKING FOUNTAIN & BOTTLE FILLING STATION COMBO UNIT. INSTALL OUTLET PER MANUFACTURER SPECS. CIRCUIT IS TO BE PROTECTED BY A GFCI RATED BREAKER. SEE PANEL SCHEDULES.
8	OUTLET FOR USE WITH SPRINKLER DRY SYSTEM AIR COMPRESSOR. FIELD VERIFY LOCATION.
9	PROVIDE 1" C. STUBBED UP IN BASE OF PEDESTAL WHICH WILL CONTAIN ADA PUSH BUTTON FOR DOOR. RUN CONDUIT UNDERGROUND FROM PEDESTAL TO BUILDING THEN TO STUB OUT ABOVE NEAREST LAY-IN CEILING. PROVIDE PULL STRING IN CONDUIT.
10	PROVIDE 120/208V, 1-PHASE CONNECTION FLUSH IN WALL FOR USE WITH WASHER/DRYER STACK UNIT. PROVIDE RECEPTACLE TO MATCH NEMA CONFIGURATION OF CORD & PLUG SUPPLIED WITH UNIT. FIELD VERIFY MOUNTING HEIGHT & LOCATION.
11	MOUNT DEVICES HIGH ON WALL FOR USE WITH TV. FIELD VERIFY EXACT MOUNTING HEIGHT & LOCATION WITH THE ARCHITECT PRIOR TO DOING ANY WORK.

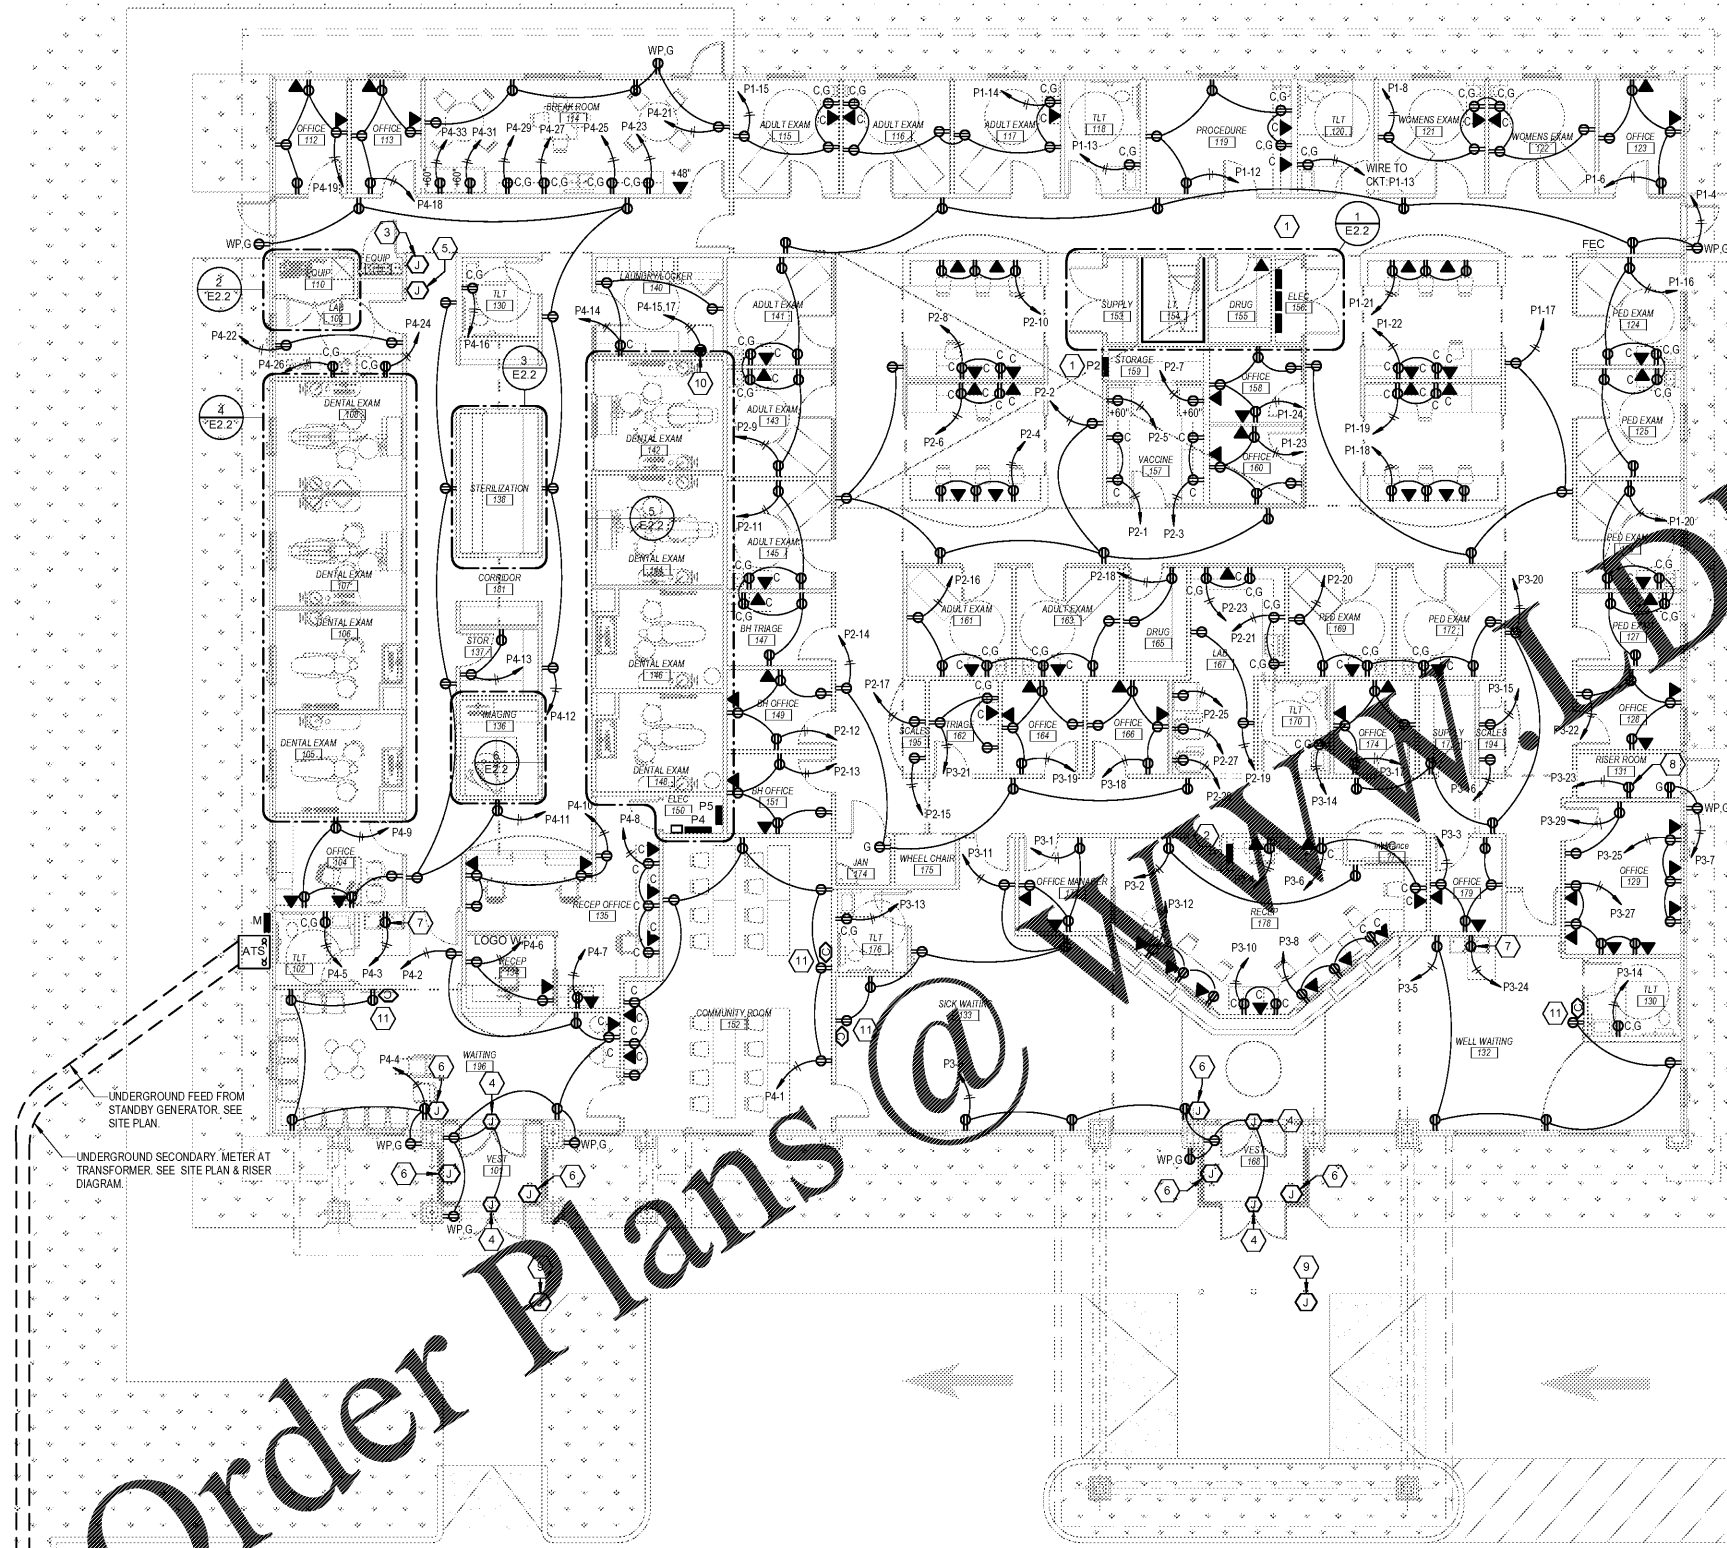

1 POWER PLAN
SCALE: 1/8" = 1'-0"

ART
1410 COMART STREET
CHATTANOOGA, TN 37408
423.265.4513
WWW.ARTECH.PRO

**GEORGIA MOUNTAINS
HEALTH SERVICES, INC.**
HIGHLAND CROSSING SOUTH
TRACT G
EAST ELLIJAY, GEORGIA

Steven B. Baber
PROFESSIONAL ENGINEER
No. 39815
09/04/2020

ISSUE DATES
INITIAL ISSUE 09-04-2020

JOB NO. 19-068 | DWN JLH | CKD GWE

March Adams & Associates
Consulting Engineers
310 Dodds Ave.
P.O. Box 3689
Chattanooga, Tennessee 37404
PH: (423)698-6675
M.A.A.#: 20109

E2.1
POWER PLAN