




1 LIFT MOTOR WIRING DIAGRAM
NO SCALE

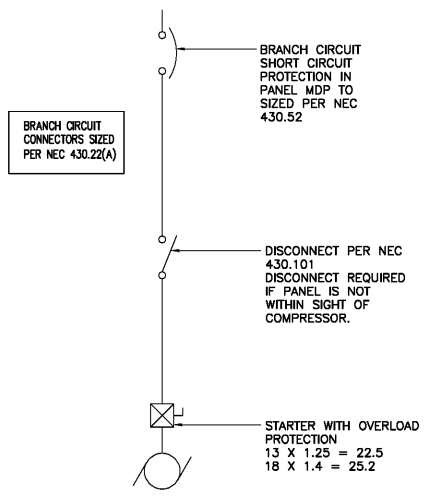

2 AIR COMPRESSOR WIRING DETAIL
NO SCALE

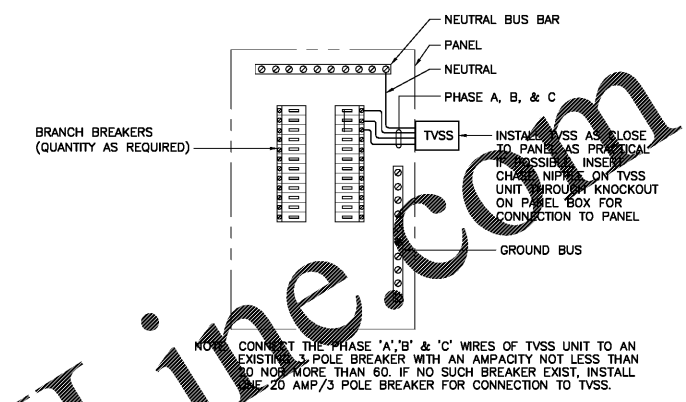


3 TVSS WIRING DIAGRAM - MAIN PANEL
NO SCALE

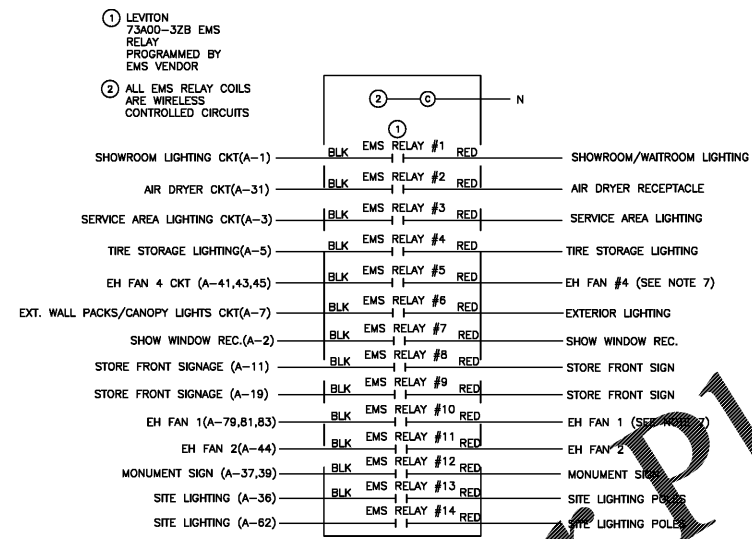


- EMS SYSTEM NOTES**
- CONTRACTOR TO VERIFY QUANTITY OF RELAYS WITH OWNERS.
 - ALL RELAYS TO BE PROVIDED WITH AN ACCESSIBLE LOCATION FOR SERVICE AND MANUAL OVERRIDE.
 - INSTALLATION SHALL FOLLOW ALL LOCAL AND STATE CODES.
 - GIVE CONSIDERATION TO WHERE RELAYS WILL BE MOUNTED AS NOT TO PLACE THEM WHERE INTERFERENCE CAN DISRUPT PROPER OPERATION.
 - HVAC CONTROLLER TO PROVIDE COMMON WIRE AT THERMOSTAT LOCATION.
 - EXTERIOR LIGHTING SHALL BE PROVIDED WITH A DIMMER MODULE TO REDUCE POWER BY 30 PERCENT TO MEET ENERGY CODES COORDINATE WITH MANUFACTURER.
 - SEE THREE-PHASE HEATER WIRING DIAGRAM ON SHEET E4.0 IF REQUIRED.


4 TYPICAL EMS RELAY WIRING
NO SCALE

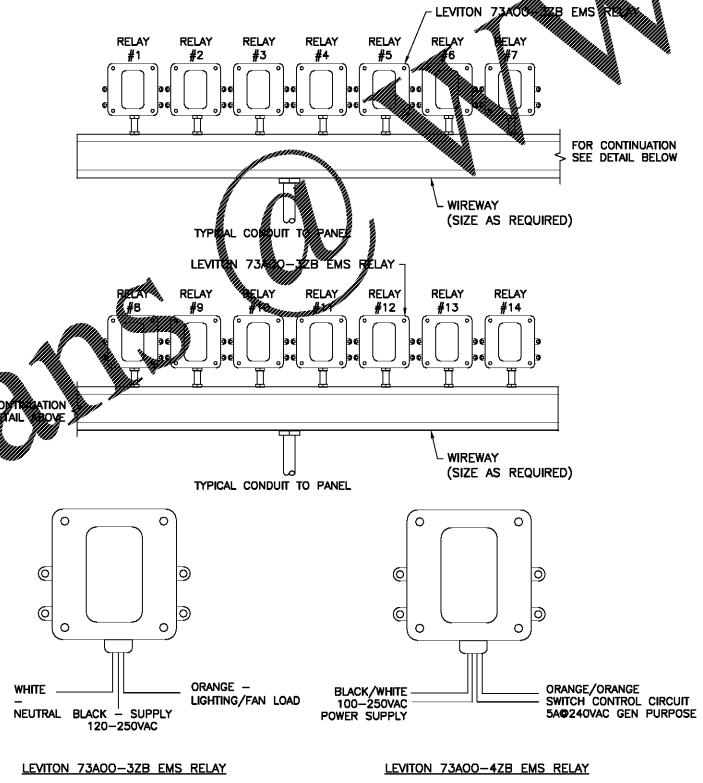

5 TYPICAL EMS LIGHTING & FAN DETAIL
NO SCALE

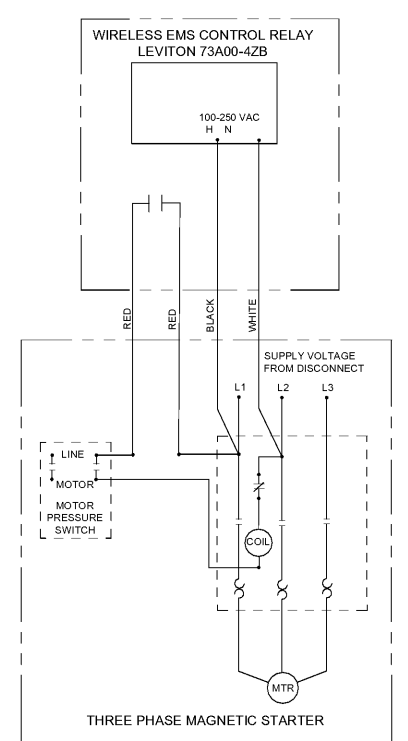

6 TYPICAL EMS COMPRESSOR DETAIL
NO SCALE

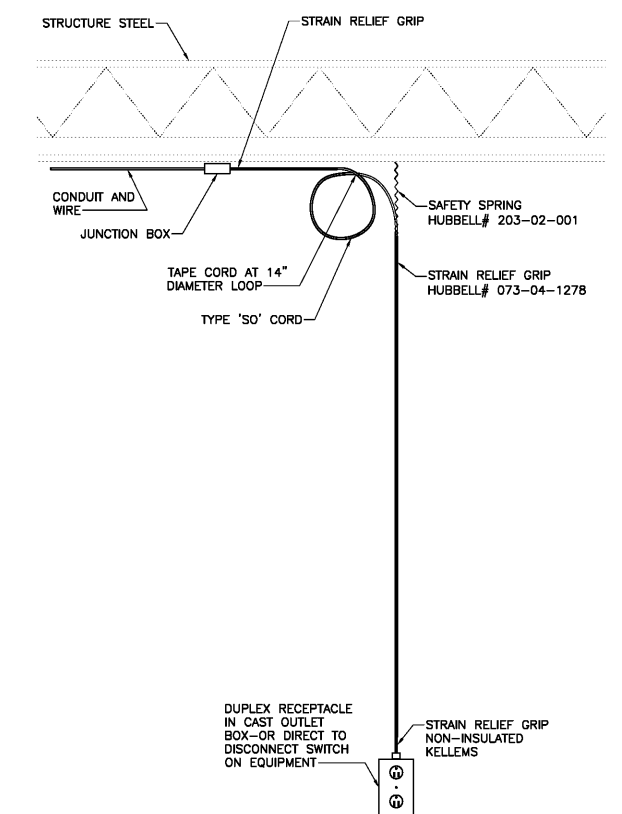

7 TYPICAL DROP CORD TO RECEPTACLE
NO SCALE