

PROTOTYPE TEMPLATE:
NORTHLAKE
v.2020.1.08.TKD
PROJECT INFORMATION:

TIRE KINGDOM.
STORE # 945
10520 COLONIAL BLVD
FT MEYERS, LEE COUNTY, FLORIDA


1 FIRE ALARM & SECURITY REQUIREMENTS PLAN
1/8"=1'-0"

| SYM. | DESCRIPTION |
|------|-------------------------------|
| SSCP | SECURITY SYSTEM CONTROL PANEL |
| S | MAN DOOR SWITCH |
| P | PASSIVE MOTION DETECTOR |
| 360 | 360 DEGREE MOTION DETECTOR |
| G | GLASS BREAK DETECTOR |
| S | SIREN |
| KP | KEY PAD |
| J | JUNCTION BOX |

| FIRE ALARM/SECURITY KEYED NOTES | |
|---------------------------------|---|
| 1 | DEVICES SHOWN IS FOR DIAGRAMMATIC PURPOSES ONLY. EXACT QUANTITY, LOCATION AND MOUNTING HEIGHTS SHALL BE COORDINATED WITH FINAL FIRE ALARM/SECURITY SYSTEM PLANS PRIOR TO ROUGH-IN. |
| 2 | E.C CONTRACTOR SHALL PROVIDE FOR REQUIRED BACK BOXES AND EMPTY CONDUIT W/PULL CORD TO FINAL TERMINATION POINT AS REQUIRED. COORDINATE WITH FIRE ALARM/SECURITY SYSTEM FOR EXACT CONDUIT SIZES AND ROUTINGS. |

| SYM. | DESCRIPTION |
|--------|--|
| FACP | FIRE ALARM CONTROL PANEL |
| A | ANNUNCIATOR |
| D | DETECT DETECTOR (INSTALLED AND SUPPLIED BY OTHERS) |
| M | MONITOR MODULE |
| F | MANUAL PULL STATION |
| H | HEAT DETECTOR |
| SD | SMOKE DETECTOR |
| H/S | WALL MOUNTED HORN STROBE |
| H/S | CEILING MOUNTED HORN STROBE |
| H/S | CEILING MOUNTED STROBE LIGHT |
| H/S/WP | WALL MOUNTED WEATHERPROOF HORN STROBE |
| J | JUNCTION BOX |

| GENERAL NOTES | |
|---------------|---|
| 1. | FIRE ALARM CEILING MOUNTED DEVICES: HEAT/SMOKE DETECTORS & CEILING STROBE SHALL HAVE 4"X4" SQUARE BOXES. a. SINGLE GANG MUD-RING FOR HORN/STROBES AND PULL STATIONS b. ROUND MUD-RING FOR HEAT/SMOKE DETECTORS |
| 2. | FIRE SPRINKLER PLANS FOR WATER FLOW AND/OR TAMPER SWITCHES SHALL HAVE 4" SQUARE BOX. |
| 3. | WALL MOUNTED DEVICES: HORN/STROBES AND THE ANNUNCIATOR SHALL HAVE 4" SQUARE BOX WITH SINGLE GANG MUG-RING AS WELL. |
| 4. | SECURITY SYSTEM DEVICES: a. CORNER MOTION SHALL MINIMUM 1/2" EMT STUBBED DOWN FROM CEILING SPACE TO 8'-0" A.F.F. WITH NO BACK BOXES. b. WALL MOUNTED MOTION (NOT CORNER) SHALL HAVE CONDUIT STUBBED DOWN TO 8'-0" A.F.F. WITH SINGLE GANG BOX WITH BLANK COVER-PLATE. c. DOOR CONTACTS SHALL HAVE 1/2" CONDUIT STUBBED DOWN FROM CEILING TO THE HEADER OF THE DOOR FRAME ON THE OPEN (NON-HINGED) SIDE OF THE DOOR PLATE |
| 5. | SEE FIRE ALARM/SECURITY VENDOR SUPPLIED DRAWINGS FOR EXACT CONDUIT ROUTINGS AND CONDUIT SIZES. |

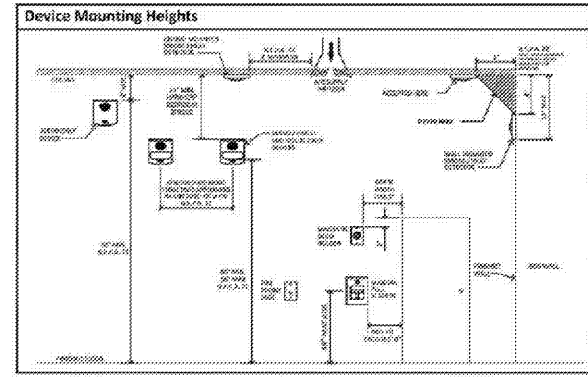

95% REVIEW SET
18 AUGUST 2020

PROJECT NO.: 2020-0095
DRAWN BY: DVC
CHECKED BY:

ISSUE DATE
PERMIT PLAN REVIEW 11-AUG-2020

| REVISION | DATE |
|----------|------|
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |

SHEET TITLE:
FIRE ALARM & SECURITY REQUIREMENTS PLAN

SHEET NUMBER:
E-7