

GENERAL ELECTRICAL NOTES

- A. ELECTRICIAN SHALL PROVIDE ALL CONDUITS WITH PULL STRINGS AS REQUIRED TO ALL DATA DROPS. ELECTRICIAN SHALL COORDINATE ALL CONDUIT RUNS WITH IT INSTALLER.
- B. ALL TELEPHONE/DATA LOCATIONS, CONDUIT ROUTING, AND SIZES SHALL BE COORDINATED AND VERIFIED WITH IT MANAGER PRIOR TO INSTALLATION.
- C. CONTRACTOR SHALL MAKE ALL FINAL CONNECTIONS AS REQUIRED, TO OWNER PROVIDED EQUIPMENT. COORDINATE EXACT LOCATIONS AND REQUIREMENTS WITH OWNER PRIOR TO ROUGH-IN AND/OR INSTALLATION.
- D. ALL TELEPHONE/DATA CONNECTION LOCATIONS SHALL BE COORDINATED WITH ARCHITECT. REFER TO ARCHITECTURAL ELEVATIONS, CASEWORK, SHOP DRAWINGS, AND EQUIPMENT INSTALLATION DRAWINGS FOR MORE INFORMATION.
- E. ELECTRICAL DEVICES LOCATED IN AUTOMOTIVE AND SHOP REPAIR AREAS, SHALL NOT BE MOUNTED BELOW 30" A.F.F., IN ACCORDANCE WITH NEC REQUIREMENTS.
- F. CALIBER COLLISION SHALL COMPLY WITH WITH THE INTERNATIONAL FIRE CODE GROUNDING REQUIREMENTS. ANY AND ALL STATIC-PRODUCING EQUIPMENT LOCATED IN FLAMMABLE GAS STORAGE OR USED AREAS, SHALL BE GROUNDED.
- G. ALL LOW VOLTAGE CABLING IN SHOP AREAS, SHALL BE COMPLETELY ENCLOSED IN CONDUIT AND ROUTED BACK TO THE IT ROOM. COORDINATE AND CONFIRM ROUTING WITH IT MANAGER PRIOR TO INSTALLATION.

- H. CONTRACTOR SHALL PROVIDE LONG SWEEP RADIUS ELBOWS FOR ALL TELEPHONE/DATA CONDUIT ROUTING. 90 DEGREE ELBOWS ARE NOT TO BE USED/INSTALLED.
- I. ALL CONNECTIONS/DEVICES SHOWN ARE FOR SPECIFIED EQUIPMENT. EQUIPMENT IS SUBMITTED AND APPROVED FROM DIFFERENT MANUFACTURERS AND HAVE DIFFERENT REQUIREMENTS. COORDINATE ALL ELECTRICAL REQUIREMENTS FOR EACH PIECE OF EQUIPMENT THAT'S PROVIDED AND REVISE TELEPHONE/DATA CONNECTIONS AS REQUIRED TO MATCH MANUFACTURERS RECOMMENDATION AND AND SPECIFICATION. ALL ADDITIONAL COST ITEMS FOR UPGRADING THE TELEPHONE/DATA COMPONENTS SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR PROVIDING SUBMITTED EQUIPMENT.
- J. ALL TELEPHONE/DATA RECEPTACLES SHALL BE MOUNTED AT 18" A.F.F. UNLESS NOTED OTHERWISE. COORDINATE EXACT HEIGHTS WITH ARCHITECT AND REFER TO ARCH DRAWINGS FOR ALL DEVICE ELEVATIONS.
- K. ALL EXPOSED CONDUIT IN SERVICE BAY AREA, SHALL BE ROUTED TO CREATE 90 DEGREE ANGLES. CONTRACTOR SHALL ROUTE ALL SERVICE BAY AREA HOME RUNS ABOVE STRIPED PAINTED WALKWAY AREA, TO STRUCTURE.
- L. VERIFY AND COORDINATE ALL TELEPHONE/DATA REQUIREMENTS, CONNECTIONS, EQUIPMENT, AND LOCATIONS FOR ALL BOOTHS WITH MANUFACTURER PRIOR TO ROUGH-IN. REFER TO MANUFACTURERS CUTSHEETS AS NEEDED.


ELECTRICAL NOTES BY SYMBOL "◇"

- 1. JUNCTION BOX MOUNTED FOR WIRELESS SYSTEM BY OTHERS
- 2. JUNCTION BOX MOUNTED FOR SPEAKER SYSTEM BY OTHERS.
- 3. JUNCTION BOX MOUNTED AT STRUCTURE ABOVE FOR TELE/DATA CONNECTION TO FRAMERACK COMPUTER. COORDINATE EXACT LOCATION AND DIMENSIONS WITH ARCHITECT AND OWNER PRIOR TO INSTALLATION.
- 4. ALL CONDUITS AND WRING FOR BOOTH NOT TO BE INSTALLED TO FINAL LOCATIONS UNTIL INSTALLATION OF BOOTH. COORDINATE SCHEDULE AND EXACT LOCATION OF POWER WITH INSTALLATION WITH BOOTH REPRESENTATIVE.
- 5. CONTRACTOR TO STUB UP (2) 4" C STUB-UPS FOR DATA/COMMUNICATION/CABLE. INSTALLER, CONTRACTOR TO RUN CONDUIT FROM STUB-UPS FROM INTERIOR WALL, OVERHEAD TO TELEPHONE BACKBOARD IN IT ROOM.
- 6. CONTRACTOR TO PROVIDE 1/2" C WITH PULL WIRE AND 3/4" C FOR BRANCH CIRCUITS FOR ALL COMMUNICATION/DATA LINES IN SHOP AREA. ROUTE CONDUIT AT STRUCTURE ABOVE PAINTED WALKWAY.
- 7. RUN CONDUIT TO PUBLIC RISE, OFF-WAY AND TO TELEPHONE COMPANY CONNECTION POINT.


THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY DUSTIN M. VOGT, PE ON 08-10-2020 USING A DIGITAL SIGNATURE. PRINTED COPIES ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

CALIBER COLLISION

olsson
 CALIBER COLLISION
 1717 South Boulder Ave
 Suite 600
 Tulsa, OK 74119
 TEL 918.376.4294
 WWW.OSSON.COM



timothy m. gallup
 architect of record
 601 S. Boulder Ave, Suite 808
 Tulsa, Oklahoma 74119
 918.549.9600
 www.tmgallup.com

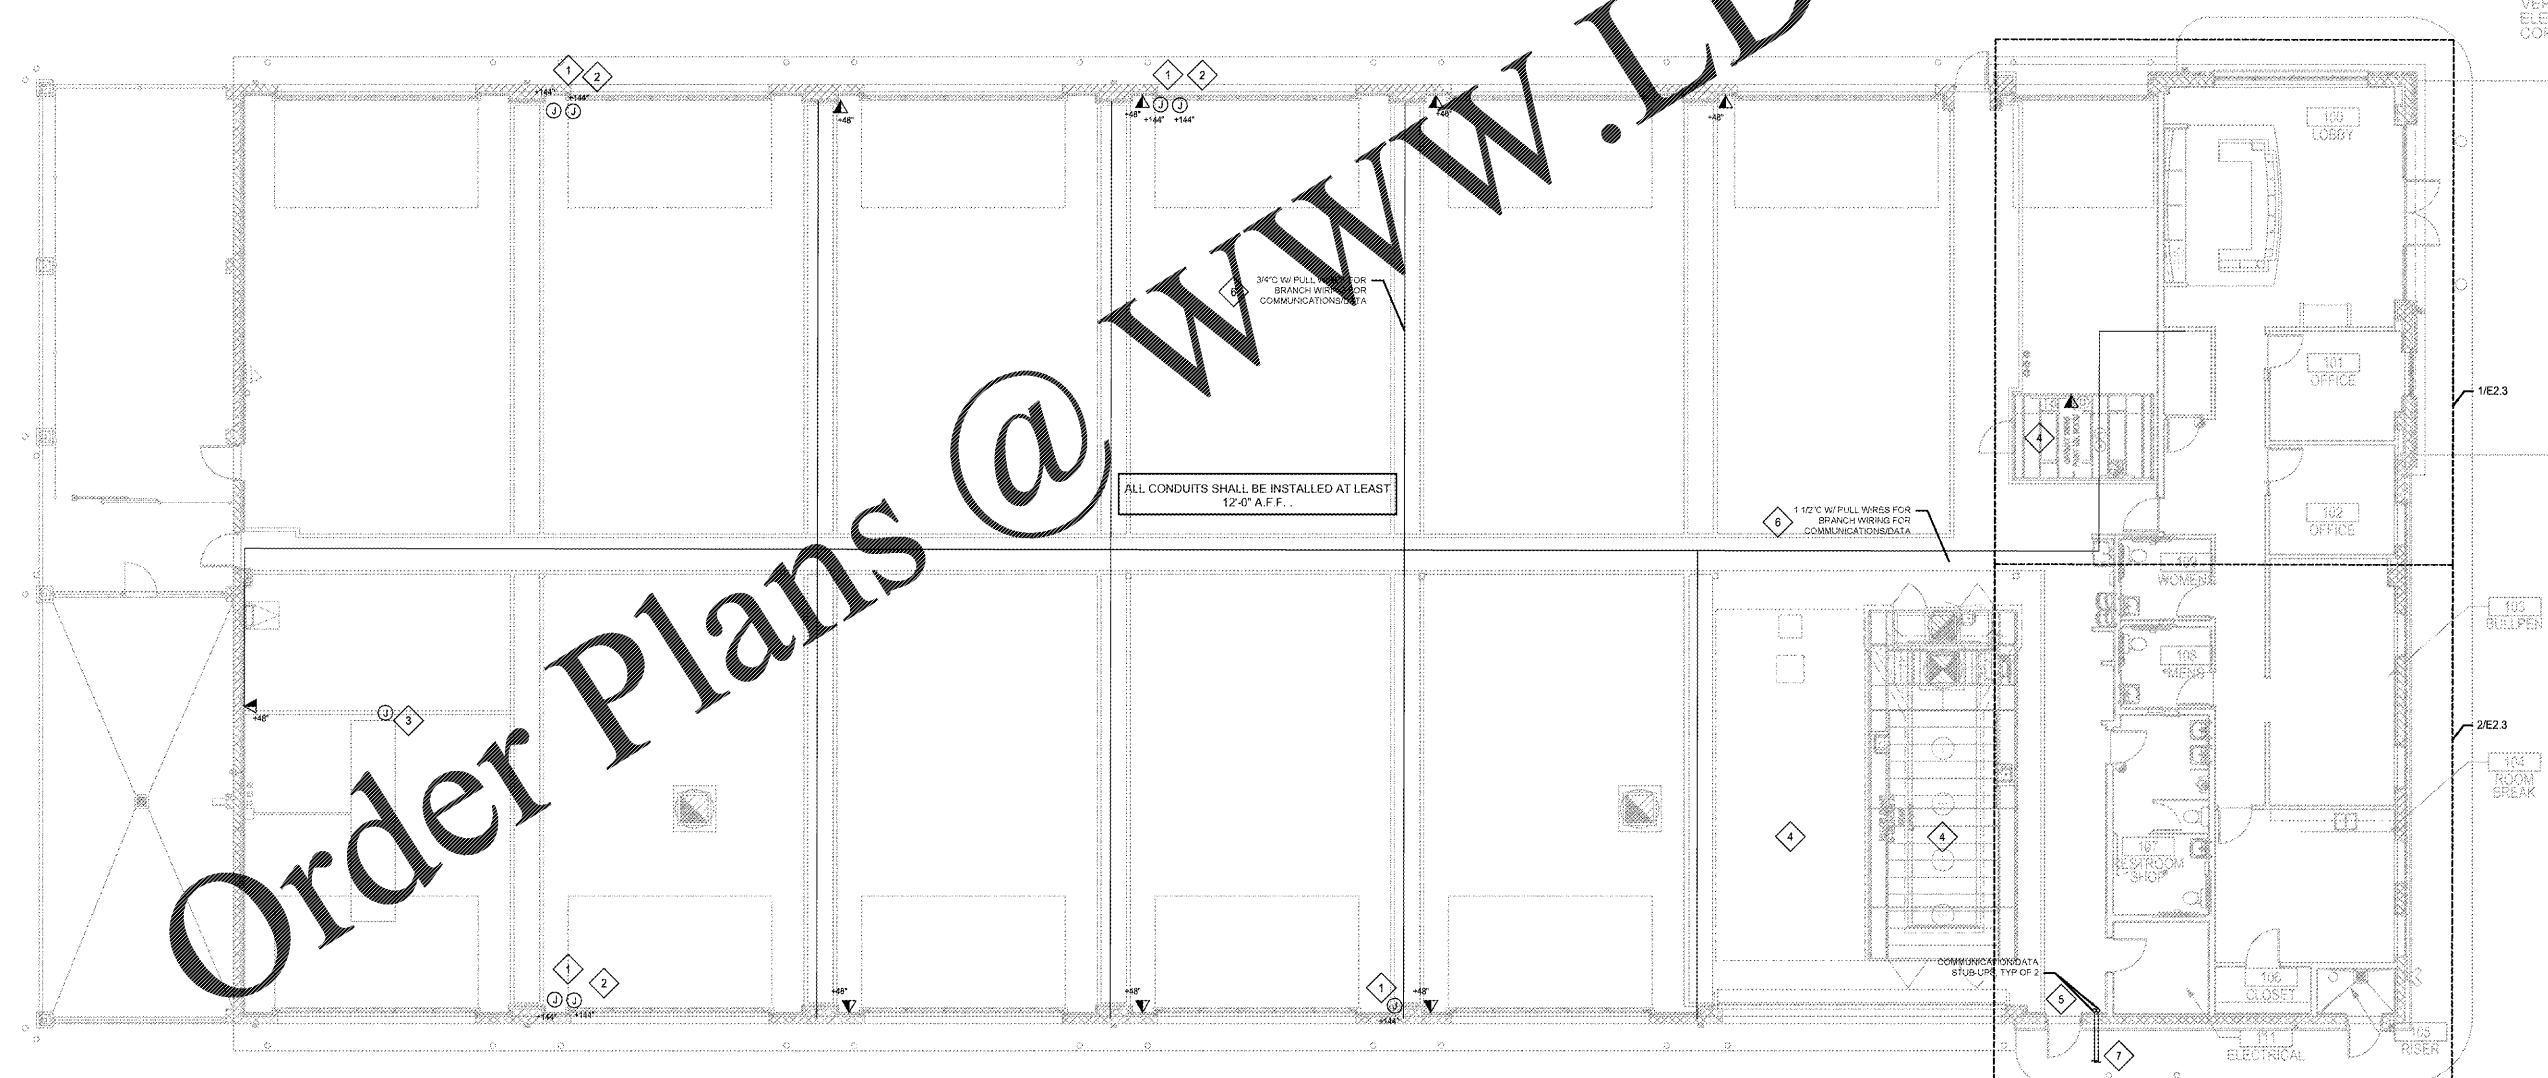

01 DATA PLAN
 1/8" = 1'-0"

REVISIONS	
NO.	DESCRIPTION

DATA PLAN
 CALIBER COLLISION
 2300 GRIFIN RD
 LAKELAND, FL
 PROJECT NO. 202022

FILE NAME: 192006
 DRAWN BY: SZK
 DATE: 08/19/2020
 REVIEWED BY: DMV

E2.2