


- GENERAL NOTES**
- BUILDING SHALL HAVE PRE-CONSTRUCTION TREATMENT PROTECTION AGAINST SUBTERRANEAN TERMITES IN ACCORDANCE WITH THE RULES AND REGULATIONS ESTABLISHED BY THE FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES. A CERTIFICATE OF COMPLIANCE SHALL BE ISSUED TO THE BUILDING DEPARTMENT BY THE LICENSED PEST CONTROL COMPANY PERFORMING THE TREATMENT IN ACCORDANCE WITH FRC 19B.1
 - SOIL TREATMENT FOR TERMITE CONTROL SHALL BE PER SPECIFICATION SECTION 05050 SOIL TREATMENT
 - REFER TO FLORIDA PRODUCT APPROVAL SCHEDULE ON COVER SHEET FOR APPLICABLE STOREFRONT SPEC. IMPACT GLASS MAY BE REQUIRED
 - RE: DETAILS 20 AND 21A-F FOR CORNER CONDITIONS AT WALL TILE IN THE FOOD SERVICE AREA AND RESTROOMS
 - ALL INTERIOR WALLS SHALL BE 1/2" G.W.B.U.C.
 - ALL INTERIOR G.W.B. CEILINGS TO BE 5/8" U.I.C.
- LEGEND**
- 2" MTL STUDS W/ R-30 BATT INSUL. AND EXT. VENEER
 - 2" MTL STUDS W/ 5/8" TYPE X GLASROC (EXTERIOR) AND 5/8" TYPE X GIB W/ INTERIOR TYPE X GLASROC @ RESTROOMS, W/ R-30 BATT INSUL. AND EXT. VENEER. CONTINUE THESE MATERIALS TO THE TOP OF PARAPET. US 283UAB5
 - 1/2" MTL STUDS ON ELECTRICAL SIDE
 - 5/8" TYP. ALL INTERIOR FINISH SCHEDULED
 - 5/8" MTL STUDS @ 16" O.C. W/ FINISH AS SCHEDULED
 - 3/4" MTL STUDS @ 16" O.C. W/ FINISH AS SCHEDULED
 - DOOR IDENTIFICATION SEE DOOR SCHEDULE
 - BLOCKING IDENTIFICATION SEE EQUIPMENT BLOCKING NOTES
 - TACTILE BRILLE SIGN STATIONING TEXT COMPLYING WITH FAC. SEE DETAIL 19A04A1
 - WATER HEAD
 - 3/4" MTL STUDS @ 16" O.C. W/ FINISH AS SCHEDULED
 - 5/8" PLYWOOD ON ELECTRICAL SIDE
 - 5/8" TYP. ALL INTERIOR FINISH SCHEDULED
 - 5/8" MTL STUDS @ 16" O.C. W/ FINISH AS SCHEDULED
 - CONCRETE
- EQUIPMENT BLOCKING NOTES**
- | ITEM | BLK MATL | LOCATION AND REMARKS |
|------|----------------------|---------------------------------|
| 1 | 12" X 12" X 1/2" MTL | IN LIEU OF G.W.B. SEE ELEVATION |
| 2 | 2" X 6" | 5'-8" |
| 3 | 2" X 6" | 3'-2" AND 4'-0" |
| 4 | 2" X 6" | 3'-0" |
| 5 | 2" X 6" | 3'-0" |
| 6 | 2" X 6" | 2'-0" AND 4'-0" |
| 7 | 2" X 6" | 2'-0" AND 4'-0" |
| 8 | 2" X 6" | 2'-0" AND 4'-0" |
| 9 | 2" X 6" | 2'-0" AND 4'-0" |
| 10 | 2" X 6" | 2'-0" AND 4'-0" |
| 11 | 2" X 6" | 2'-0" AND 4'-0" |
| 12 | 2" X 6" | 2'-0" AND 4'-0" |
| 13 | 2" X 6" | 2'-0" AND 4'-0" |
| 14 | 2" X 6" | 2'-0" AND 4'-0" |
| 15 | 2" X 6" | 2'-0" AND 4'-0" |
| 16 | 2" X 6" | 2'-0" AND 4'-0" |
| 17 | 2" X 6" | 2'-0" AND 4'-0" |
| 18 | 2" X 6" | 2'-0" AND 4'-0" |
| 19 | 2" X 6" | 2'-0" AND 4'-0" |
| 20 | 2" X 6" | 2'-0" AND 4'-0" |
| 21 | 2" X 6" | 2'-0" AND 4'-0" |
| 22 | 2" X 6" | 2'-0" AND 4'-0" |
| 23 | 2" X 6" | 2'-0" AND 4'-0" |
| 24 | 2" X 6" | 2'-0" AND 4'-0" |
| 25 | 2" X 6" | 2'-0" AND 4'-0" |
| 26 | 2" X 6" | 2'-0" AND 4'-0" |
| 27 | 2" X 6" | 2'-0" AND 4'-0" |
| 28 | 2" X 6" | 2'-0" AND 4'-0" |
| 29 | 2" X 6" | 2'-0" AND 4'-0" |
| 30 | 2" X 6" | 2'-0" AND 4'-0" |
| 31 | 2" X 6" | 2'-0" AND 4'-0" |
| 32 | 2" X 6" | 2'-0" AND 4'-0" |
| 33 | 2" X 6" | 2'-0" AND 4'-0" |
| 34 | 2" X 6" | 2'-0" AND 4'-0" |
| 35 | 2" X 6" | 2'-0" AND 4'-0" |
- DOOR NOTES**
- DOOR SCHEDULE IS SHOWN IN DOOR SCHEDULE ARE TYPICAL FOR WALK-IN STORES. VERIFY QUANTITIES AND WHICH DOORS ARE REQUIRED AS INDICATED IN FLOOR PLAN.
 - SEE STOREFRONT MANUFACTURER SPECIFICATIONS FOR VESTIBULE DOORS AND HARDWARE. DOORS ARE TO BE REINFORCED WITH THREMLATA AND GLASS AT ALL DOORS.
 - ALL EXTERIOR HOLLOW METAL DOORS SHALL BE INSULATED DOORS.
 - RUN CONTINUOUS BEAD OF CLEAR SILICONE CAULK AROUND ALL DOOR FRAMES.
 - EXIT DOOR LOCKS: IF PROVIDED ON EXISTING DOORS, SHALL NOT REQUIRE THE USE OF A KEY, TOOL, SPECIAL KNOWLEDGE OR EFFORT FOR OPERATION FROM THE EGRESS SIDE IN ACCORDANCE WITH SECTION 14.2.3 OF IFBC AND SECTION 1010.1.9 OF IFBC UNLESS SPECIFICALLY ALLOWED BY CODE.
 - A LATCH OR OTHER FASTENING DEVICE ON A LOCKING DOOR SHALL BE PROVIDED WITH A KNOB, HANDLE, PANIC BAR, OR OTHER SIMPLE TYPE OF RELEASING DEVICE HAVING AN OBVIOUS METHOD OF OPERATION UNDER ALL LIGHTING CONDITIONS. DOORS SHALL BE OPERABLE WITH NO MORE THAN ONE RELEASING OPERATION PER IFBC 14.2.1.9.
 - ALL DOORS SERVING SPACES REQUIRED TO BE ACCESSIBLE SHALL BE PROVIDED WITH OPERABLE PARTS THAT SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PULLING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE OPERABLE PARTS SHALL BE 5 POUNDS MAXIMUM (IFBC 404.2.3.4).
 - OPERABLE PARTS OF HARDWARE SHALL BE 3/4" MINIMUM AND 48" MAXIMUM ABOVE THE FINISH FLOOR OR GRADING (IFBC 404.2.7.3).
 - REFER TO HARDWARE SCHEDULE IN THE SPECIFICATION MANUAL.
 - THRESHOLD IS NOT TO EXCEED 1/2" HIGH.
 - DOOR TO REQUIRE HOLE IN SLAB FOR BOLT.
 - VISION PANEL DIMENSIONS CORRESPOND TO VISIBLE LIGHT DIMENSIONS. CONTRACTOR TO COORDINATE REQUIRED GLASS SIZE AND OPENING WITH DOOR MANUFACTURER.
 - ACROBYN DOORS SHALL BE INSTALLED IN H.M. FRAMES PER SPECIFICATIONS. THE DOORS SHALL HAVE ACRYLON COVERING FACTORY APPLIED.

DOOR SCHEDULE

#	W	H	TH	TYPE	MATL	FRM	THR	HW	COMMENTS	PUSH	KICK PLATE		
										HW	PUSH	PULL	LABEL
APS	3'-0"	6'-0"	0'-0"						HW 15 3/4" X 24" X 1/2" INSULATED TOWER ACCESS PANEL/DOOR				
GD	3'-0"	7'-0"	0'-1 1/4"	B	HM	HM	D	HW 9	SEE DETAILS 20 & 21A-F AND 20A-F	LOCKSET			
DD	4'-0"	7'-0"	0'-1 1/4"	C	HM	HM	C	HW 10	SEE DETAIL 20 & 21A-F AND 20A-F		PANIC BAR		
EL	3'-0"	6'-0"	0'-1 1/4"	C	HM	HM	C	HW 13	SEE DETAIL 20 & 21A-F AND 20A-F		PANIC BAR		
F1	3'-0"	6'-0"	0'-0"						HW 13 3/4" X 24" SAFETY GLASS VISION PANEL. SEE DETAIL 20A-F & 20A-F1				
CF	3'-0"	6'-0"	0'-1 1/4"	C	MD	HM		HW 12	3/4" X 24" ONE-WAY SAFETY GLASS VISION PANEL. PROVIDE 8" JAMBS W/ CONTINUOUSLY ON RETAIL SIDE. SEE DETAIL 23A-F	LOCKSET			
FT	3'-0"	6'-0"	0'-1 1/4"	B	MD	HM		HW 7	3/4" X 24" DOOR 1". SEE DETAIL 22A-F				
R1	3'-0"	6'-0"	0'-0"	REF					BY REFRIGERATION COMPANY				
R2	4'-0"	6'-0"	0'-2"	REF					BY REFRIGERATION COMPANY (DOUBLE DOORS) W/ 8" X 14" LITE BY REFRIGERATION COMPANY (GLAZED)				
TS	3'-0"	7'-0"	0'-1 1/4"	C	HM	HM	B	HW 3.1	4" X 24" LAMINATED GLASS VISION PANEL. SEE DETAILS 20 & 21A-F AND 20A-F FOR SILL	LOCKSET			
V1	(2) 3'-0"	7'-0"	0'-1 1/4"	A	ALUM	ALUM	C	HW 20	NO HOLD OPENS. HARDWARE SET 20 BY G.C. BALANCE OF HARDWARE BY DOOR SUPPLIER		PUSH BAR		
V2	(2) 3'-0"	7'-0"	0'-1 1/4"	A	ALUM	ALUM	C	HW 20	NO HOLD OPENS. HARDWARE BY DOOR SUPPLIER		PUSH BAR		
V3	(2) 3'-0"	7'-0"	0'-1 1/4"	A	ALUM	ALUM	C	HW 20	NO HOLD OPENS. PUSH ONLY HARDWARE BY DOOR SUPPLIER		PUSH BAR		
W1	3'-0"	6'-8"	0'-1 1/4"	C	MD	HM		HW 3.1	DOUBLE ACTING WITH 4" X 24" GLASS VISION PANEL. SEE DETAIL 23A-F				
W2	3'-0"	6'-8"	0'-1 1/4"	C	MD	HM		HW 3.2	4" X 24" ONE-WAY SAFETY GLASS VISION PANEL/THUMB LATCH. SEE DETAIL 23A-F				
W3	3'-0"	6'-8"	0'-1 1/4"	C	MD	HM		HW 3.6	4" X 24" SAFETY GLASS VISION PANEL. SEE DETAIL 22A-F	LOCKSET			

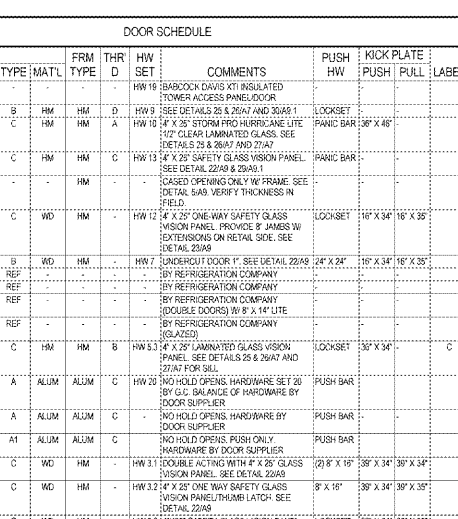

1925 Prospect Ave.
Orlando, FL 32814
P (407) 661-9100
F (407) 661-9101
www.c-p.com

Chhab & Peterson
Architects Engineers Planners

CLIENT NAME: **WAWA**
260 WEST BALTIMORE PIKE
WAWA, PENNSYLVANIA 15063

PROJECT NAME: **WAWA F85L 2019.01 STORE #8351 - CMM**
1004 EDGEWOOD AVE.
JACKSONVILLE, FL 32254

DATE: 09-09-2020
BY: [Signature]
CHECKED: [Signature]

FLOOR PLAN
SHEET TITLE: **A1**