


REFER TO THEATRE CONSULTANT DRAWINGS FOR SCOPE OF WORK DILINEATION AND ADDITIONAL ELECTRICAL REQUIREMENTS AND INFORMATION

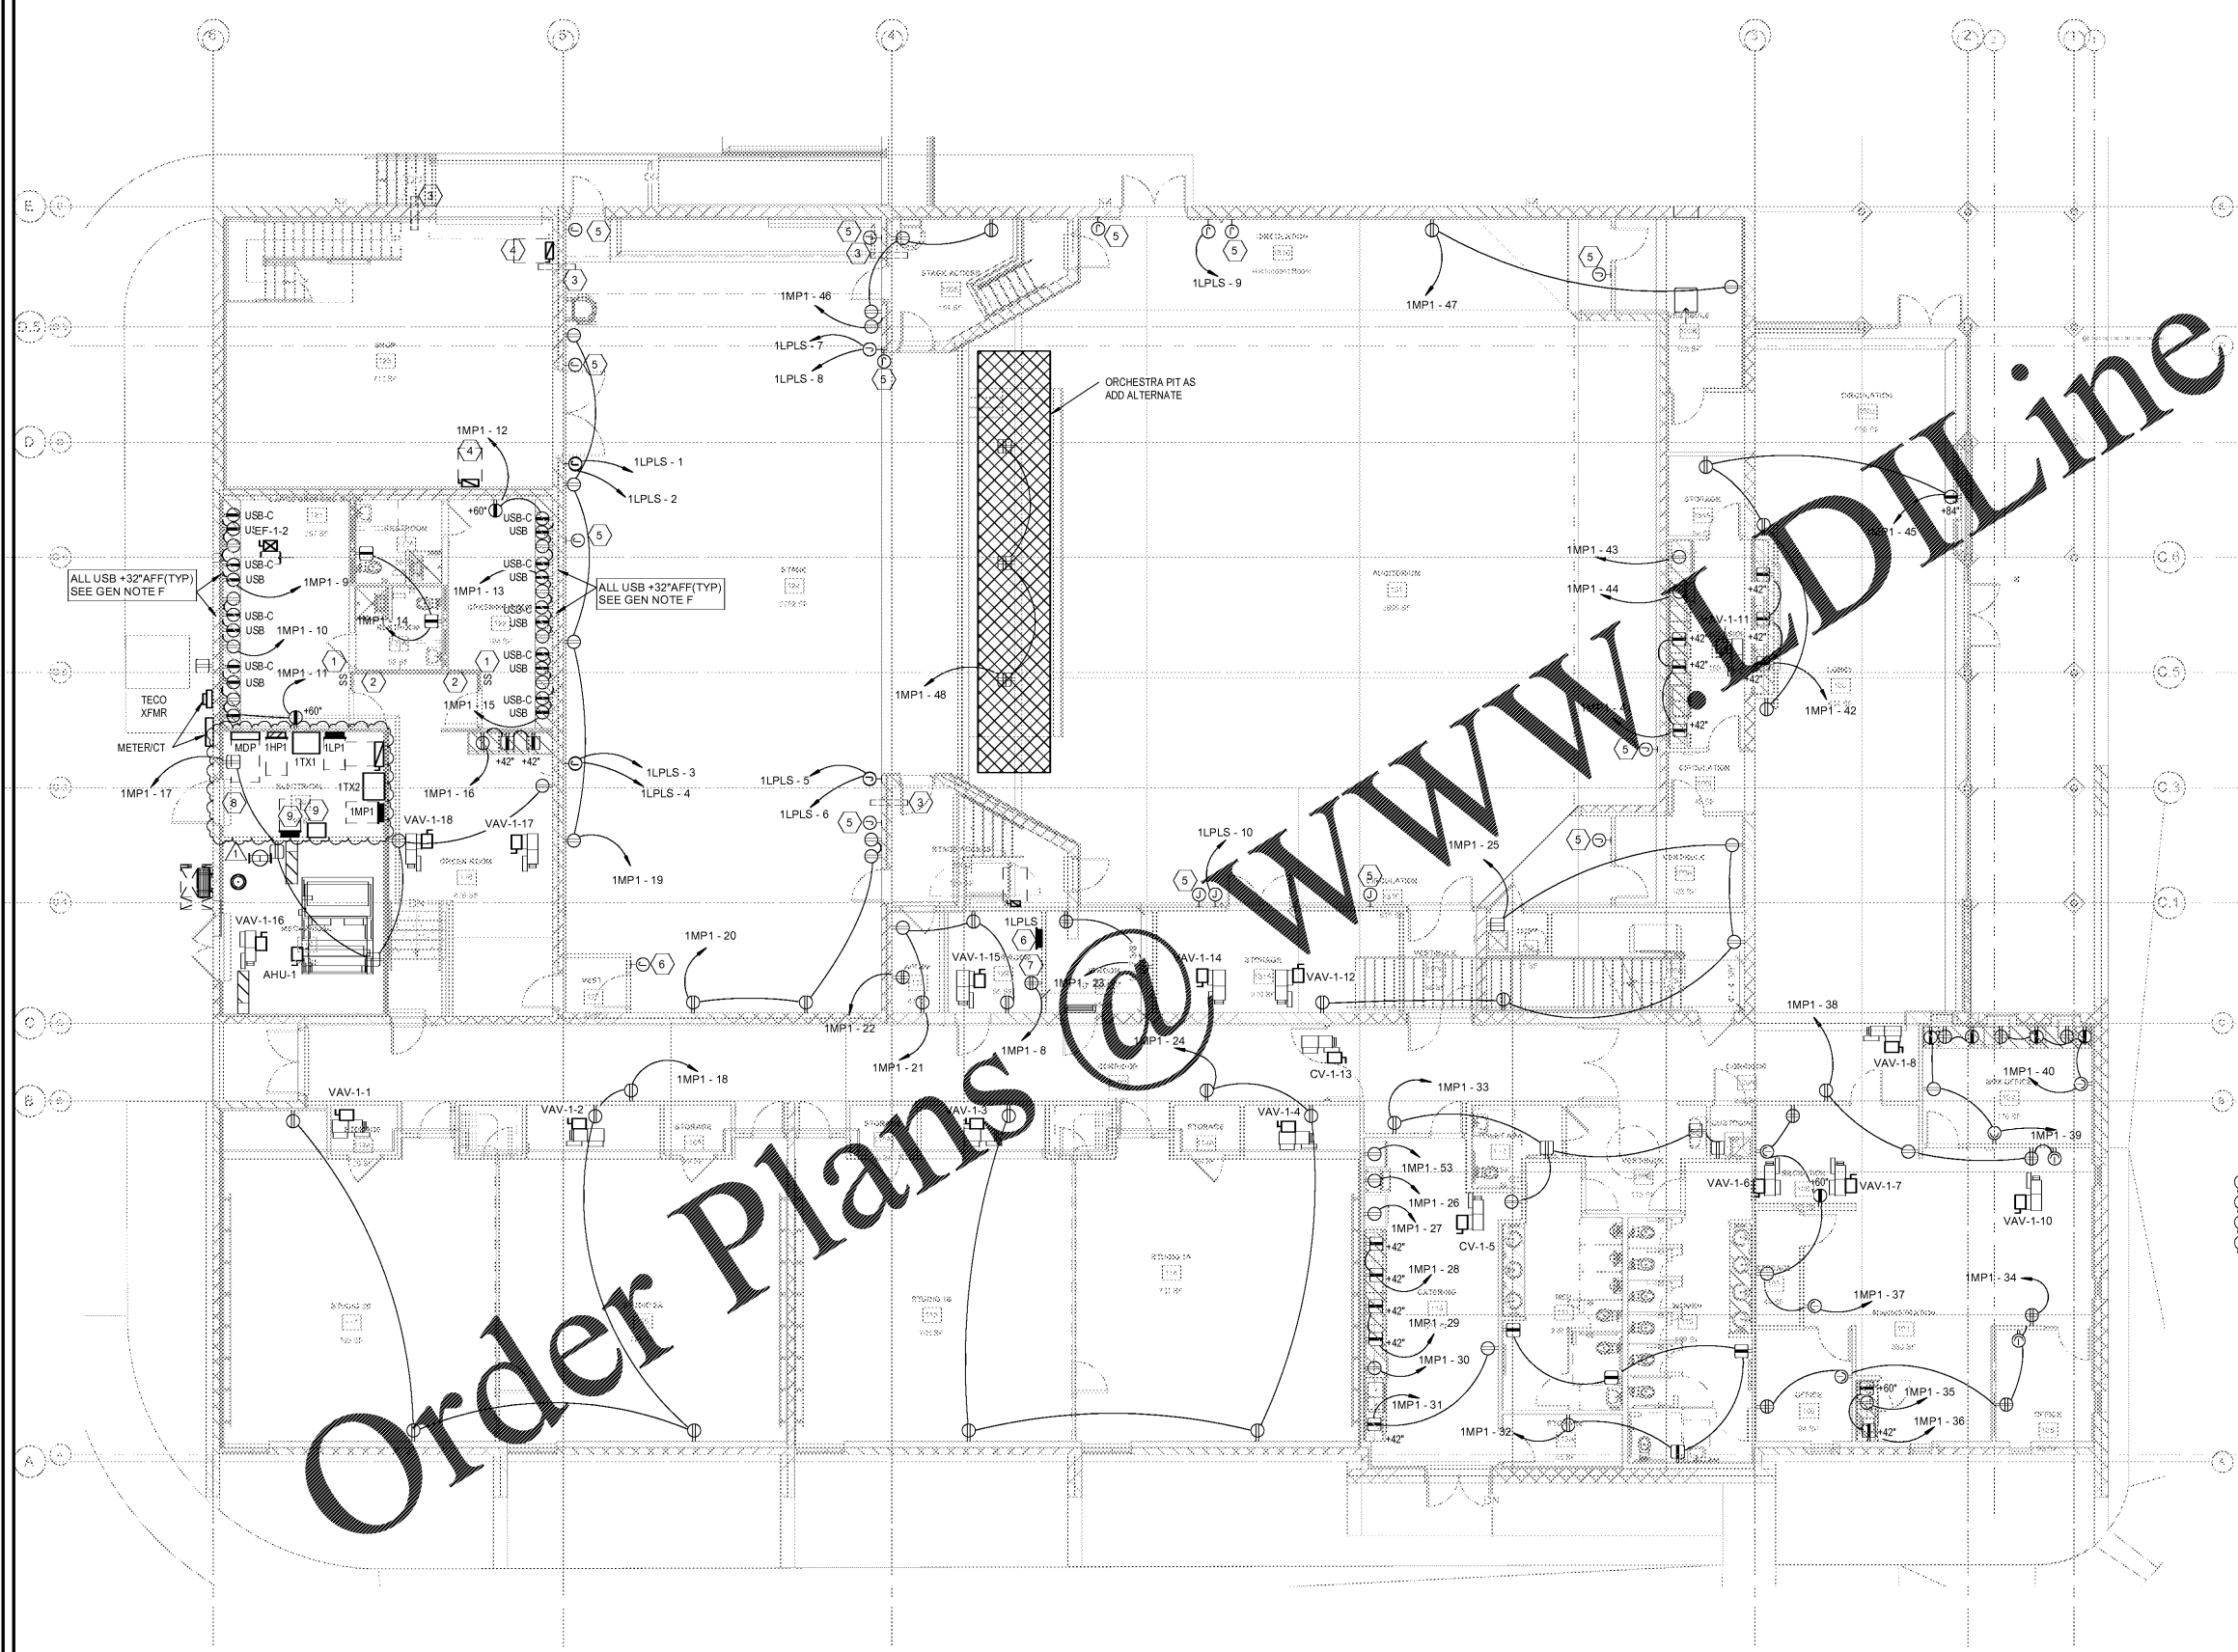

Order Plans @

**GENERAL NOTES**

- A. ELECTRICAL CONTRACTOR SHALL REFER TO THE ELECTRICAL SPECIFICATIONS FOR ADDITIONAL DESIGN STANDARDS. THE ELECTRICAL SPECIFICATIONS ARE A BINDING PART OF THE CONSTRUCTION DOCUMENTS.
- B. ALL GANG BOXES SHALL BE MINIMUM 3" DEEP U.O.N.
- C. ALL WIRE SHALL BE COPPER STRANDED.
- D. RECEPTACLE COVER PLATES IN CONCESSION, AUDITORIUM, VESTIBULES, AND STAGE SHALL BE BLACK. ALL REMAINING RECEPTACLE COVER PLATES SHALL BE WHITE.
- E. ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR INSTALLATION OF ALL BOXES. BOXES TYING INTO LIGHTING SYSTEM PANEL "1LPLS" ARE FURNISHED BY DIV 11. REFER TO TP SERIES DRAWINGS FOR ADDITIONAL SCOPE INFORMATION.
- F. ALL USB/USBC RECEPTACLES IN THE DRESSING ROOMS SHALL BE INSTALLED AT 32" AFF. COORDINATE WITH MILLWORK CONTRACTOR.

**KEYNOTES**

- | NUMBER | NOTES   |
|--------|---|
| 1      | ALL RECEPTACLES ADJACENT TO MIRRORS AND ABOVE DRESSING TABLE COUNTER ARE TO BE SWITCHED.  |
| 2      | PILOT INDICATOR LIGHT LOCATION- EACH SWITCH CONTROLLING DRESSING ROOM INDICATORS SHALL HAVE A PILOT INDICATOR LIGHT INDICATING WHEN RECEPTACLES ARE ENERGIZED.  |
| 3      | PATHWAY LOCATIONS FOR CABLE PASS THROUGH- PROVIDE 4"x4" THROUGH WALL (PRODUCT PART # FT4SD) REFER TO DIV 11 TP SERIES DRAWINGS FOR ADDITIONAL INFORMATION.  |
| 4      | FURNISH AND INSTALL 200A/1F/3P/NEMA1(240V) SAFETY SWITCH FOR OWNER/SHOP ELECTRICAL PROVISIONS.  |
| 5      | LOW VOLTAGE BACKBOX LOCATION FOR TERMINATION OF PERFORMANCE ETHERNET OR SUPPLEMENTAL CONTROLS- ALL BOXES ARE TO BE MINIMUM 2 1/4" DEEP U.O.N. AND ARE FURNISHED BY THE ELECTRICAL CONTRACTOR. ALL HOMERUNS ARE IN MINIMUM 3/4" CONDUIT. REFER TO DIV 11 TP SERIES DRAWINGS BOX SCHEDULE FOR ADDITIONAL INFORMATION. |
| 6      | INTELLIGENT BREAKER PANEL LOCATION "1LPLS" - MODEL ETC 240V RATED OR APPROVED EQUIVALENT- ALL PERFORMANCE LIGHTING CIRCUITS SHALL TERMINATE AT THIS LOCATION. REFER TO PANEL SCHEDULE AND TP SERIES DRAWING FOR ADDITIONAL INFORMATION.   |
| 7      | DEDICATED QUADRIplex FOR LV EQUIPMENT RACK POWER- COORDINATE WITH DIV 11 CONTRACTOR PRIOR TO INSTALL. PROVIDE BOX 96" AFF FOR HOME RUN LOCATIONS ABOVE RACK.  |
| 8      | PV PANEL AND INVERTER LOCATION FOR PHOTOVOLTAIC PROVISIONS- CONTRACTOR TO BID AS ADD ALTERNATE. REFER TO PV ONE-LINE AND E2.2 FOR ADDITIONAL INFORMATION.   |

FIRST FLOOR PLAN - POWER 1

**VOLT AIR**  
 THESE ITEMS HAVE BEEN ELECTRICALLY CHECKED BY: GERALD A. CRINKOVICH, P.E.  
 6005 Benjamin Road, Suite A  
 Tampa, Florida 33634  
 Tel: 888.881.9713  
 www.VoltAir.com  
 Project No: 18040  
 COA: 427156  
 Engineer of Record:  
 GERALD A. CRINKOVICH, P.E. #42527

**FLEISCHMANN GARCIA**  
 ARCHITECTURE + PLANNING + INTERIORS  
 350 HOBBS AVENUE, SUITE 800  
 TAMPA, FLORIDA 33606  
 PHONE (772) 726-8800  
 FAX (772) 726-8800  
 www.fleischmann-garcia.com

**HILLSBOROUGH COUNTY  
 NEW TAMPA PERFORMING ARTS  
 CENTER**  
 8550 HUNTERS VILLAGE RD.  
 TAMPA FL, 33647

THIS DESIGN AND DRAWING IS THE SOLE PROPERTY OF FLEISCHMANN GARCIA. NO PART OF THIS WORK MAY BE REPRODUCED WITHOUT PRIOR WRITTEN PERMISSION FROM FLEISCHMANN GARCIA.

**PERMIT SET**  
 PROFESSIONAL ENGINEER  
 GERALD A. CRINKOVICH, P.E.  
 NO: 42527  
 STATE OF FLORIDA  
 PROFESSIONAL ENGINEER

FGA PROJECT NUMBER  
 19048

ISSUE DATE  
 04-15-2020

NO	DATE	NOTES
1	05.26.20	Permit Comments

SHEET NAME  
 FIRST FLOOR PLAN - POWER

SHEET NUMBER  
 E2.1