

D·Z·A
ASSOCIATES, INC.

IL REG. # 104-001714 Suite 233N
2625 Butterfield Road Suite 233N
Oak Brook, Illinois 60553
Phone 630-520-1020 www.dzainc.com

© 2010 D-Z-A ASSOCIATES, INC.
THE ARCHITECT SHALL BE DEEMED THE AUTHOR OF
THESE DOCUMENTS AND SHALL BE RESPONSIBLE FOR
REVISIONS AND OTHER RIGHTS, INCLUDING COPYRIGHT.


Rev. No.	Description	Date
▲	ISSUED FOR BID AND PERMIT	10/16/20

GENERAL NOTES:

- OVERHEAD PIPING SHALL BE INSTALLED WITHIN ROOF FRAMING SYSTEM.

KEYED NOTES:

- TENANT SHALL PROVIDE WATER METER, WITH REMOTE READER LOCATED IN LANDLORD'S ROOM.

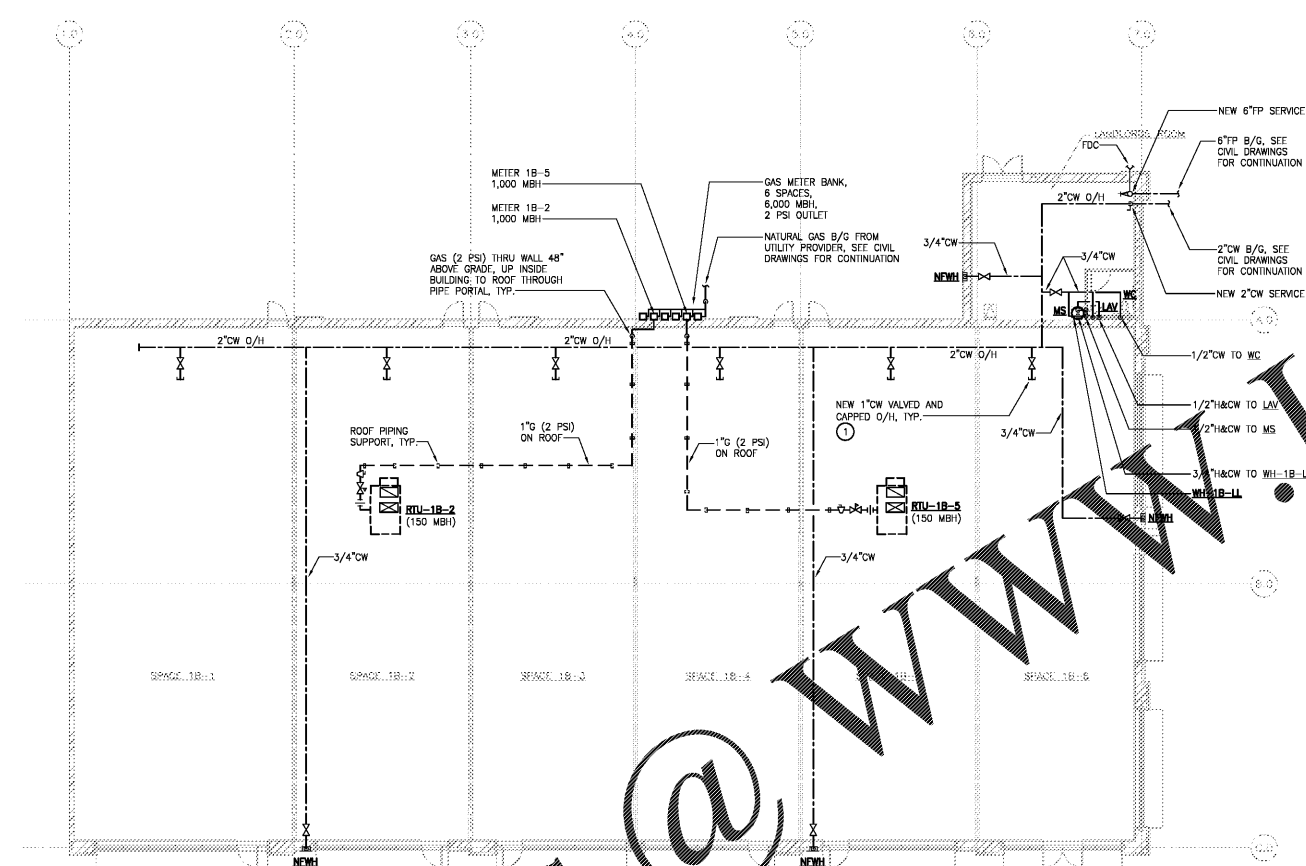

METER 1B-2

GAS LOAD AND SIZING SUMMARY:

1. LOAD SUMMARY:

RTU-1B-2	= 150 MBH
FUTURE	= 850 MBH
TOTAL	= 1000 MBH

2. PIPE SIZING SUMMARY:

- 2.0 PSI INLET PRESSURE
- 1.0 PSI PRESSURE DROP
- 200 FT TOTAL EQUIV. LENGTH
- IFGC TABLE 402.4(4) SCHEDULE 40 METALLIC PIPE IS USED.

METER 1B-5

GAS LOAD AND SIZING SUMMARY:

1. LOAD SUMMARY:

RTU-1B-5	= 150 MBH
FUTURE	= 850 MBH
TOTAL	= 1000 MBH

2. PIPE SIZING SUMMARY:

- 2.0 PSI INLET PRESSURE
- 1.0 PSI PRESSURE DROP
- 200 FT TOTAL EQUIV. LENGTH
- IFGC TABLE 402.4(5) SCHEDULE 40 METALLIC PIPE IS USED.

1 SUPPLY PLAN - RETAIL 1B
SCALE: 3/32" = 1'-0"

Order Plans @


WWW.LDIIline.com

Salem Gate Market

RETAIL 1B

CONYERS, GEORGIA

PLUMBING SUPPLY PLAN



Date: 10/16/20
Drawn by: MA
Project No.: 20.062
Sheet No.: P1.1 (1)

Ray Group Consulting Engineers, Inc.
1877 Powers Ferry Road
Building 20, Suite 100
Atlanta, Georgia 30339
Tel: (770) 963-1448
Fax: (770) 963-8033