


KEY NOTES


1 EXISTING CONCRETE SLAB. ALL MANHOLES WITHIN THE TANK SLAB AREA TO BE RAISED 1" ABOVE THE NORMAL GRADE OF CONCRETE. SLOPE CONCRETE TO MANHOLES 1/4" PER FT. CROWN CONCRETE AS TO NOT INHIBIT WATER DRAINAGE OFF THE TANK SLAB (NO POOLING).

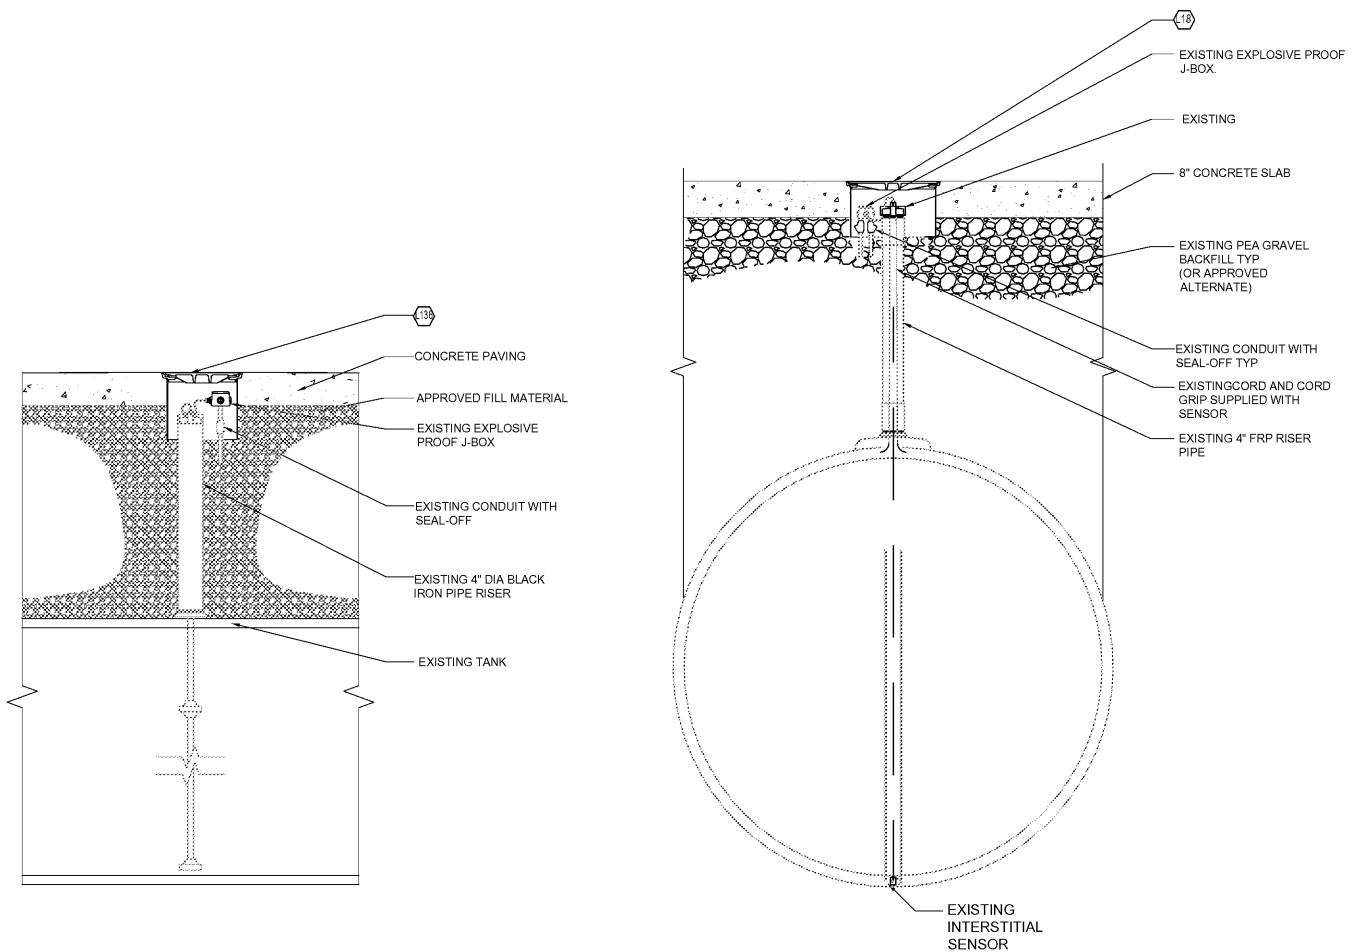


5 EXISTING ATG PROBE
3/4"=1'-0"

4 ANNULAR SPACE RISER AND SENSOR SECTION
1/2"=1'-0"

3 NOT USED
1/4"=1'-0"

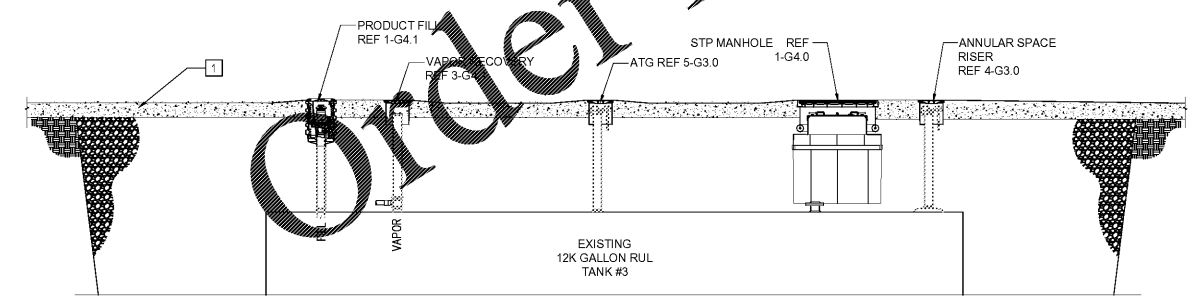

1 EXISTING 12,000 GALLON TANK SECTION
1/4"=1'-0"

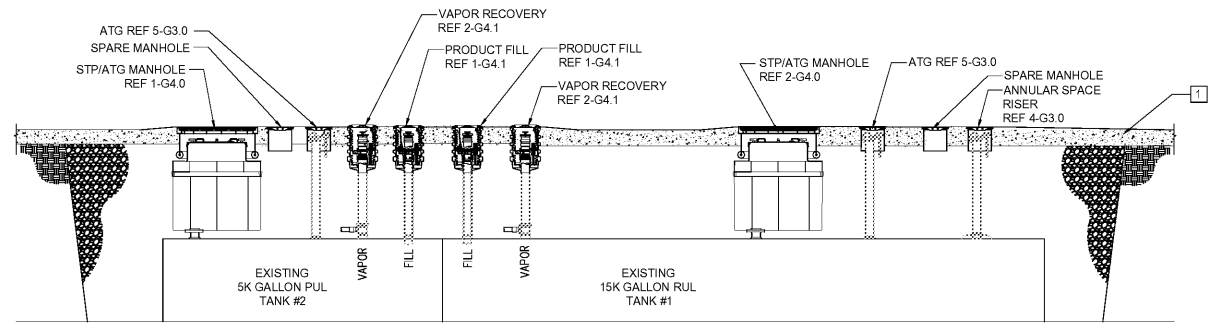

1 EXISTING 20,000 GALLON SPLIT TANK SECTION
1/4"=1'-0"

PRINTED BY: JATANG DRAWING NAME: 41635 - G3.0 TANK SECTIONS.DWG PRINT DATE: Oct 26, 2020 - 5:39pm

Order Plans @ www.LDILine.com

www.LDILine.com

<p>Job#: SEI-29986</p> <p>Scale: AS NOTED</p> <p>Date: 08/05/20</p> <p>Drawn By: LAA</p> <p>Checked By: KMS</p>	<p>7-ELEVEN, INC.</p> <p>3200 HACKBERRY ROAD, IRVING TEXAS 75063</p> <p>7-ELEVEN #41635</p> <p>1401 COVENTRY ROAD</p> <p>MYRTLE BEACH, SC 29575</p> <p>TANK SECTIONS</p>
<p>1700 Northside Drive Riverside, AT 27554 478-334-8489 www.7-eleven.com</p>	
<p>PRELIMINARY DRAWINGS NOT FOR CONSTRUCTION</p>	
<p>SHEET: G3.0</p> <p>FUELING - USA</p>	