



PRINTED BY: LAYLANG
 DRAWING NAME: 41635 - 04.1 TANK SUMP DETAILING
 PRINT DATE: Oct 26, 2020 - 5:00pm

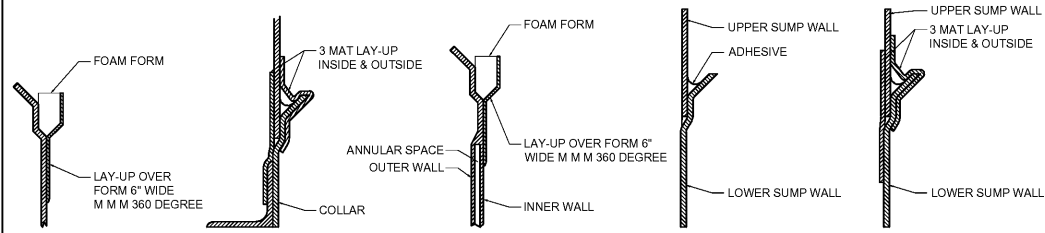


LAY-UP SAMPLES SHOWN ARE FOR REFERENCE ONLY. REFER TO MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR SPECIFIC LAY-UP MATERIALS AND METHODS.

6 TANK SUMP LAYUP DETAILS
 NTS

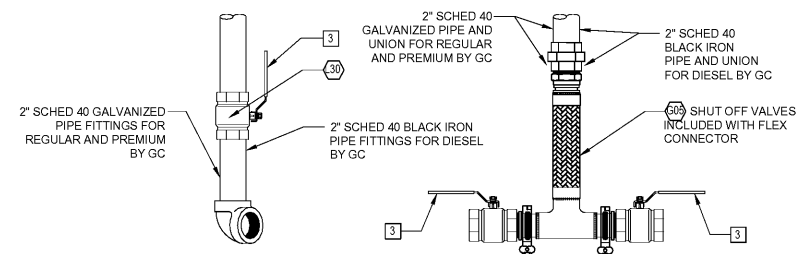

SINGLE PRODUCT OUTPUT
 DUAL PRODUCT OUTPUT

5 FUEL PIPING TREE DETAILS
 1 1/2"=1'-0"

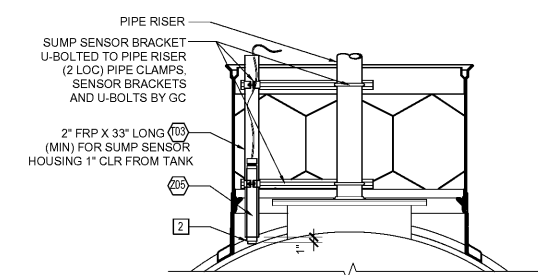


4 SUMP SENSOR AND SENSOR BRACKET DETAIL
 3/4"=1'-0"

KEY NOTES

- CONCRETE SLAB. REF CIVIL DRAWINGS FOR TOS ELEVATIONS. ALL MANHOLES COVERS WITHIN THE TANK SLAB AREA ARE TO BE SET 1" ABOVE THE FINISH GRADE AND SLOPE CONCRETE AWAY FROM MANWAY COVERS AT 2% GRADE. CROWN CONCRETE AS TO NOT INHIBIT WATER DRAINAGE OFF THE TANK SLAB (NO POOLING).
- SUMP SENSOR TO REST AT LOWEST POINT OF SUMP ENCLOSURE ON PRODUCT PIPING SIDE OF SUMP. TANK CONTRACTOR TO SUPPLY UNISTRUT BRACKETS, PIPE CLAMPS AND 2" FRP SLEEVE FOR 2-POINT MOUNTING OF THE SLEEVE.
- POSITION BALL VALVE FOR UNOBSTRUCTED USE OF SHUT-OFF HANDLE.
- OVERFILL PREVENTION VALVE INSTALLED PER MFRS RECOMMENDATION. SET OVERFILL DEVICE FOR RESTRICTION TO FLOW AT OR BELOW 90% TANK CAPACITY AND POSITIVE SHUT-OFF AT 95% TANK CAPACITY TO MEET NFPA 30 REQUIREMENTS.


Rev. #	Date	Description

Proto 11-05-18

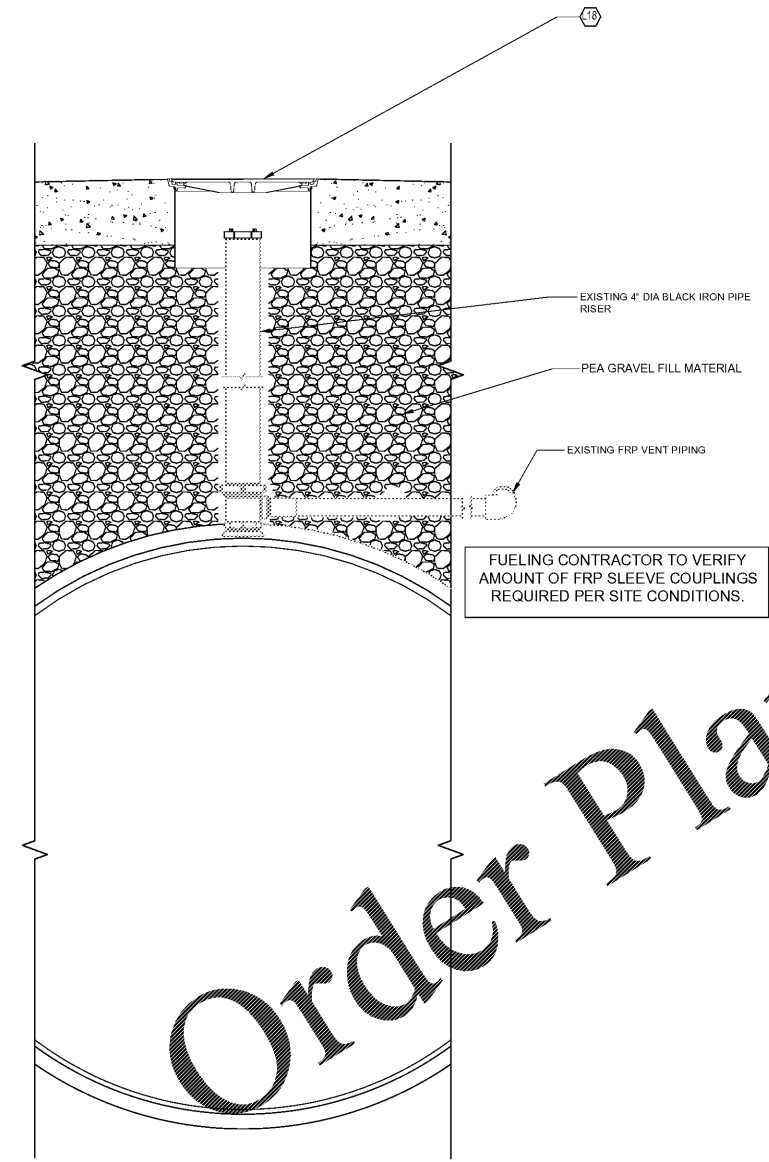


FUELING CONTRACTOR TO VERIFY AMOUNT OF FRP SLEEVE COUPLINGS REQUIRED PER SITE CONDITIONS.

3 DIESEL VENT DETAIL
 1"=1'-0"

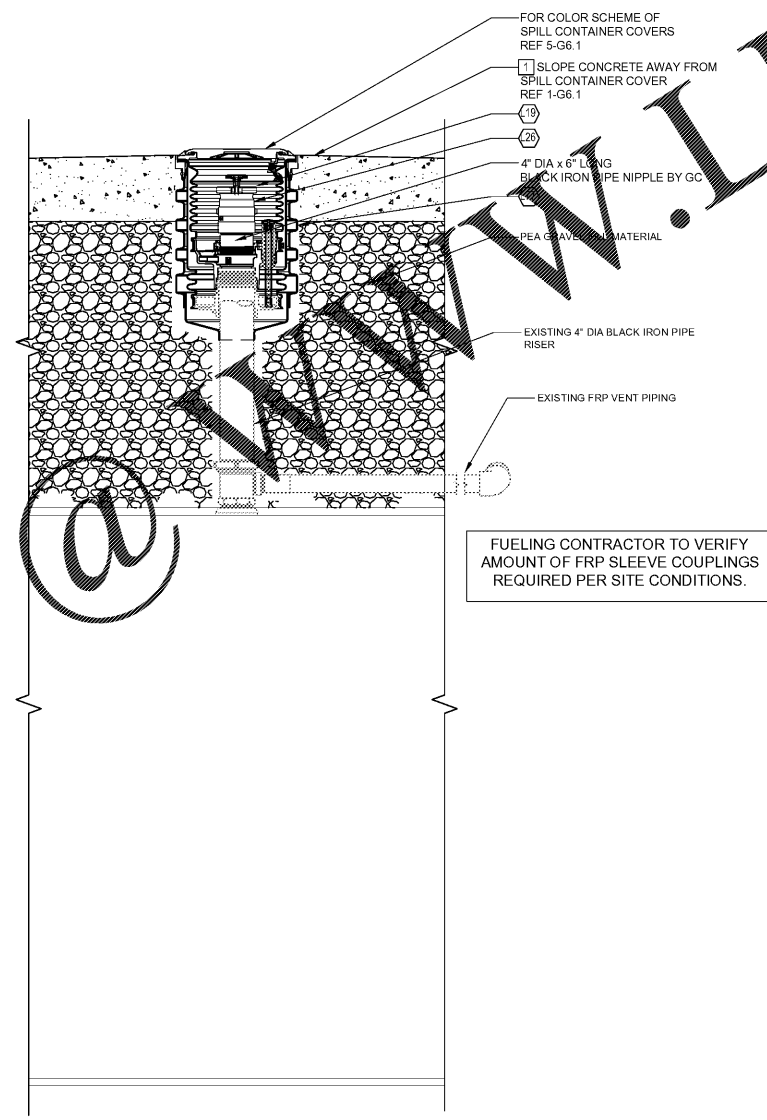

FUELING CONTRACTOR TO VERIFY AMOUNT OF FRP SLEEVE COUPLINGS REQUIRED PER SITE CONDITIONS.



2 RUL / PUL VENT/VAPOR DETAIL
 1"=1'-0"

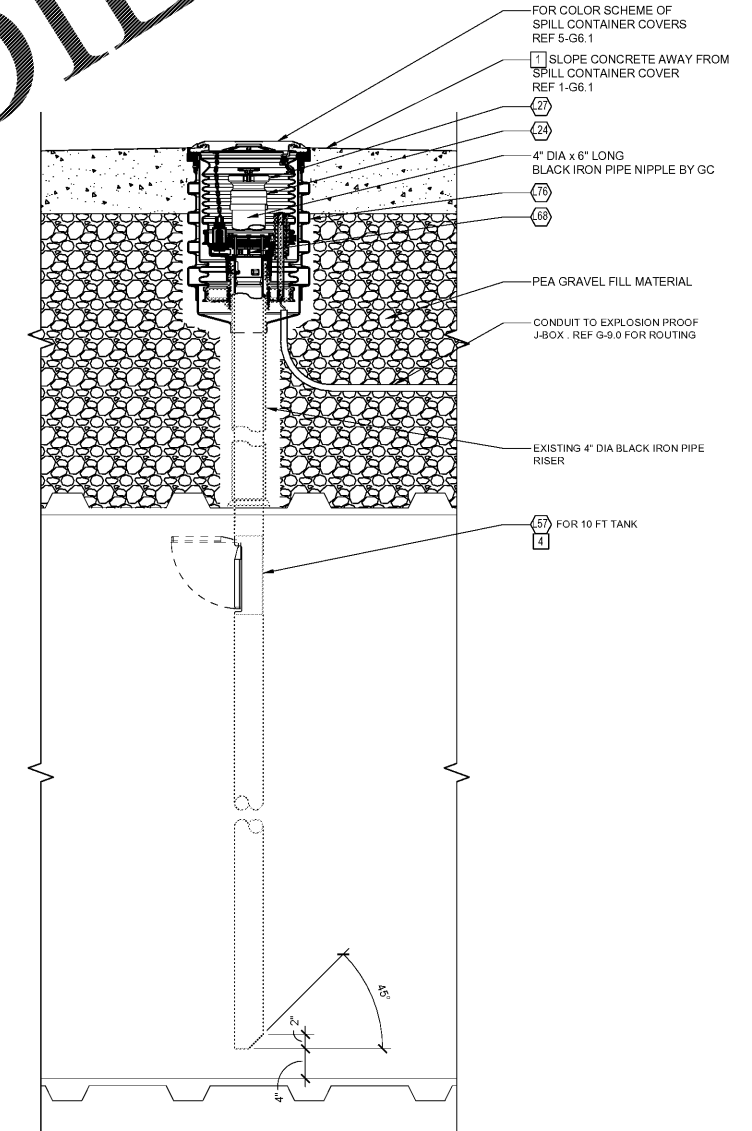

1 FUEL FILL CONTAINER DETAIL
 1"=1'-0"

Order Plans @ www.LDILine.com

7-ELEVEN, INC.
 3200 HACKBERRY ROAD, IRVING TEXAS 75063
 7-ELEVEN #41635
 1401 COVENTRY ROAD
 MYRTLE BEACH, SC 29575
 TANK SUMP DETAILS



Job#: SEI-29986
 Scale: AS NOTED
 Date: 08/05/20
 Drawn By: LAA
 Checked By: KMS

Documents prepared by Core States Group are to be used for the specific project and site conditions for which they are intended. Any extension of use to other projects, by owner or contractor, without the expressed, written consent of Core States Group is prohibited. Core States Group is not responsible for any claims, damages, or losses resulting from the use of these drawings for any project other than that specifically intended. User will hold Core States Group harmless from all claims and losses.



SHEET:
G4.1
 FUELING - USA