
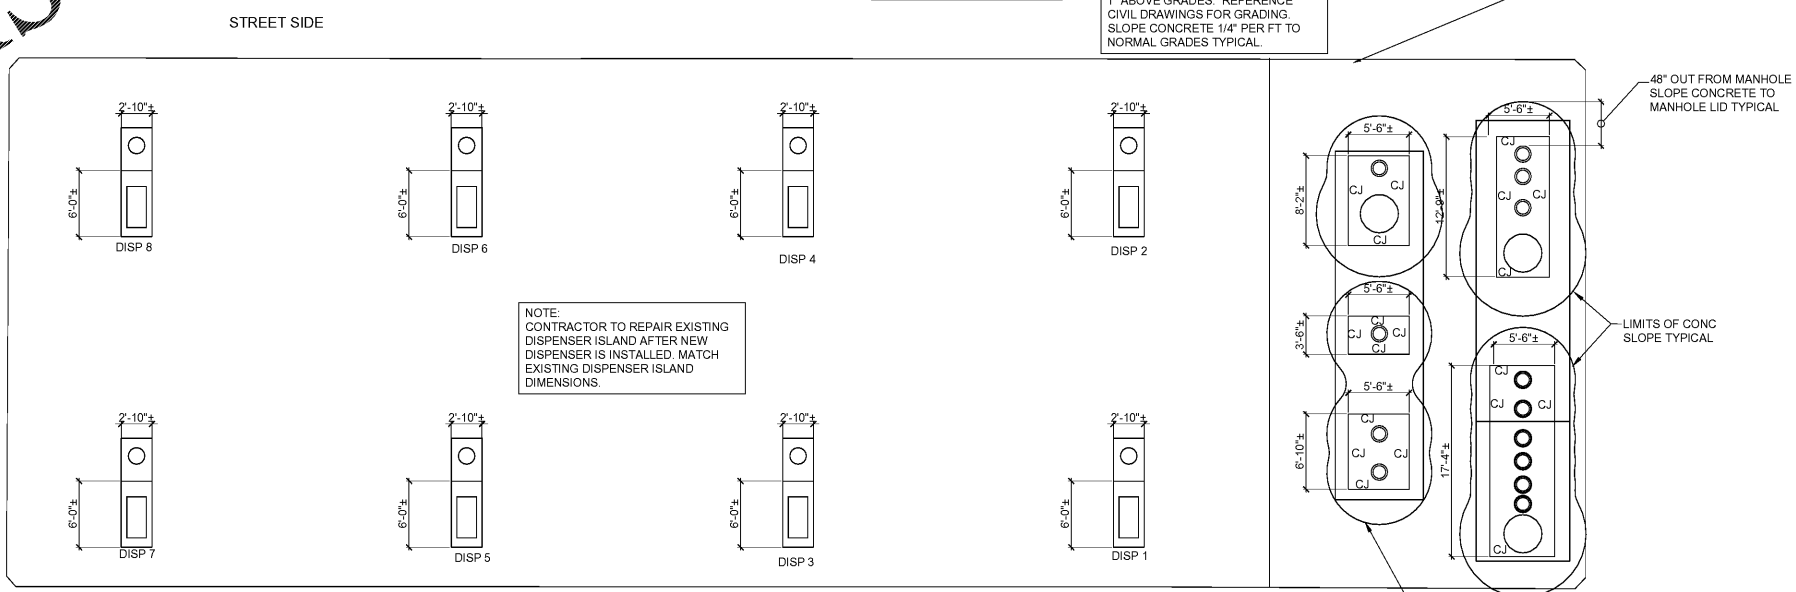
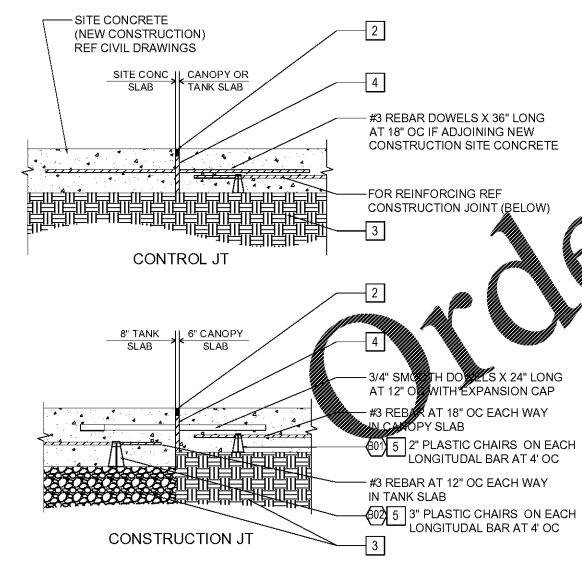
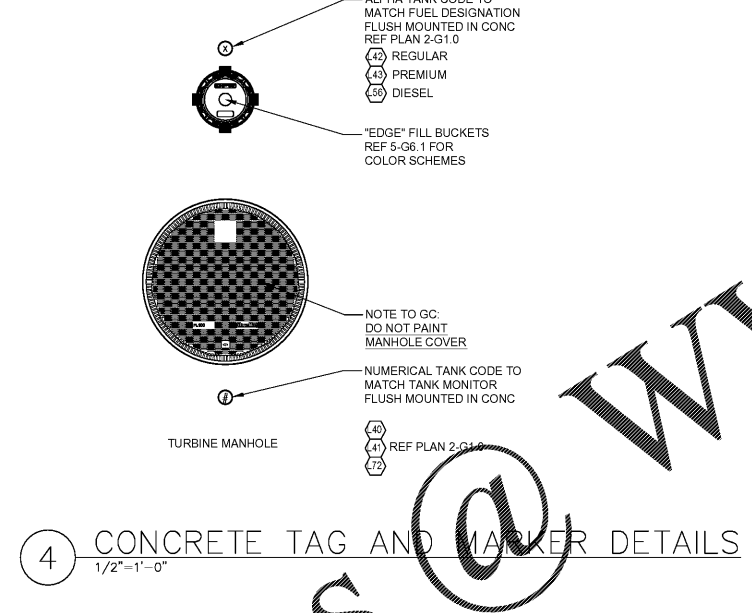




KEY NOTES

- CONCRETE SLAB. REF CIVIL DRAWINGS FOR TOS ELEVATIONS. ALL MANHOLES WITHIN THE TANK SLAB AREA TO BE RAISED 1" ABOVE THE NORMAL GRADE OF CONCRETE. SLOPE CONCRETE TO MANHOLES 1/4" PER FT. CROWN CONCRETE AS TO NOT INHIBIT WATER DRAINAGE OFF THE TANK SLAB (NO POOLING).
- GASOLINE RESISTANT JOINT SEALING COMPOUND - REF SPEC SECTION V CONCRETE / PART 2 - PRODUCTS / 2.1.9.
- UNDISTURBED SOIL OR COMPACTED BACK FILL NOT LESS THAN 95% OF MODIFIED PROCTOR DENSITY (AASHTO-T-180).
- 1/2" THICK ASPHALT IMPREGNATED EXPANSION JOINT MATERIAL.
- PLASTIC CHAIRS PROVIDED BY SUPPLIER. REF G6.1 SHEET FOR CHAIR SIZES, TYPES AND LOCATIONS. REF G7.0 SHEET FOR CLARITY.

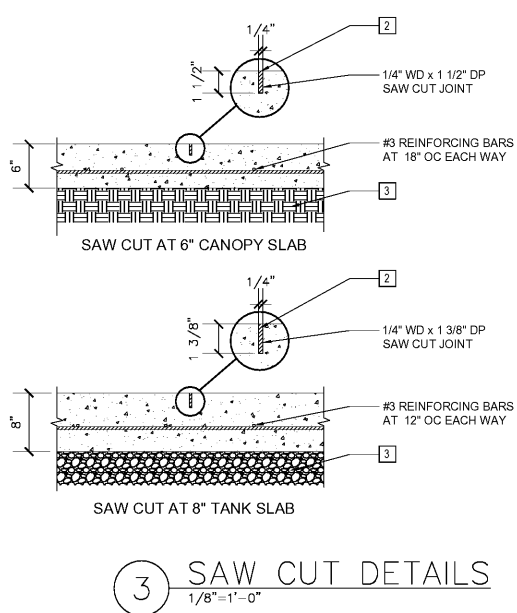


Rev. #	Date	Description

7-ELEVEN, INC.  
3200 HACKBERRY ROAD, IRVING TEXAS 75063  
7-ELEVEN #41635  
1401 COVENTRY ROAD  
MYRTLE BEACH, SC 29575  
FUELING DIMENSIONAL PLAN  
Proto 11-05-18



Job#: SEI-29986  
Scale: AS NOTED  
Date: 08/05/20  
Drawn By: LAA  
Checked By: KMS



SHEET:  
**G6.1**  
FUELING - USA