

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to archSTUDIO7, PLLC without delay. The Copyright to all designs and drawings are the property of archSTUDIO7, PLLC. Reproduction or use for any purpose other than that authorized by archSTUDIO7, PLLC is forbidden.

Consultants:



WAVE ENGINEERING  
1300 S. MINT ST. SUITE 110  
CHARLOTTE, NC 28203  
INFO@WAVEENGINEERING.COM  
NC CORP. LICENSE #6-1881  
WAVE PROJECT #20150

Permit - Seal:

PRELIMINARY  
NOT FOR CONSTRUCTION  
OR PRICING

10/20/2020

NOT FOR  
CONSTRUCTION

Issued / Revisions:	Appd.	Date

Client:



Project:  
**Storage Facility**  
Country Club Rd.  
Winston-Salem, NC

Title:


**FIRST FLOOR  
POWER PLAN**

Date:

Project No.:      Drawn by:

Sheet:

**E-202**

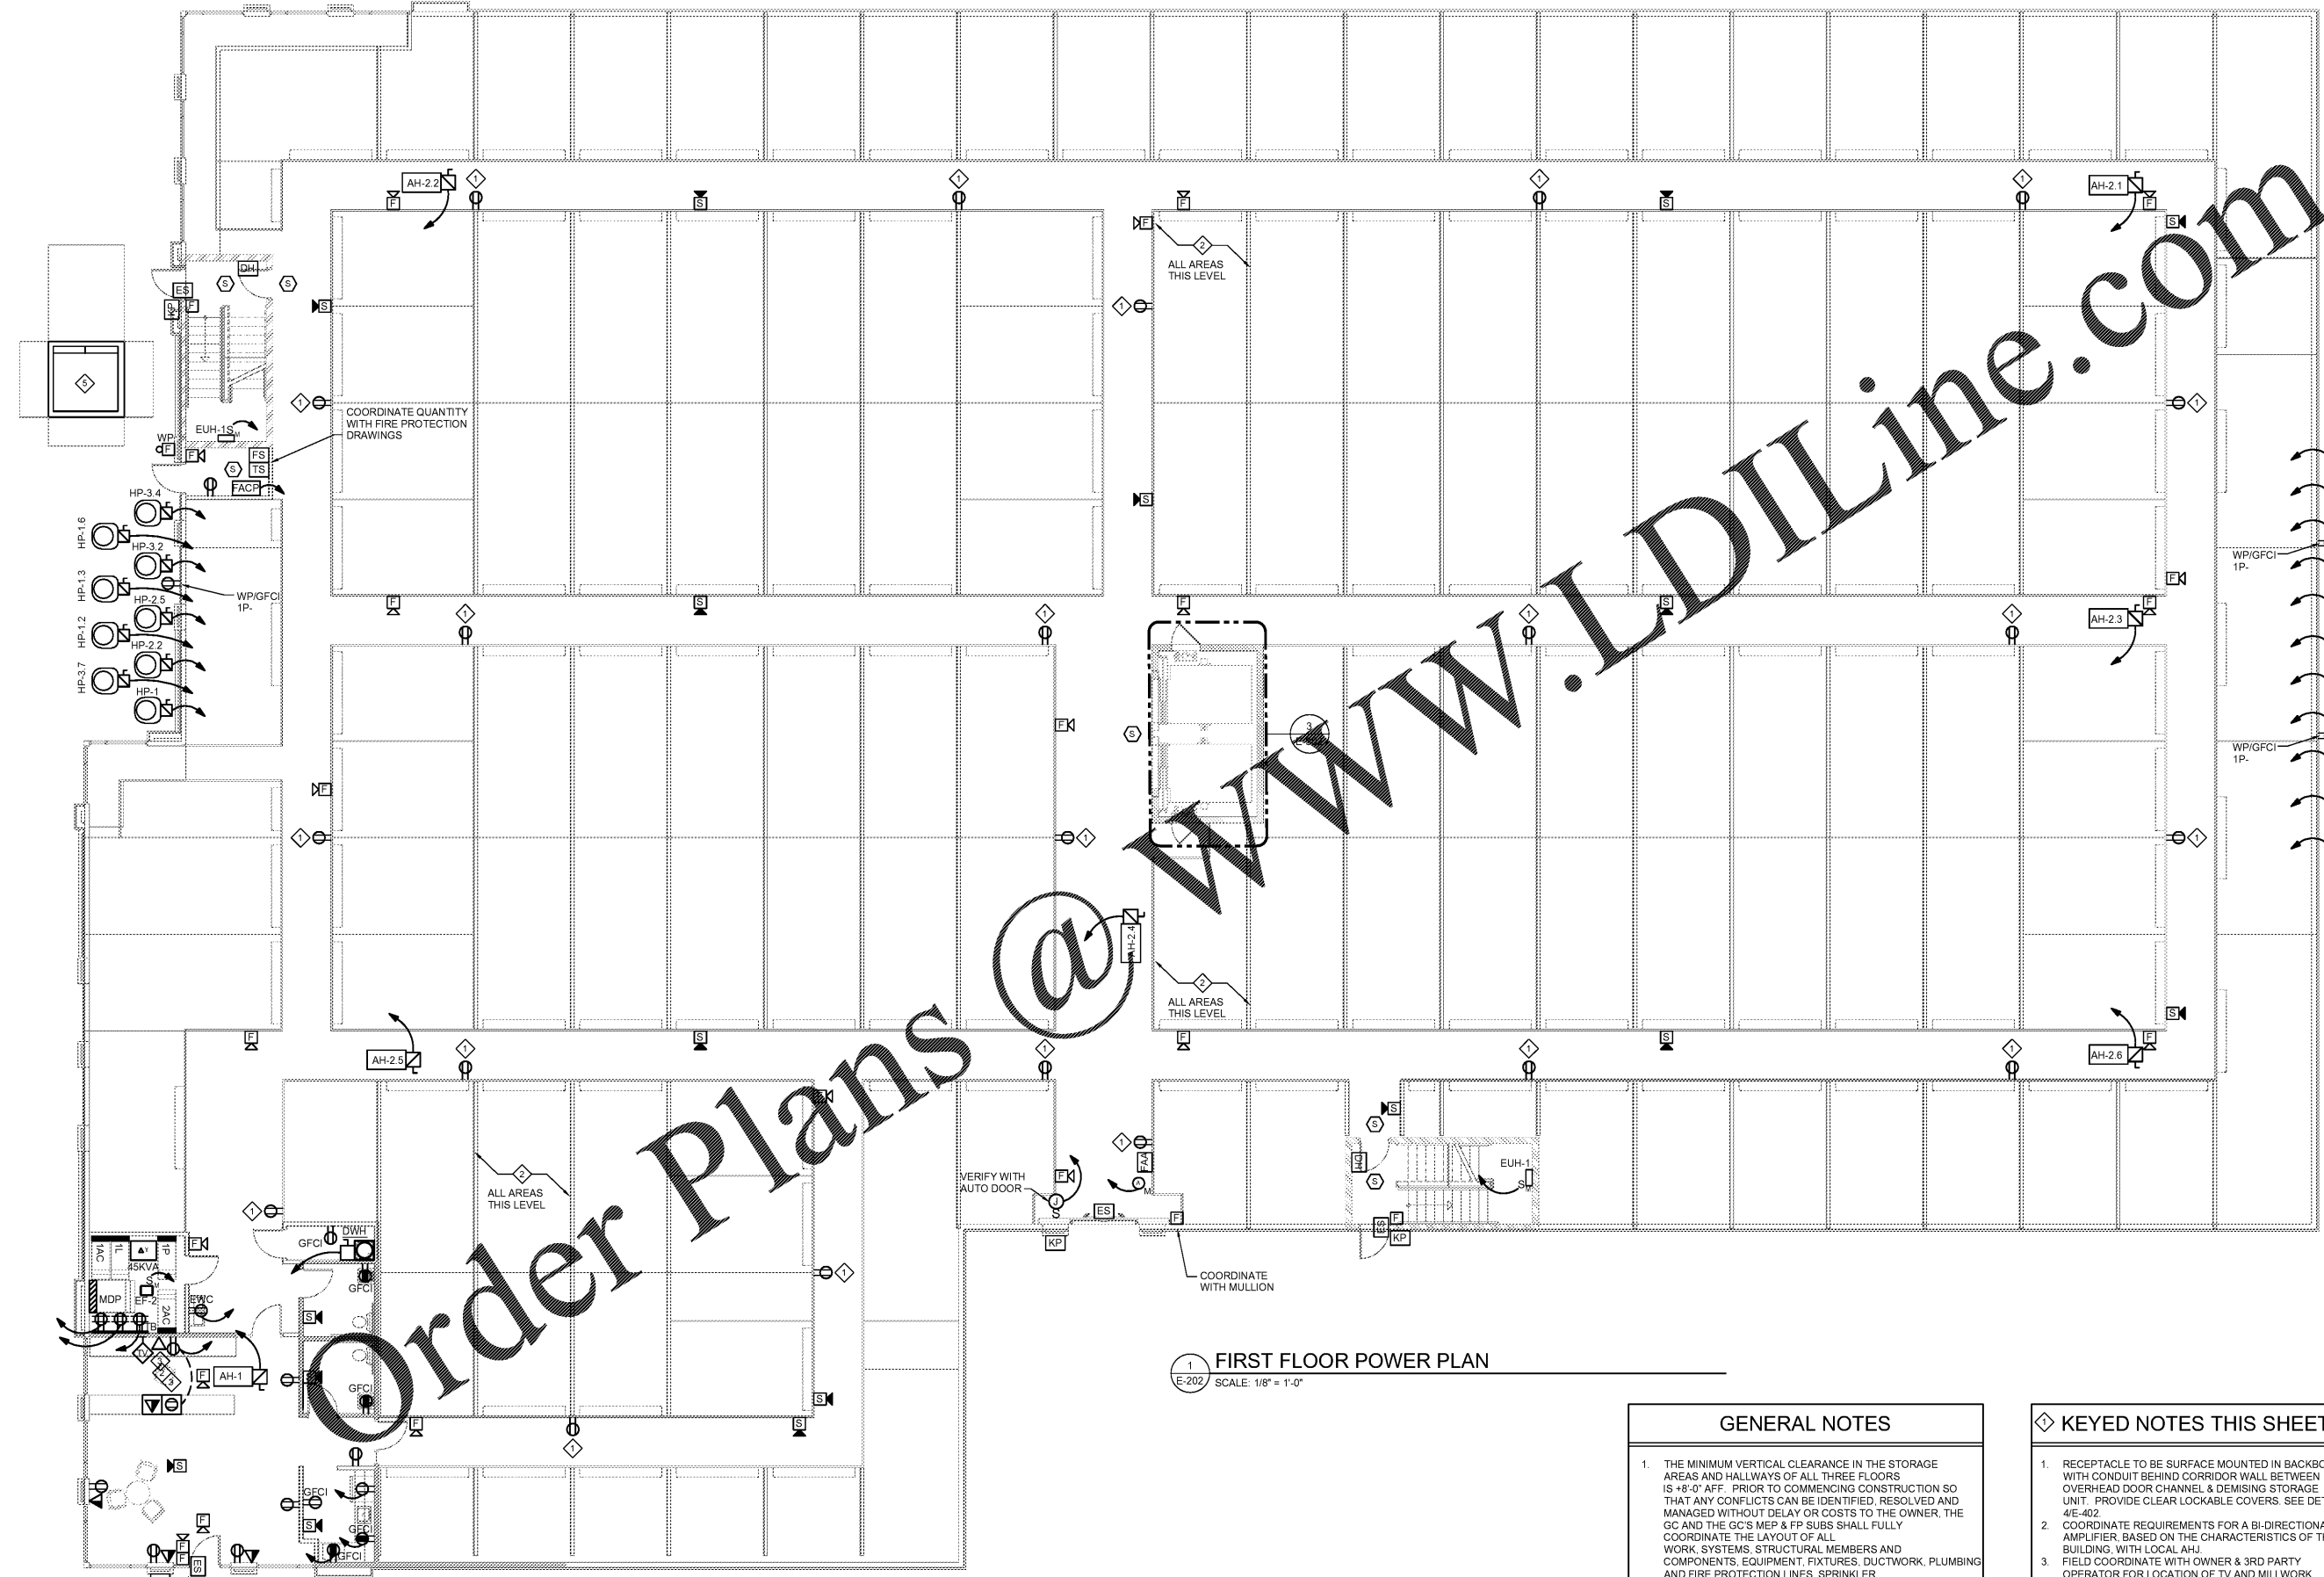

1 FIRST FLOOR POWER PLAN  
E-202 SCALE: 1/8" = 1'-0"

**GENERAL NOTES**

1. THE MINIMUM VERTICAL CLEARANCE IN THE STORAGE AREAS AND HALLWAYS OF ALL THREE FLOORS IS +8'-0" AFF. PRIOR TO COMMENCING CONSTRUCTION SO THAT ANY CONFLICTS CAN BE IDENTIFIED, RESOLVED AND MANAGED WITHOUT DELAY OR COSTS TO THE OWNER, THE GC AND THE GC'S MEP & FP SUBS SHALL FULLY COORDINATE THE LAYOUT OF ALL WORK, SYSTEMS, STRUCTURAL MEMBERS AND COMPONENTS, EQUIPMENT, FIXTURES, DUCTWORK, PLUMBING AND FIRE PROTECTION LINES, SPRINKLER HEADS, ETC. LOCATED IN THE AREA BETWEEN +7'-10" AFF AND THE UNDERSIDE OF THE FLOOR OR ROOF DECK ABOVE.

**KEYED NOTES THIS SHEET**

1. RECEPTACLE TO BE SURFACE MOUNTED IN BACKBOX WITH CONDUIT BEHIND CORRIDOR WALL BETWEEN OVERHEAD DOOR CHANNEL & DEMISING STORAGE UNIT. PROVIDE CLEAR LOCKABLE COVERS. SEE DETAIL 4/E-402.
2. COORDINATE REQUIREMENTS FOR A BI-DIRECTIONAL AMPLIFIER BASED ON THE CHARACTERISTICS OF THE BUILDING, WITH LOCAL AHJ.
3. FIELD COORDINATE WITH OWNER & 3RD PARTY OPERATOR FOR LOCATION OF TV AND MILLWORK RECEPTACLE(S)/DATA.
4. COORDINATE REQUIREMENTS PRIOR TO SLAB POURING.
5. CONCRETE PAD TO BE 8'3" X 9'9". CONFIRM PAD SIZE AND LOCATION FOR TRANSFORMER WITH CIVIL DRAWINGS PRIOR TO ROUGH-IN WORK. PAD BY ELECTRICAL CONTRACTOR.

Order Plans @

WWW.LDILine.com

COORDINATE LOCATION WITH AHJ PRIOR TO ROUGH-IN  
COORDINATE WITH MULLION