

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to archSTUDIO7, PLLC without delay. The Copyright to all designs and drawings are the property of archSTUDIO7, PLLC. Reproduction or use for any purpose other than that authorized by archSTUDIO7, PLLC is forbidden.

Consultants:



WAVE ENGINEERING
 1300 S. MINT ST. SUITE 110
 CHARLOTTE, NC 28203
 INFO@WAVEENGINEERING.COM
 NC CDRP. LICENSE #6-1881
 WAVE PROJECT #20193

Permit - Seal:

PRELIMINARY
 NOT FOR CONSTRUCTION
 OR PRICING

10/20/2020

NOT FOR CONSTRUCTION

Issued / Revisions:	Appd.	Date

Client:




Project:
Storage Facility
 Country Club Rd.
 Winston-Salem, NC

Title:

THIRD FLOOR POWER PLAN

Date:	
Project No.:	
Drawn by:	
Sheet:	

E-203

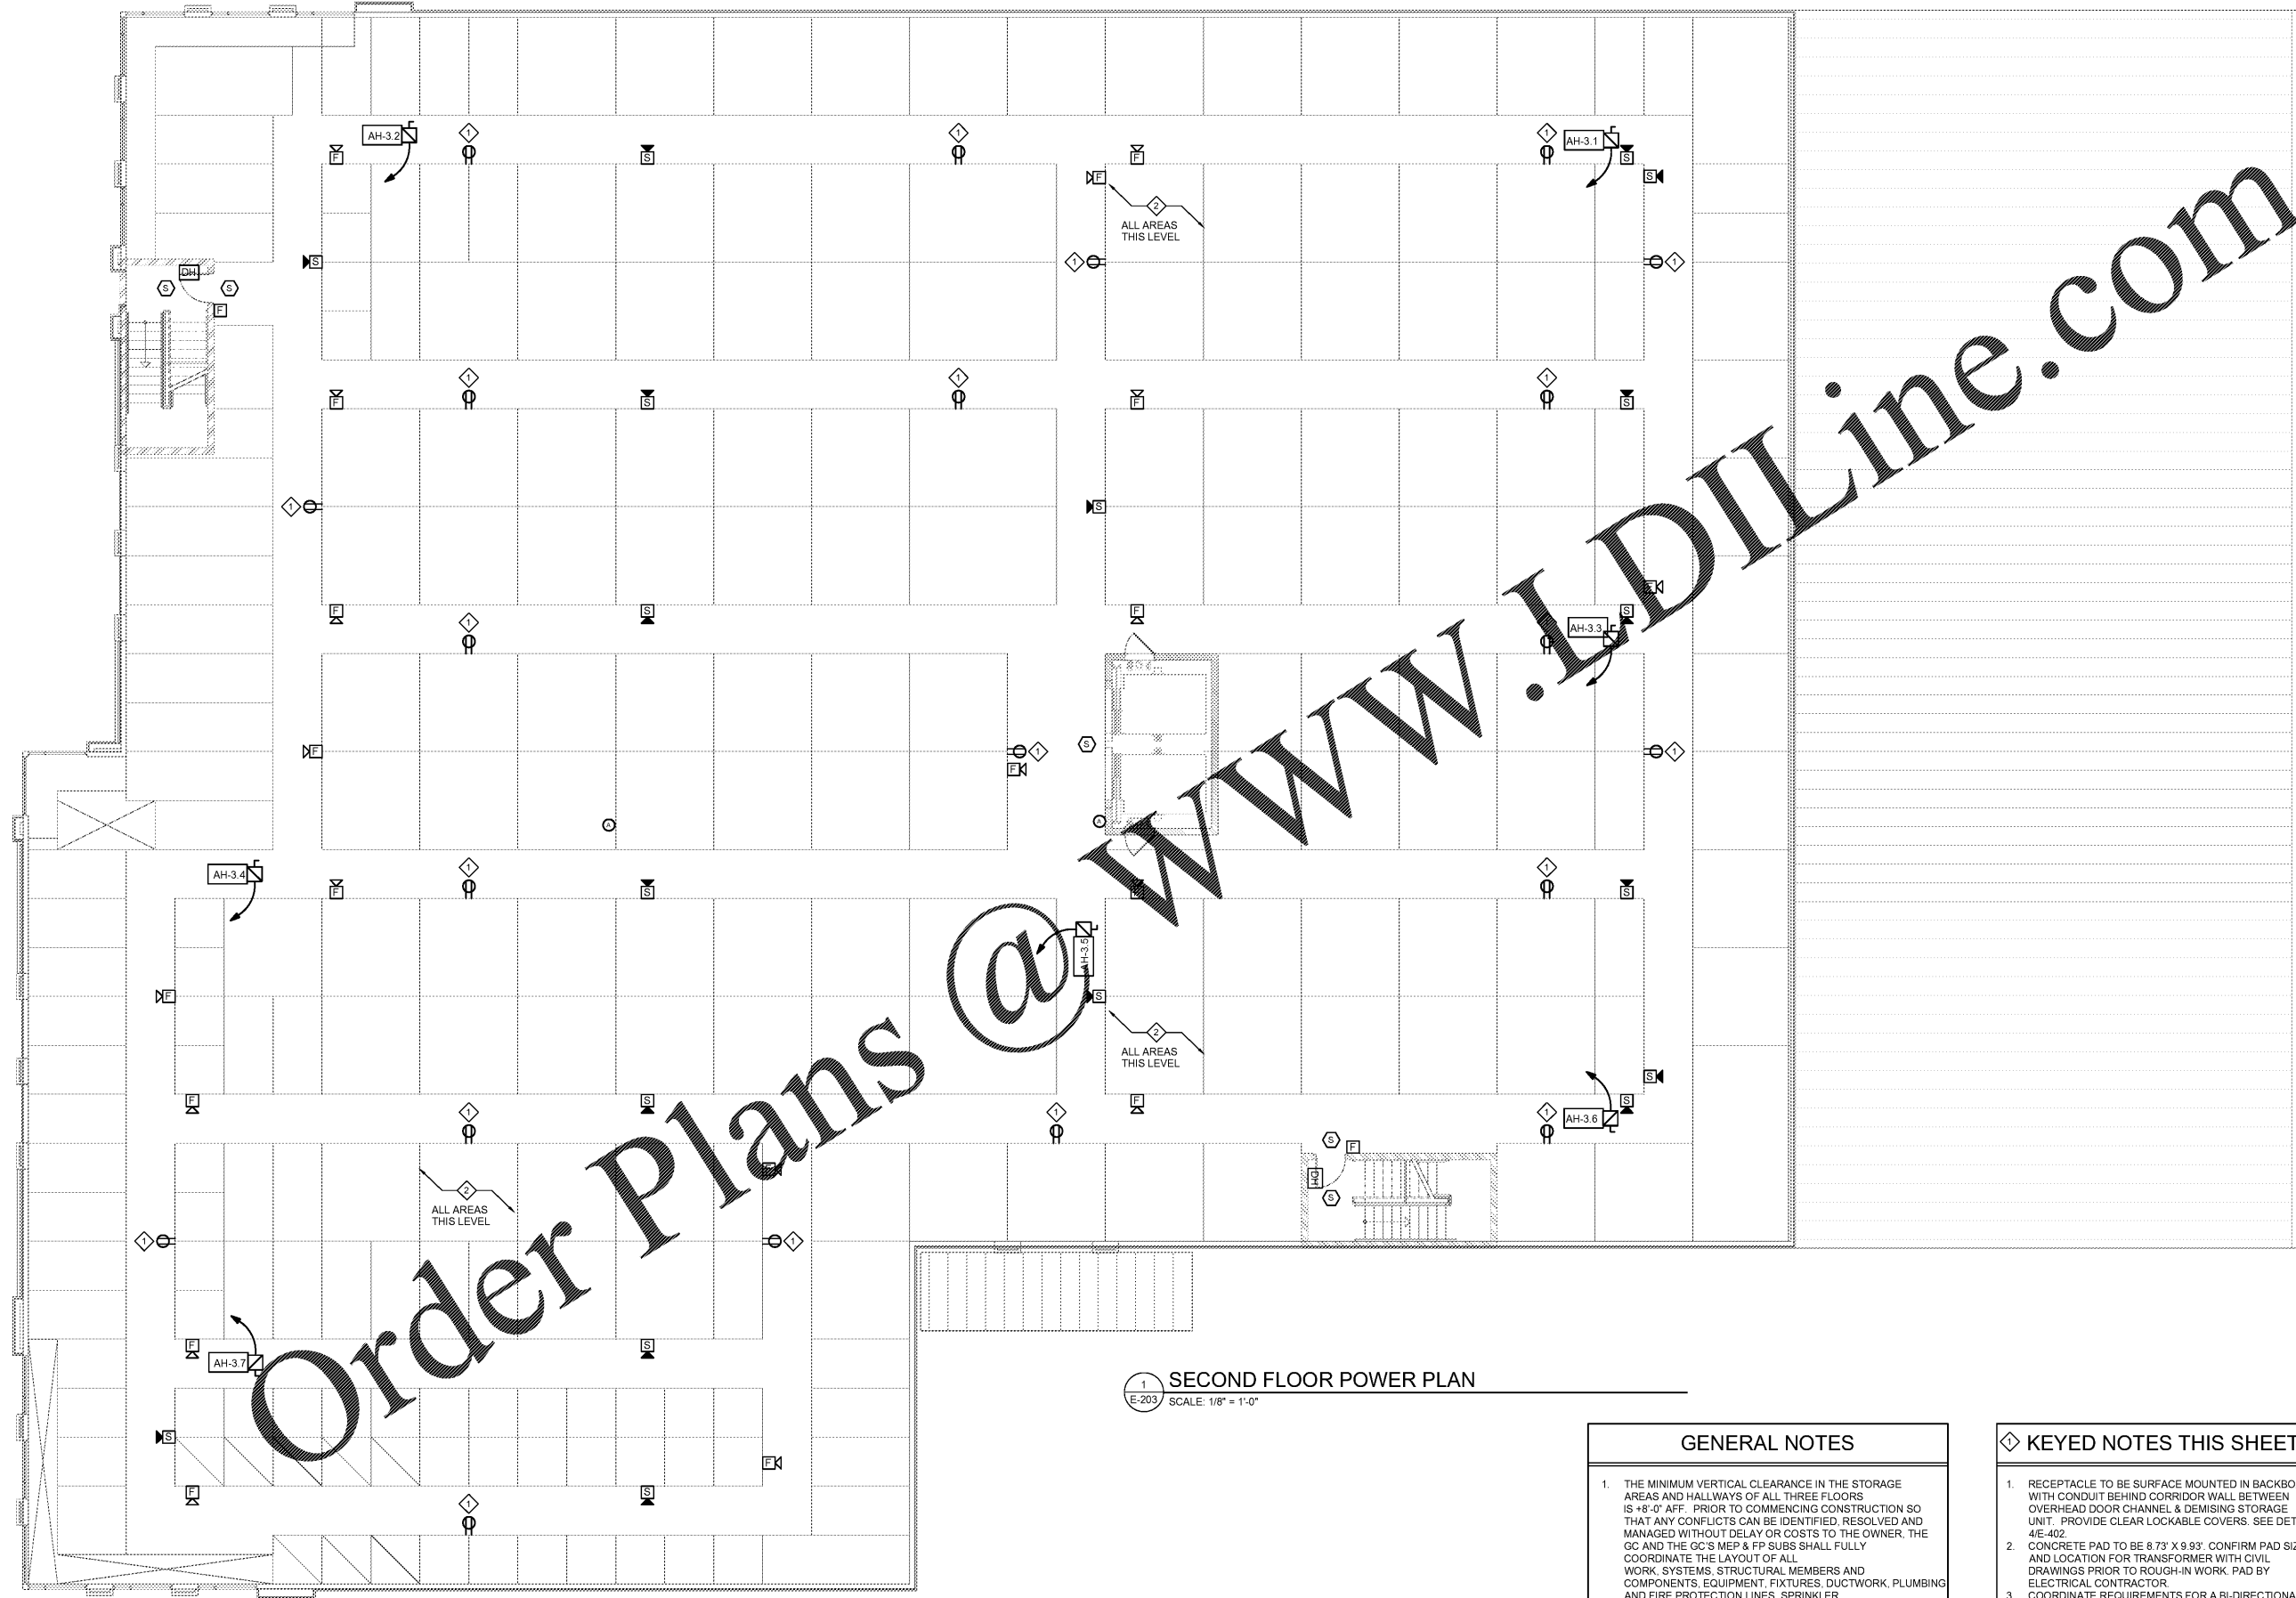

1 SECOND FLOOR POWER PLAN
 E-203 SCALE: 1/8" = 1'-0"

GENERAL NOTES

1. THE MINIMUM VERTICAL CLEARANCE IN THE STORAGE AREAS AND HALLWAYS OF ALL THREE FLOORS IS +8'-0" AFF. PRIOR TO COMMENCING CONSTRUCTION SO THAT ANY CONFLICTS CAN BE IDENTIFIED, RESOLVED AND MANAGED WITHOUT DELAY OR COSTS TO THE OWNER, THE GC AND THE GC'S MEP & FP SUBS SHALL FULLY COORDINATE THE LAYOUT OF ALL WORK, SYSTEMS, STRUCTURAL MEMBERS AND COMPONENTS, EQUIPMENT, FIXTURES, DUCTWORK, PLUMBING AND FIRE PROTECTION LINES, SPRINKLER HEADS, ETC. LOCATED IN THE AREA BETWEEN +7'-10" AFF AND THE UNDERSIDE OF THE FLOOR OR ROOF DECK ABOVE.

KEYED NOTES THIS SHEET

1. RECEPTACLE TO BE SURFACE MOUNTED IN BACKBOX WITH CONDUIT BEHIND CORRIDOR WALL BETWEEN OVERHEAD DOOR CHANNEL & DEMISING STORAGE UNIT. PROVIDE CLEAR LOCKABLE COVERS. SEE DETAIL 4/E-402.
2. CONCRETE PAD TO BE 8'3" X 9'93" CONFORM PAD SIZE AND LOCATION FOR TRANSFORMER WITH CIVIL DRAWINGS PRIOR TO ROUGH-IN WORK. PAD BY ELECTRICAL CONTRACTOR.
3. COORDINATE REQUIREMENTS FOR A BI-DIRECTIONAL AMPLIFIER, BASED ON THE CHARACTERISTICS OF THE BUILDING, WITH LOCAL AHJ.

Order Plans @ www.LDILine.com