



1 ENLARGED REFLECTED CEILING PLAN  
HUB2 1/4" = 1'-0"

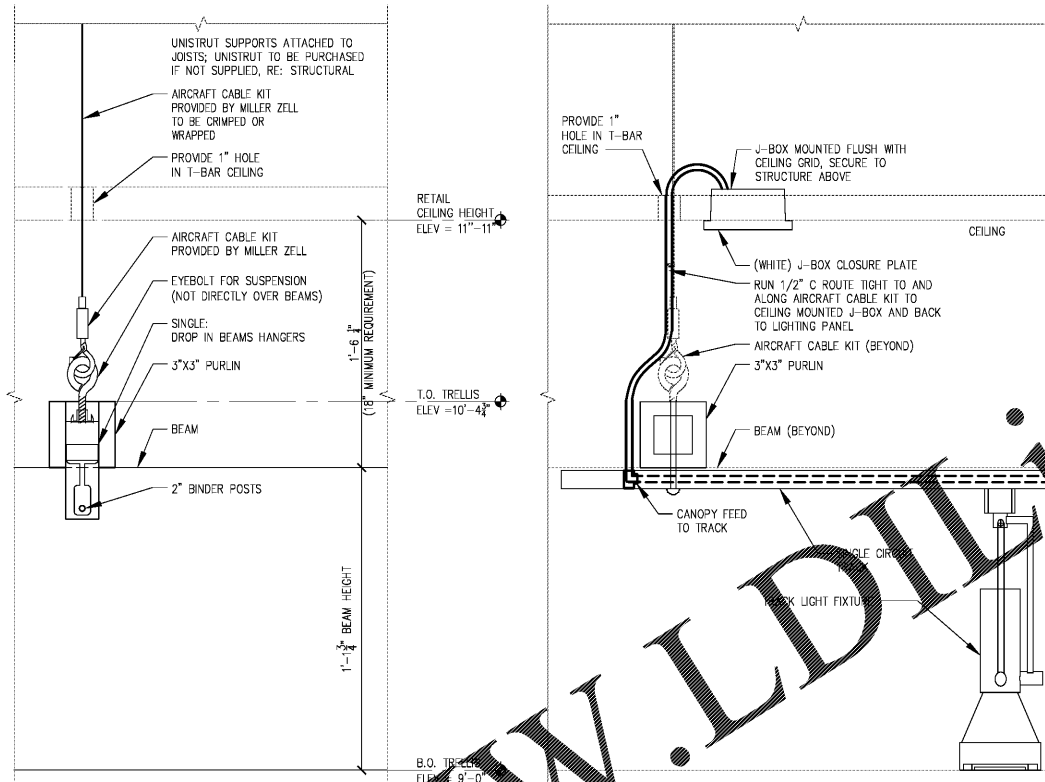

3 SUSPENSION AT PURLIN SECTION HUB2 3" = 1'-0"  
4 TRACK LIGHT STRIP SECTION HUB2 3" = 1'-0"

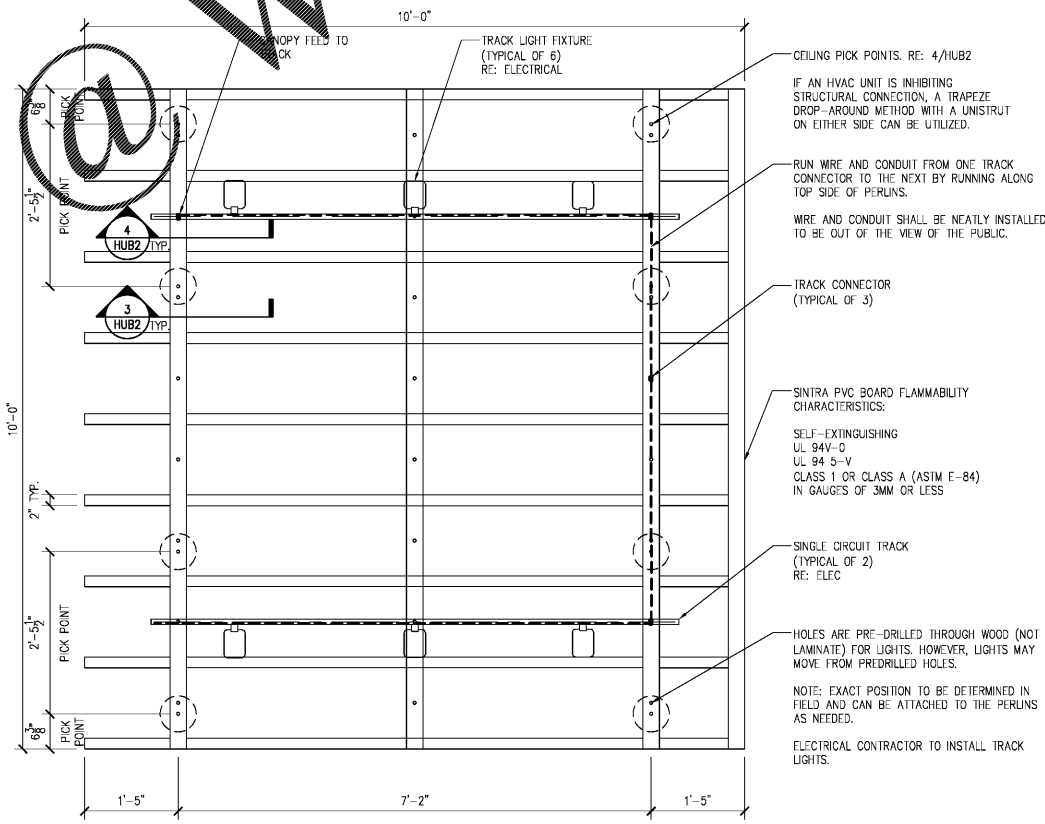

2 ENLARGED TRELLIS PLAN VIEW  
HUB2 3/4" = 1'-0"

**NOTES**

- INSTALL NEW/RELOCATE POWER POLES. REFER TO ELECTRICAL DWGS.
- EXISTING PERIMETER SIGNAGE TO BE CONSISTENT WITH CURRENT CVS STANDARDS. GC AND CVS CPM TO COORDINATE DEMO, RELOCATION, AND/OR RE-USE OF ALL EXISTING GRAPHICS.
- RELOCATION OF EXISTING SECURITY CAMERAS, MOTION DETECTORS, AND SECURITY EQUIPMENT BY CVS VENDOR. GC SHALL COORDINATE INSTALLATION WITH VENDOR. REPLACE ANY STAINED OR DAMAGED CEILING TILE THROUGHOUT ENTIRE STORE AS DETERMINED DURING PRE-BID WALKTHROUGH. REPAIR OR REPLACE ANY DAMAGED OR INOPERABLE LIGHT FIXTURES AS REQUIRED.
- RELOCATE/INSTALL NEW AISLE MARKERS PER CVS SET-UP MANAGER.
- CLEAN ALL EXISTING HVAC DIFFUSERS AND LIGHT FIXTURE LENSES THROUGHOUT THE ENTIRE STORE.
- GENERAL CONTRACTOR SHALL COORDINATE REVISION CEILING GRID AND LIGHTING FIXTURE LOCATIONS WITH EXISTING CEILING DIFFUSERS AND REGISTERS. GC SHALL RELOCATE DIFFUSERS AND REGISTERS AS REQUIRED TO FACILITATE CEILING GRID MODIFICATIONS AND/OR RELOCATION OF LIGHT FIXTURES. PROVIDE ADDITIONAL SHEET METAL, FLEX DUCT, HANGERS AND ACCESSORIES AS REQUIRED TO RELOCATE AIR TERMINAL DEVICES. HVAC AIR TERMINAL DEVICES TO BE MODIFIED SHALL CONFORM TO SMACNA STANDARDS. UPON PROJECT COMPLETION, AIR TERMINAL DEVICES AND MINIMUM 5' OF ASSOCIATED BRANCH DUCTWORK SHALL BE CLEANED FREE OF DUST AND DEBRIS. MODIFICATION TO EXISTING VENTILATION AIR FLOW SHALL NOT BE PERMITTED.

**LEGEND**

---	EXISTING PARTITION	REMAIN	NEW GYPSUM WALLBOARD CEILING
---	EXISTING NEW PARTITION	RELOCATE	NEW ACOUSTICAL CEILING TILE AND CEILING GRID
---	NEW PARTITION	RELOCATE	EXISTING ACOUSTICAL CEILING TILE TO REMAIN
---	NOTE DESIGNATION	RELOCATE	FIXTURE DESIGNATIONS
---	COLUMN GRID	RELOCATE	NOT LABELED
---	EXISTING CEILING JOIST TO REMAIN	RELOCATE	EXISTING TO REMAIN
---	NEW CEILING JOIST	RELOCATE	NEW

**CEILING FIXTURE SCHEDULE**

EXISTING/DEMO/NEW SYMBOL	DESCRIPTION
○	2x4 LIGHTS
□	1x4 LIGHTS
•	MONOPOINT LIGHTS
—	STRIP LIGHTS
—	STRIP LIGHTS
⊗	EXIT SIGNS
⊕	EMERGENCY LIGHTS
•	POWER DROP
⊙	POWER POLE
⊙	SPEAKER
⊙	SECURITY CAMERA BUBBLE
⊙	SECURITY MOTION SENSOR
⊙	SPRINKLER HEAD
⊙	HVAC SUPPLY
⊙	HVAC RETURN
⊙	HVAC EXHAUST

**CEILING NEW NOTES BY SYMBOL**

- INSTALL NEW/RELOCATED LIGHT FIXTURES AS SHOWN/SCHEDULED. RE: ELECTRICAL
- INSTALL NEW/RELOCATED EMERGENCY LIGHT FIXTURES AS SHOWN/SCHEDULED. RE: ELECTRICAL
- INSTALL NEW LIGHTED "EMERGENCY EXIT" SIGNAGE AS SHOWN. RE: ELECTRICAL
- GC TO COORDINATE WITH CVS VENDOR FOR RELOCATION/INSTALLATION OF ALL SECURITY EQUIPMENT, INCLUDING CAMERAS AND MOTION DETECTORS.
- GC SHALL COORDINATE FIRE ALARM SYSTEM MODIFICATIONS WITH THE CVS VENDOR AND RELOCATE EXISTING STROBES AS REQUIRED.
- INSTALL NEW POWER DROP AS SHOWN. RE: ELECTRICAL
- GC TO PURCHASE AND INSTALL (3) CASES OF CEILING TILES AS SCHEDULED TO REPLACE DAMAGED/STAINED TILES THROUGHOUT.
- CLEAN EXISTING HVAC DIFFUSERS.
- INSTALL NEW/EXISTING HVAC SUPPLY/RETURN VENTS AS SHOWN. RE: MECHANICAL
- INSTALL NEW TRELLIS PROVIDED BY MILLER ZELL, CENTERED WITHIN RHC WAITING. RE: 1/HUB2
- INSTALL NEW TRACK LIGHTING AS SHOWN. RE: ELECTRICAL
- INSTALL NEW/EXISTING SPEAKERS AS SHOWN. RE: ELECTRICAL
- INSTALL NEW POWER POLE AS SHOWN. RE: ELECTRICAL
- INSTALL NEW MONOPOINT LIGHTING AS SHOWN. RE: ELECTRICAL



HEALTH HUB/Rx CONSULTATION  
STORE NUMBER: 4176

11 RIVER RIDGE DRIVE, OAKLEY PLAZA  
ASHEVILLE, NC 28803  
CAP CODE: 90

CS PROJECT NUMBER: 146740

ARCHITECT OF RECORD:



This drawing and the design shown are the property of Little Architecture, a professional consulting firm. The reproduction, copying or alteration of this drawing without the written consent of the architect is prohibited and any infringement will be subject to legal action.



DEVELOPER:



SEAL:



REVISIONS:

DRAWING BY: JC

CVS PROJECT MANAGER: RJ

DATE: 11-02-2020

JOB NUMBER: 121-14217-08

TITLE: HEALTHHUB ENLARGED CEILING PLAN

SHEET NUMBER: HUB2

COMMENTS: