


NOTE: PROVIDE POWER TO GONDOLA VIA SO CORD WITH ALL COMPONENTS INCLUDING BUT NOT LIMITED TO STRAIN RELIEF FOR A COMPLETE AND STATIONARY INSTALLATION. JUNCTION BOX TO BE FLUSH MOUNTED WITH CEILING GRID AND SECURED TO STRUCTURE ABOVE.


POWER DROP TO BE USED AS LEGRAND WIREMOLD POWER DROP #PD123180WH

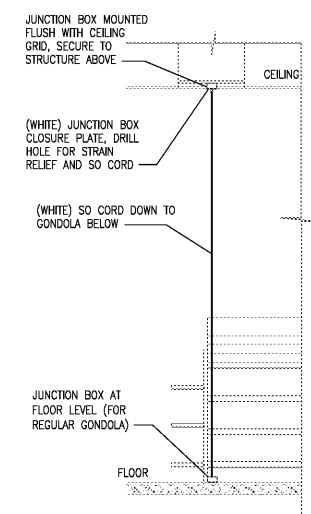

NOTE: PROVIDE POWER TO GONDOLA VIA SO CORD WITH ALL COMPONENTS INCLUDING BUT NOT LIMITED TO STRAIN RELIEF FOR A COMPLETE AND STATIONARY INSTALLATION. JUNCTION BOX TO BE FLUSH MOUNTED WITH CEILING GRID AND SECURED TO STRUCTURE ABOVE.

POWER DROP TO BE USED AS LEGRAND WIREMOLD POWER DROP #PD123180WH

3 POWER DROP SUPPLY DETAIL
E4 SCALE: NTS

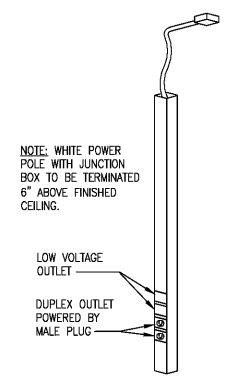


5 POWER POLE DETAIL
E4 SCALE: NTS

- GENERAL NOTES**
- CONTRACTOR SHALL COORDINATE ALL FINAL LOCATIONS FOR POINTS OF ELECTRICAL SERVICE (JUNCTION BOXES, STUB-UPS, RECEPTACLES, TELE/DATA OUTLETS, ETC.) WITH EQUIPMENT INSTALLER AND CVS REPRESENTATIVE PRIOR TO INSTALLATION.
 - ELECTRICAL CONTRACTOR SHALL LABEL ALL CIRCUITS TO BE ABANDONED FROM REMODEL OF STORE AS "SPARE" IN PANEL(S).
 - ALL UNUSED WIRING IN CEILING/FLOOR SPACE SHALL BE PULLED BACK TO SOURCE AND REMOVED.
 - REFER TO ARCHITECTURAL PLANS AND ELECTRICAL PLAN FOR DEMOLITION.
 - REUSE EXISTING CIRCUITS FROM REMOVED EQUIPMENT WHEN POSSIBLE. ABANDONED CIRCUITS SHALL BE REMOVED BACK TO SOURCE.
 - CONTRACTOR TO VERIFY ALL EXISTING PANEL LOADING IN FIELD AS REQUIRED, PRIOR TO ANY NEW WORK.
 - PANEL CIRCUIT DIRECTORY TO COMPLY WITH SEC 408.4. CEC.
 - MOUNT THE FOLLOWING ABOVE FINISH FLOOR:
OUTLETS 18" TO 48"
SWITCHES 36" TO 48"
THERMOSTATS TO

- KEYED NOTES - NEW WORK**
- PROVIDE POWER TO GONDOLA VIA POWER DROP WITH ALL COMPONENTS INCLUDING BUT NOT LIMITED TO STRAIN RELIEF FOR A COMPLETE AND STATIONARY INSTALLATION. JUNCTION BOX TO BE FLUSH MOUNTED WITH CEILING GRID AND SECURED TO STRUCTURE ABOVE. REFER TO 3/E4.
 - INSTALL QUAD RECEPTACLE MOUNTED SIDWAYS ON GONDOLA BASE FOR SHELVING LIGHTING. CONCEAL ALL WIRING FROM RECEPTACLE TO POWER DROP WITHIN GONDOLA. COMPLETE ALL SHELVING LIGHTING CONNECTION AS REQUIRED. CONNECT TO EMS/TIMER ALONG WITH RETAIL SHELVING LIGHTING. REFER TO 3/E4.
 - INSTALL DEDICATED QUAD RECEPTACLE MOUNTED ON GONDOLA BASE FOR VIDEO TRENDCAPS. CONCEAL ALL WIRING FROM RECEPTACLE TO POWER DROP WITHIN GONDOLA. COMPLETE ALL CONNECTION AS REQUIRED. DO NOT CONNECT TO EMS.
 - RELOCATE / PROVIDE WIRING CHASE TO BE AS MANUFACTURED BY WEIDENBACH-BROWN WITH ALL COMPONENTS FOR A COMPLETE AND STATIONARY INSTALLATION. PROVIDE JUNCTION BOX 6" ABOVE CEILING FOR WIRING CHASE CONNECTION. VERIFY LENGTH OF WIRING CHASE REQUIRED PRIOR TO ORDERING.
 - RELOCATED ACO(S), FLM(S), POSTER PRINTER, DUPLEX PRINTER, APEX PROCESSOR, AND KODAK PRINTER WITH ASSOCIATED CONTROL. EXTEND CIRCUIT AS NEEDED.
 - RELOCATE / PROVIDE A NEMA 5-20R DUPLEX RECEPTACLE MOUNTED HORIZONTALLY AT 5" AFF TO CENTER FOR POS TERMINAL. PROVIDE LABEL READING "KICKPLATE RECEPTACLE". EXTEND EXISTING CIRCUIT AS NEEDED.
 - RELOCATE / PROVIDE A NEMA 5-20R DUPLEX RECEPTACLE NEAR THE CONDUIT STUB-UP UNDER THE FIXTURE BASE FOR MONITOR CHECK PRINTER AND CHECKPOINT UNDERCOUNTER EQUIPMENT. EXTEND EXISTING CIRCUIT AS NEEDED. VERIFY EXACT STUB-UP CONDUIT LOCATION IN FIELD.
 - REINSTALL CHECKOUT AND PHOTOLAB ELECTRICAL COMPONENTS. IF REQUIRED, TRENCH FLOOR SLAB AS NEEDED TO RUN NEW/EXISTING POWER TO CHECKOUT AREA. EXTEND EXISTING CIRCUITS AS NEEDED.
 - PROVIDE 1" CONDUIT DOWN TO 1'-6" AFF TO J-BOX WITH PULLSTRING FOR LOW VOLTAGE WIRING.
 - NEW PHARMACY CASEWORK SECTION. RECONNECT EXISTING CIRCUITS.
 - PROVIDE / RELOCATE POWER POLE FOR FUTURE USE IN Rx CONSULT ROOM. REFER TO POWER POLE DETAIL.
 - PROVIDE DEDICATED QUAD RECEPTACLE AT 7'-5" AFF FOR IS RACK. COMPLETE ALL CONNECTION TO EXISTING COMMUNICATION CONTROLLERS.
 - RELOCATED DEACTIVATION BUTTON AT 42" AFF AND RECONNECT. EXTEND WIRING AS NEEDED. COORDINATE WITH ALARM VENDOR PRIOR TO ANY WORK.
 - RELOCATED J-BOX FOR STOCKROOM ACCESS ALARM FLUSH MOUNTED AT 42" AFF WITH 3/4" C FROM J-BOX TO ACCESS ALARM PANEL ABOVE DOOR.
 - RELOCATED RECEPTACLE FOR STOCKROOM ACCESS ALARM LOCATED ABOVE DOOR IN RECEIVING AREA. EXTEND EXISTING CIRCUIT AS NEEDED.

GC TO COORDINATE WITH CVS VENDOR FOR RELOCATION /REINSTALLATION OF ALL CAMERAS, MOTION DETECTORS, SECURITY EQUIPMENT INCLUDING FIRE ALARM EQUIPMENT. VERIFY IN FIELD.

NOTE: EXISTING POWER POLES AND GONDOLAS BEING RELOCATED BASED ON THE FINAL MERCHANDISE PLAN. GC SHALL COORDINATE WITH FINAL MERCHANDISE PLAN TO IDENTIFYING GONDOLAS AND POWER POLES TO BE RELOCATED AND SHALL RELOCATE AS REQUIRED. RECONNECT GONDOLA WIRING CHASE CIRCUITS TO EXISTING CIRCUITS. VERIFY CHASE IS WORKING AFTER INSTALLATION.

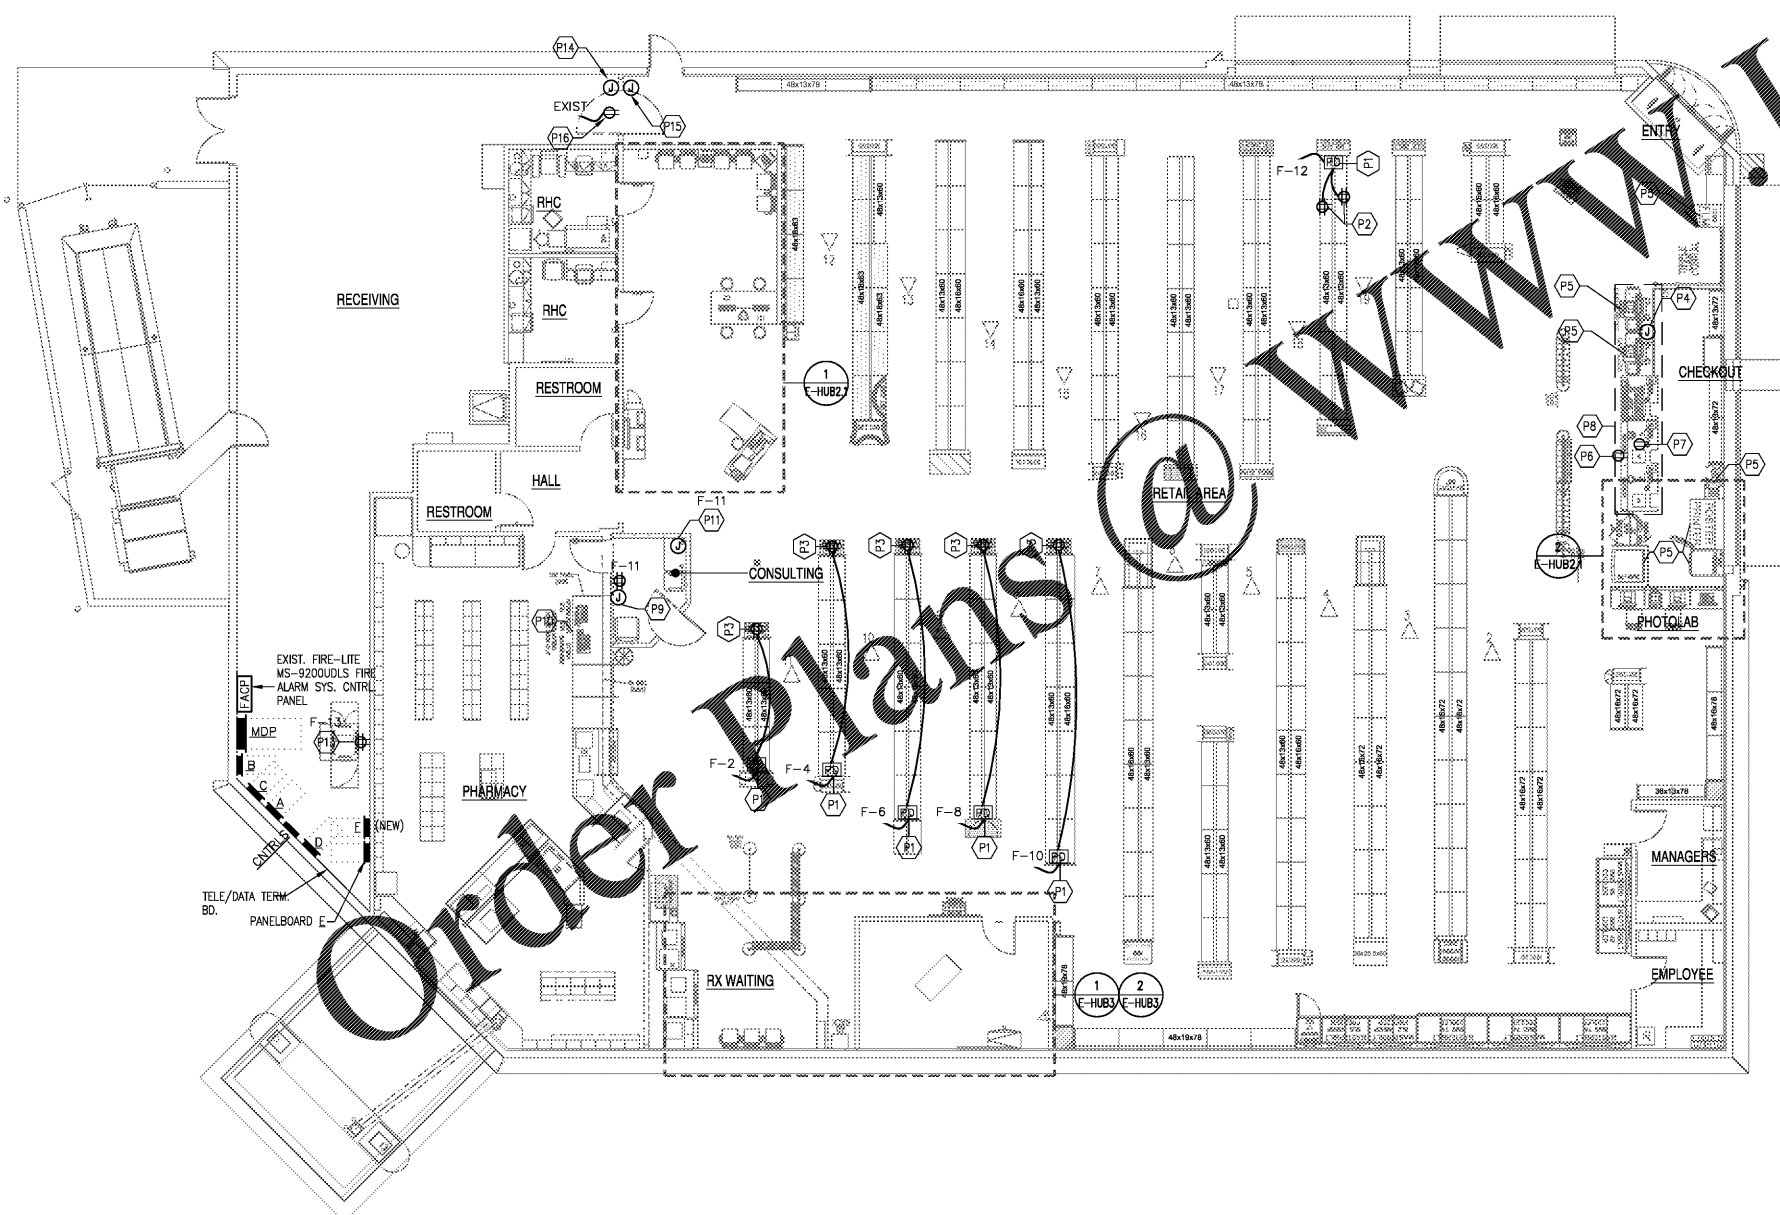

1 NEW POWER PLAN
E4 SCALE: 1/8" = 1'-0"




HEALTH HUB/Rx CONSULTATION
STORE NUMBER: 4176

11 RIVER RIDGE DRIVE, OAKLEY PLAZA
ASHEVILLE, NC 28803
CAP CODE: 90


CS PROJECT NUMBER: 146740

ARCHITECT OF RECORD:

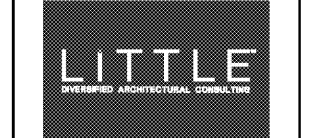


115 S. College St. Ste. 4000 Charlotte, NC 28217
T: 704.825.8350 F: 704.861.9700
www.littleonline.com

This drawing and the design shown are the property of Little Architectural Consulting. The reproduction, copying or other use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.
© Little 2019

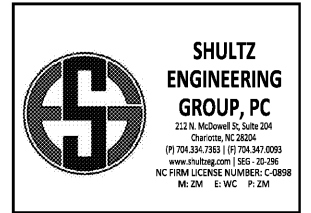

DEVELOPER:

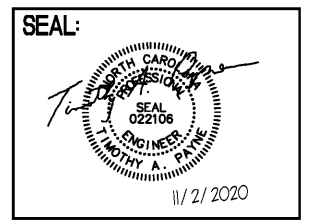

REVISIONS:

DRAWING BY: WC
CVS PROJECT MANAGER: RJ
DATE: 11-02-2020
JOB NUMBER: 121-14217-08
TITLE:

POWER PLANS
SHEET NUMBER:

E4

COMMENTS: