




- GENERAL NOTES:**
- CONTRACTOR SHALL VERIFY/COORDINATE LOCATION OF ALL POWER & DATA OUTLETS FOR EQUIPMENT. OBTAIN OWNERS APPROVAL BEFORE ROUGH IN. NO EXCEPTIONS. NO ADDITIONAL COMPENSATION SHALL BE AWARDED FOR ANY ADDITIONAL WORK REQUIRED TO RELOCATE OUTLETS DUE TO CONTRACTOR'S FAILURE TO COORDINATE WITH OWNER.
  - OIL CHANGE BUILDING IS CLASSIFIED AS MINOR REPAIR GARAGE.

- NOTES:**
- 3/4" CONDUIT STUBBED UP 18" FROM OPENING WHERE POWER & DATA TURNS UP INTO WORK PEDESTAL. PROVIDE FLEXIBLE CONDUIT INTO WORK PEDESTAL. COORDINATE WITH CLEAR COM BEFORE ROUGHING IN.
  - HOMERUN 3/4" EC TO TELEPHONE BACKBOARD ON EQUIPMENT PLATFORM.
  - HOMERUN TO 20A, 1 POLE CIRCUIT BREAKER IN PANELBOARD PPOC THROUGH LIGHTING CONTACTOR OC-2.

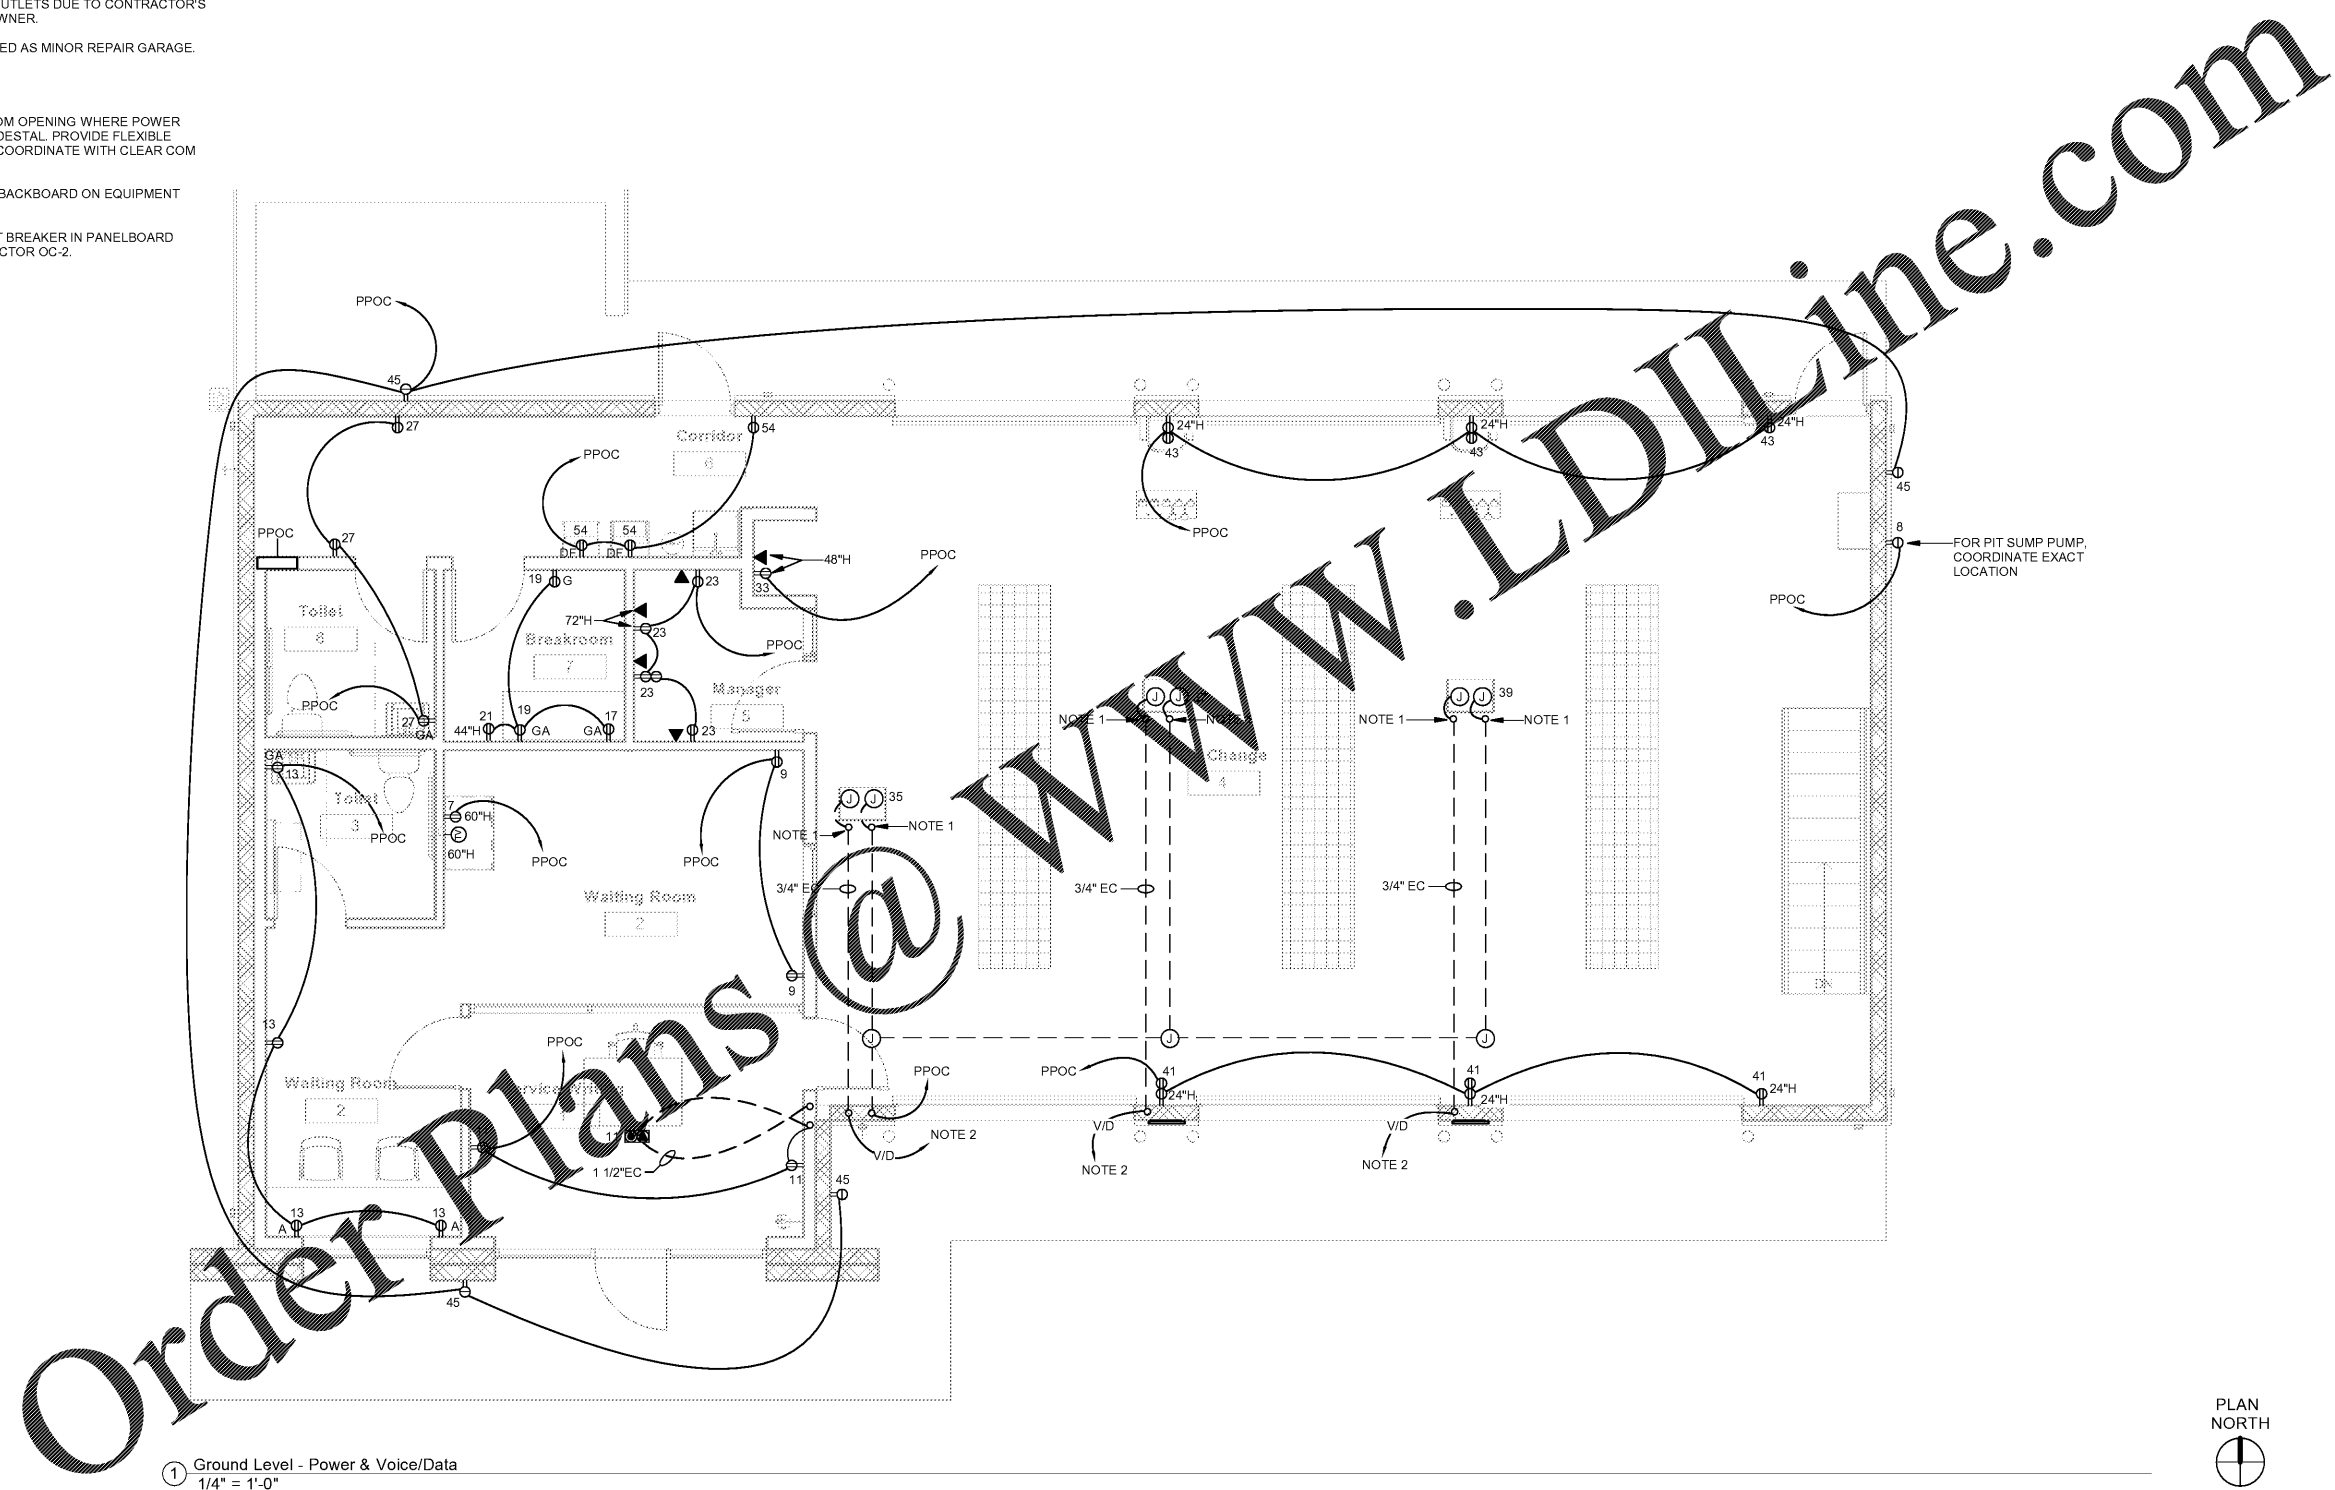

1 Ground Level - Power & Voice/Data  
1/4" = 1'-0"



**Express Oil Change & Tire Engineers**  
 Right Hand Oil Change Building (Hurricane)  
 2265 O'Neal Lane  
 Baton Rouge, LA 70816

FINAL

No.	Description	Date

© 2020 Aho Architects, LLC. All Rights Reserved.

**Ground Floor Plan - Power & Voice/Data**

Project number	20025
Date	08/27/2020
Drawn by	TH
Checked by	NB
<b>OC-E300</b>	
Scale	1/4" = 1'-0"



8/27/2020 2:01:01 PM