


SERVICE BLDG ROOF FRAMING PLAN

1/8" = 1'-0"


Sheet Notes:

1. See Sheet No. S0.x for typical details and general notes.
2. Reference all elevations to finish floor elevation (+) 0'-0".
3. Roof construction 5/8" plywood deck with H-clips. Attach with 8d nails @ 6" o.c.
4. Roof slope = 8"/12".
5. Refer to architectural drawings for all dimensions, slopes, elevations, etc... not illustrated on this plan. Coordinate all final dimensions and elevations with architectural.
6. Truss loading: Top Chord Dead Load = 10 psf, Bottom Chord Dead Load = 10 psf, use Total dead load = 20 psf for wind load calculation.
7. Truss requirements: (note that all of these requirements must be included in the truss submittal prior to receiving approval)
 - a) Furnish design calculations sealed by a Professional Engineer licensed in the state in which the project occurs for all truss members.
 - b) Truss manufacturer shall specify and provide all truss to truss and truss to purlin connections, and not contain mention of "by others" in relation to design.
 - c) Truss manufacturer shall be responsible for providing and illustrating all necessary anchor bolts and bracing required.

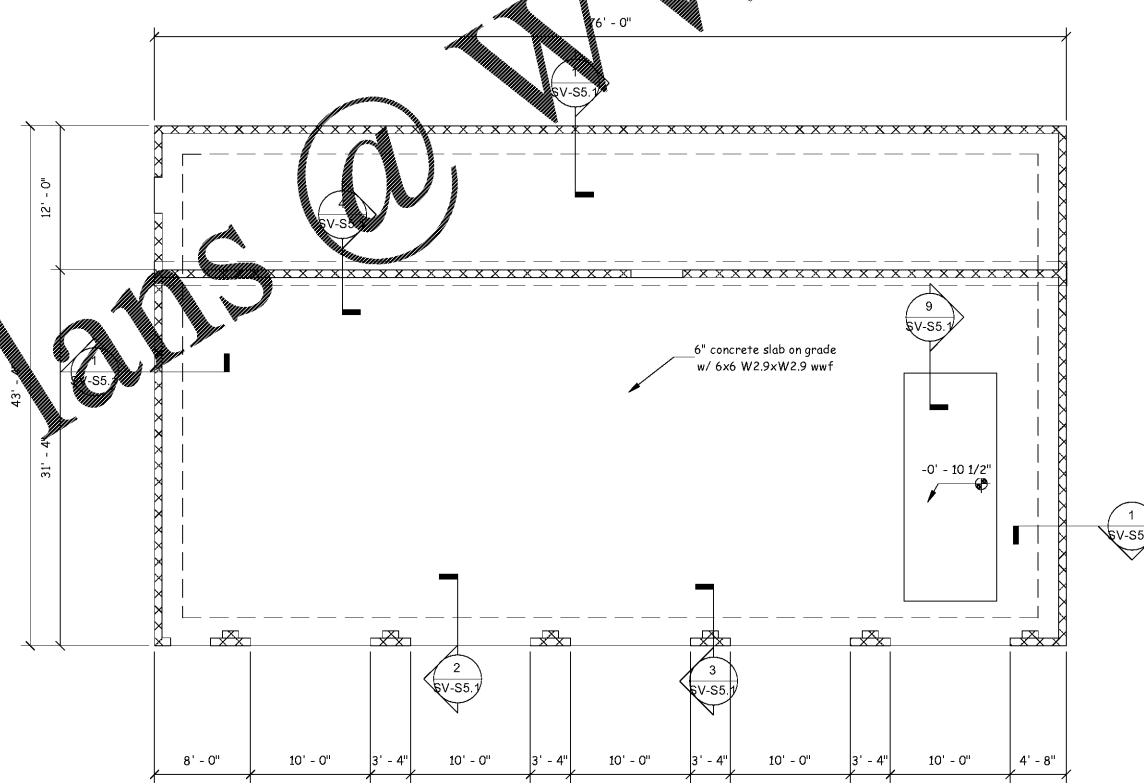

SERVICE BLDG FOUNDATION PLAN

1/8" = 1'-0"



40" Jamb
3/4" = 1'-0"

Order Plans @ WWW.LDILine.com

Express Oil Change & Tire Engineers
Service Building (Hurricane)
2265 O'Neal Lane
Baton Rouge, LA 70816

FINAL

No.	Description	Date

© 2020 Aho Architects, LLC. All Rights Reserved.

Foundation and Roof Framing Plan

Project number	20025
Date	08.27.2020
Drawn by	jcj
Checked by	jd

SV-S1.1

Scale As indicated

