




Order Plans @ www.LDOnline.com

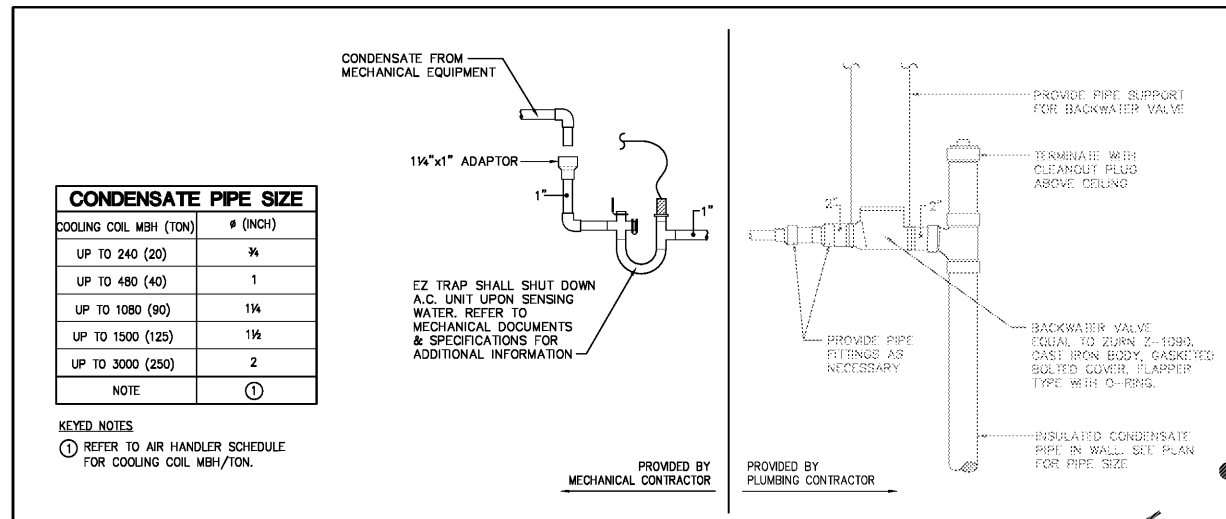


CEILING HUNG AIR HANDLER CONDENSATE DRAIN AND TRAP DETAIL
NO SCALE. TYP. OF AH-1-1 & QAH 1-1X

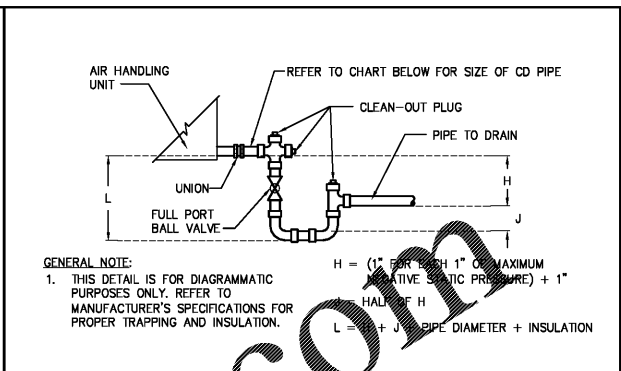

DRAW-THRU COIL CONFIGURATION
TYP. OF AH-1-1 & QAH 1-1X

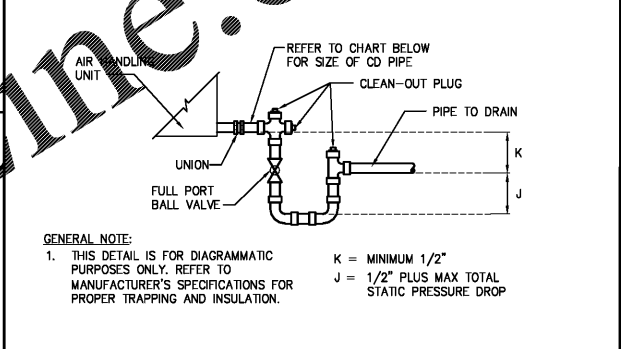

BLOW-THRU COIL CONFIGURATION
TYP. OF AH-2-1 & AH-2-2

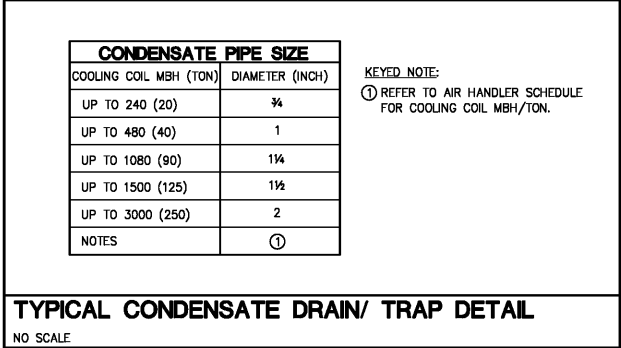

TYPICAL CONDENSATE DRAIN/ TRAP DETAIL
NO SCALE.

ENGINEERING MATRIX, INC.
CONSULTING ENGINEERS
2880 SCHERER DRIVE, SUITE 640
ST. PETERSBURG, FLORIDA 33716
(727) 321-4668 FAX (727) 321-8082 EMAIL: enr@matrix.com
CERT. OF AUTHORIZATION NO. 4898 EMT JOB NO. 19-0960
© 2019 Engineering Matrix, Inc. DRAWN BY: RCM CHECKED BY: JSW

FleischmanGarcia
ARCHITECTS • ENGINEERS • INTERIORS
3511 WINDY PARK AVENUE, SUITE 300
TALLAHASSEE, FLORIDA 32310
PHONE: (904) 842-8991
FAX: (904) 842-8923
REGISTRATION NUMBER: AA 000237

Pasco County Fire & Rescue Station No. 17
New Port Richey, Florida

THIS PERSON AND DRAWING IS THE SOLE PROPERTY OF PASCO COUNTY. NO PART OF THIS WORK MAY BE REPRODUCED WITHOUT THE WRITTEN PERMISSION FROM FLEISCHMAN-GARCIA.
I CERTIFY TO THE BEST OF MY KNOWLEDGE THAT THESE DRAWINGS COMPLY WITH ALL RELEVANT BUILDING CODES.

FGA PROJECT NUMBER
19039

ISSUE DATE
05-25-20

REVISIONS
DATE: _____
DATE: _____
DATE: _____

SHEET NUMBER
M3.3

MECHANICAL DETAILS A1 WTS