


05-21-20
E:\new\19039\FGA\19039_FGA_CPA Fire Station 17\Backdoor\19-0806_F4_1_14_2_Floor_Plane-2SYSTEMS.dwg

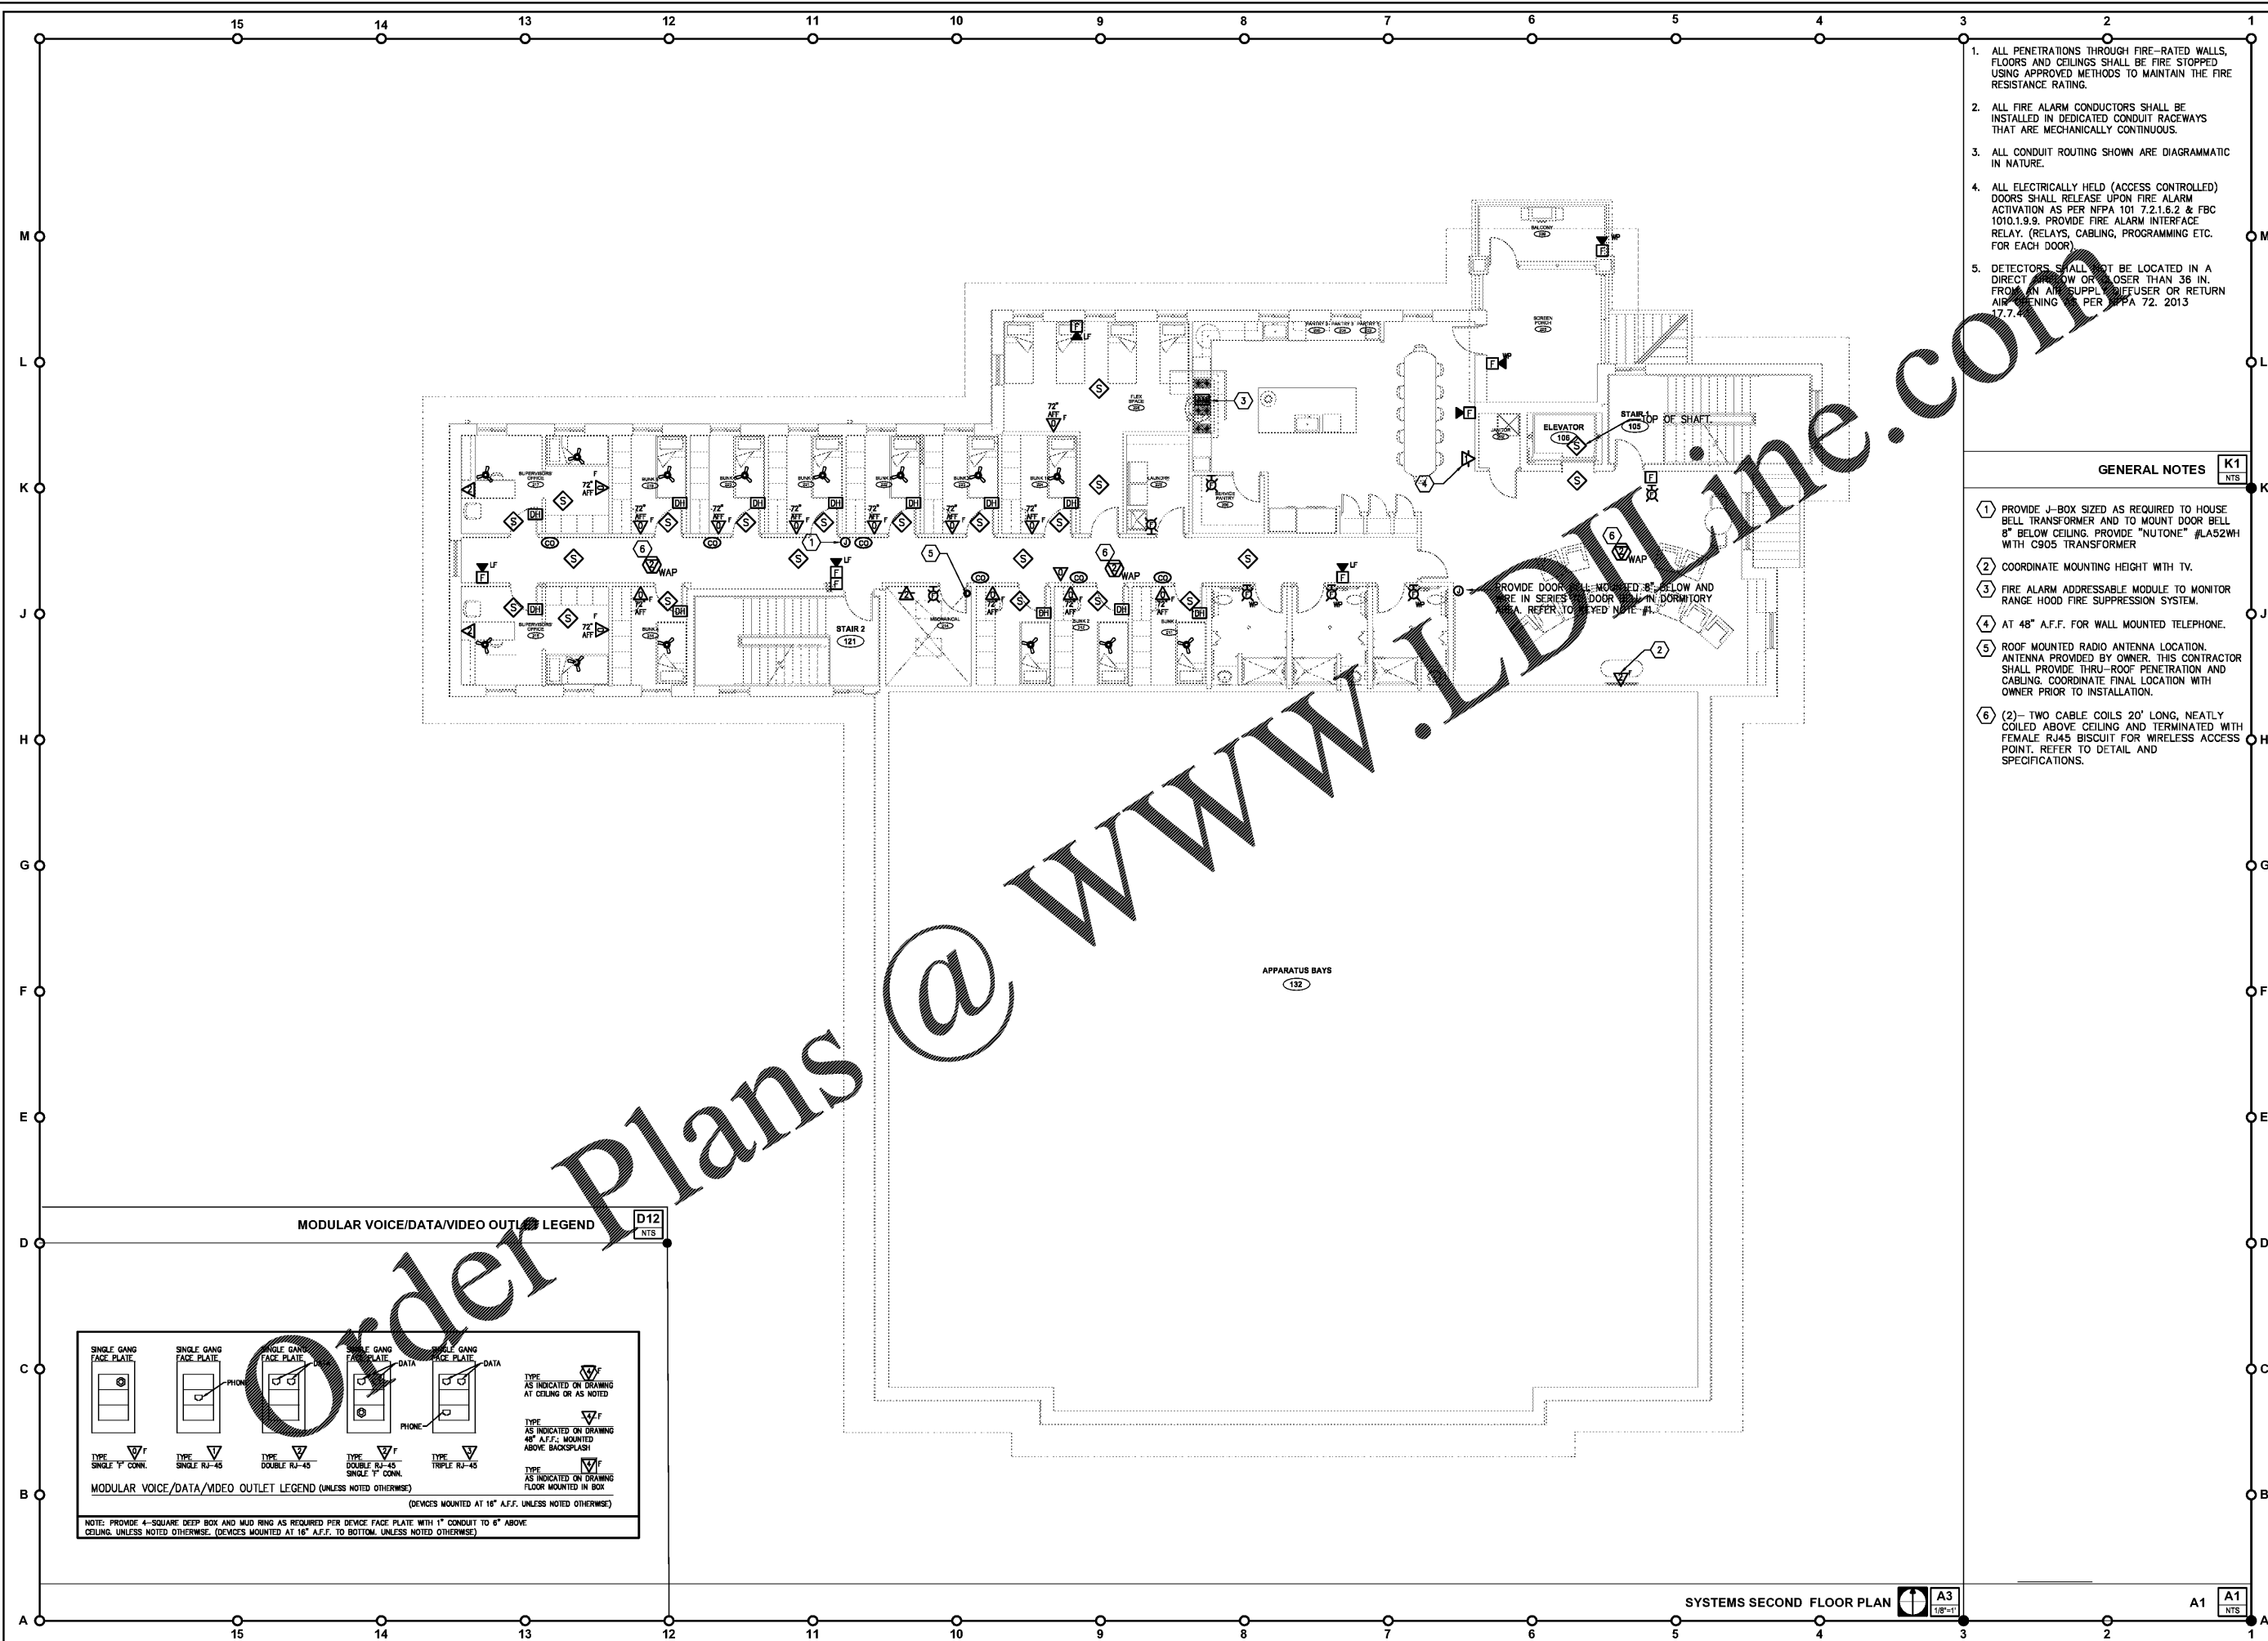


1. ALL PENETRATIONS THROUGH FIRE-RATED WALLS, FLOORS AND CEILINGS SHALL BE FIRE STOPPED USING APPROVED METHODS TO MAINTAIN THE FIRE RESISTANCE RATING.
2. ALL FIRE ALARM CONDUCTORS SHALL BE INSTALLED IN DEDICATED CONDUIT RACEWAYS THAT ARE MECHANICALLY CONTINUOUS.
3. ALL CONDUIT ROUTING SHOWN ARE DIAGRAMMATIC IN NATURE.
4. ALL ELECTRICALLY HELD (ACCESS CONTROLLED) DOORS SHALL RELEASE UPON FIRE ALARM ACTIVATION AS PER NFPA 101 7.2.1.6.2 & FBC 1010.1.9.9. PROVIDE FIRE ALARM INTERFACE RELAY. (RELAYS, CABLING, PROGRAMMING ETC. FOR EACH DOOR)
5. DETECTORS SHALL NOT BE LOCATED IN A DIRECT FLOW OF AIR OR WITHIN 36 IN. FROM AN AIR SUPPLY DIFFUSER OR RETURN AIR OPENING PER NFPA 72, 2013 17.7.4.

GENERAL NOTES K1 NTS

- 1 PROVIDE J-BOX SIZED AS REQUIRED TO HOUSE BELL TRANSFORMER AND TO MOUNT DOOR BELL 8" BELOW CEILING. PROVIDE "NUTONE" #LA52WH WITH C905 TRANSFORMER
- 2 COORDINATE MOUNTING HEIGHT WITH TV.
- 3 FIRE ALARM ADDRESSABLE MODULE TO MONITOR RANGE HOOD FIRE SUPPRESSION SYSTEM.
- 4 AT 48" A.F.F. FOR WALL MOUNTED TELEPHONE.
- 5 ROOF MOUNTED RADIO ANTENNA LOCATION. ANTENNA PROVIDED BY OWNER. THIS CONTRACTOR SHALL PROVIDE THRU-ROOF PENETRATION AND CABLING. COORDINATE FINAL LOCATION WITH OWNER PRIOR TO INSTALLATION.
- 6 (2) - TWO CABLE COILS 20' LONG, NEATLY COILED ABOVE CEILING AND TERMINATED WITH FEMALE RJ45 BISCUIT FOR WIRELESS ACCESS POINT. REFER TO DETAIL AND SPECIFICATIONS.

MODULAR VOICE/DATA/VIDEO OUTLET LEGEND D12 NTS

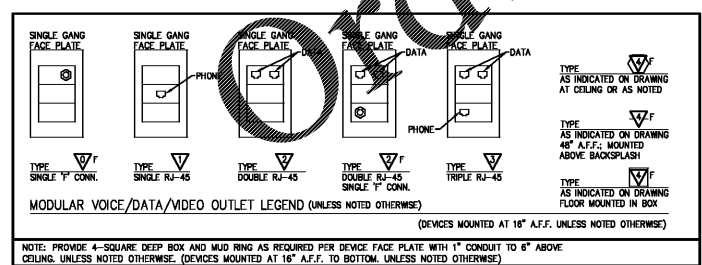

ENGINEERING MATRIX, INC.
 CONSULTING ENGINEERS
 2880 SCHEERER DRIVE, SUITE 640
 ST. PETERSBURG, FLORIDA, 33716
 (727) 372-4668 FAX(727) 372-8062 EMAIL: em@matrixeng.com
 CERT. OF AUTHORIZATION NO. 4289 EMI JOB NO. 19-0800
 © 2019 Engineering Matrix, Inc. DRAWN BY: EM CHECKED BY: JSW

FleischmanGarcia
 ARCHITECTS
 2501 PARK AVENUE, SUITE 300
 TAMPA, FLORIDA 33613
 PHONE (813) 281-4000
 FAX (813) 281-3000
 REGISTRATION NUMBER: AA 000227

**Pasco County
 Fire & Rescue Station
 No. 17**
 New Port Richey, Florida

THIS DESIGN AND DRAWING IS THE SOLE PROPERTY OF FLEISCHMAN-GARCIA ARCHITECTS. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN. IT IS NOT TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT THE WRITTEN PERMISSION OF FLEISCHMAN-GARCIA ARCHITECTS.

FGA PROJECT NUMBER
19039

ISSUE DATE
05-25-20

REVISIONS

△	DATE: _____
△	DATE: _____
△	DATE: _____

SHEET NUMBER
E4.2