


- NOTES THIS DETAIL:
- COORDINATE WITH ARCHITECTURAL DRAWINGS. MONITOR SIZE AND LOCATION. A/V BOX SHALL BE MOUNTED AT CENTER OF MONITOR.
 - COORDINATE DISPLAY MOUNT LOCATION WITH A/V J-BOX.
 - ALL J-BOXES ARE 4"-SQUARE 2-1/8" DEEP UNLESS OTHERWISE NOTED.
 - CONTRACTOR SHALL PROVIDE ALL EQUIPMENT SHOWN, POWER ADAPTERS, CABLES, BRACKETS, WALL PLATES AND MOUNTING HARDWARE FOR COMPLETE FUNCTIONAL SYSTEM.
 - REFER TO SPECIFICATIONS FOR TV REQUIREMENTS.

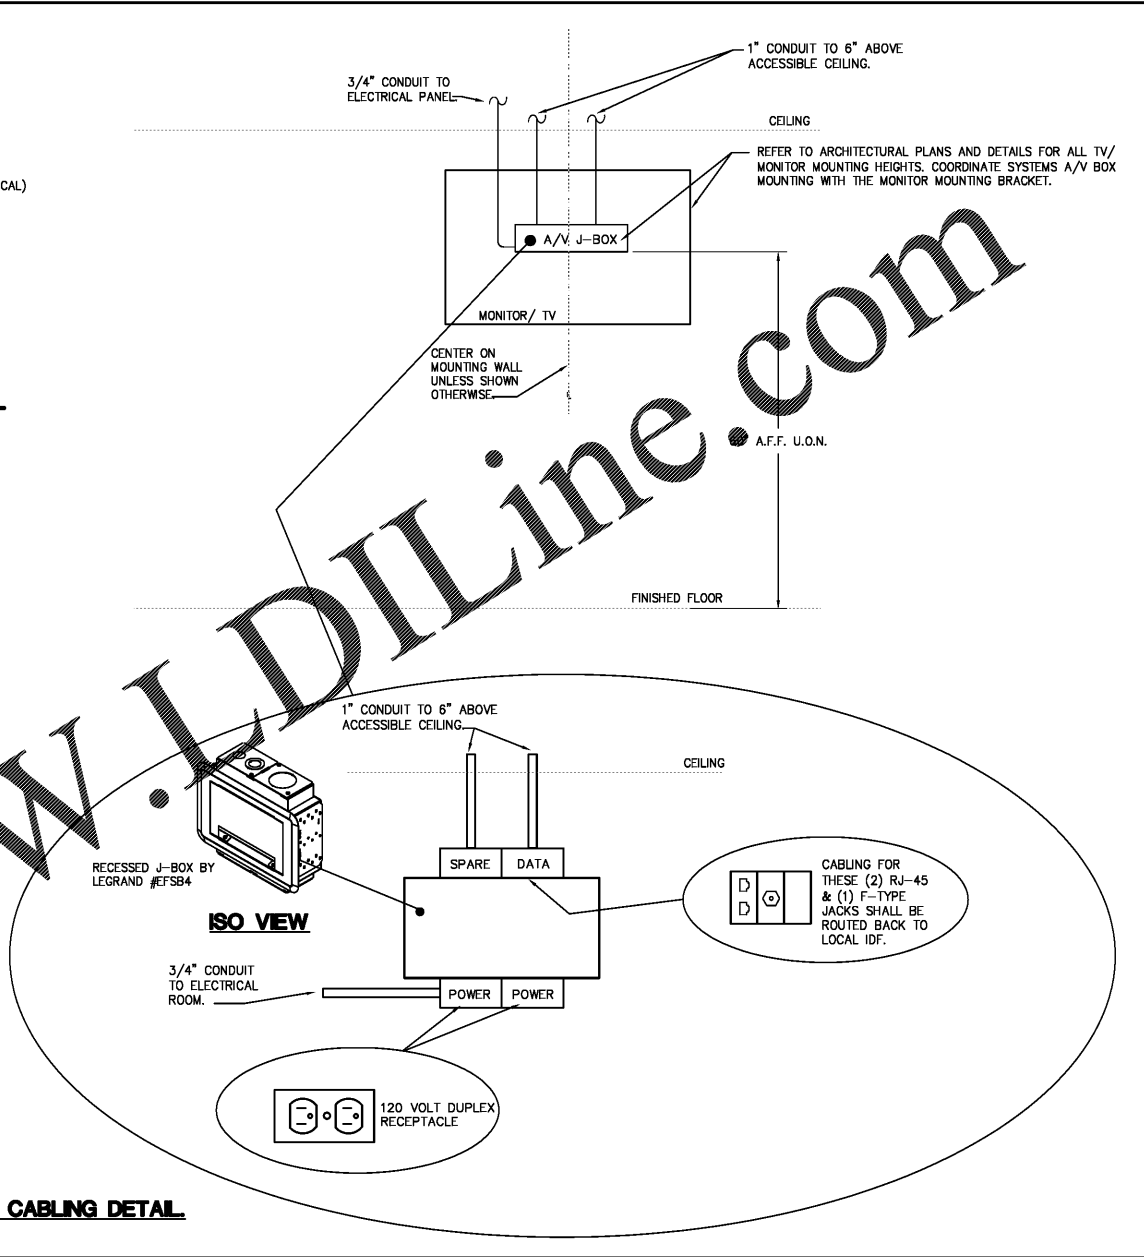

ENGINEERING MATRIX, INC.
 CONSULTING ENGINEERS
 2880 SCHERER DRIVE, SUITE 640
 ST. PETERSBURG, FLORIDA 33716
 (727) 321-4668 FAX (727) 321-8082 EMAIL: em@matrixinc.com
 CERT. OF AUTHORIZATION NO. 4288 E.M. JOB NO. 19-0960
 © 2019 Engineering Matrix, Inc. DRAWN BY: EM CHECKED BY: JSW

FleischmanGarcia
 ARCHITECTS
 2511 WYOMING AVENUE, SUITE 300
 TAMPA, FLORIDA 33606
 PHONE (813) 281-1400
 FAX (813) 281-3800
 REGISTRATION NUMBER: AA 000237

Pasco County Fire & Rescue Station No. 17
 New Port Richey, Florida

THIS PERSON AND DRAWING IS THE SOLE PROPERTY OF FLEISCHMAN-GARCIA ARCHITECTS AND PART OF THIS WORK AND BE REPRODUCED WITHOUT THE WRITTEN PERMISSION FROM FLEISCHMAN-GARCIA ARCHITECTS.

LETTER TO THE BEST OF MY KNOWLEDGE, PART OF THESE DRAWINGS COMPLY WITH ALL RELEVANT BUILDING CODES.

FGA PROJECT NUMBER
19039

ISSUE DATE
05-25-20

REVISIONS
 DATE: _____
 DATE: _____
 DATE: _____

SHEET NUMBER
E5.3

Order Plans

WWW.IDILine.com