



CRICKETS SHALL BE LOCATED AT THE EQUIPMENT AS INDICATED. MINIMUM CRICKET SLOPE: 1/2" PER FOOT.

ROOF PLAN 1/4"=1'-0" **A**

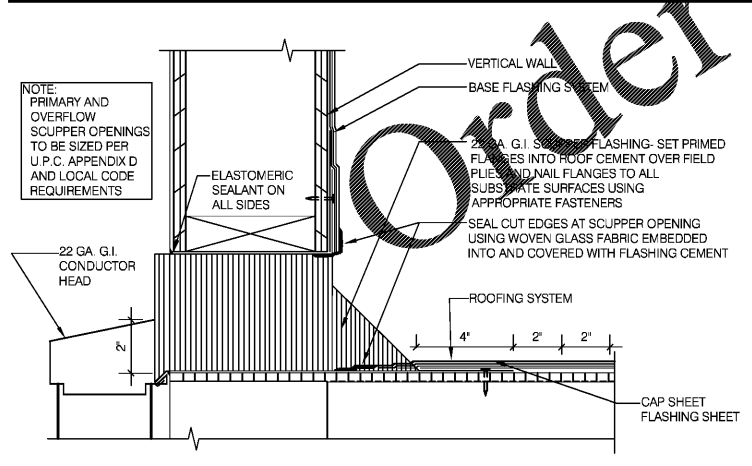

SCUPPER FLASHING **D**

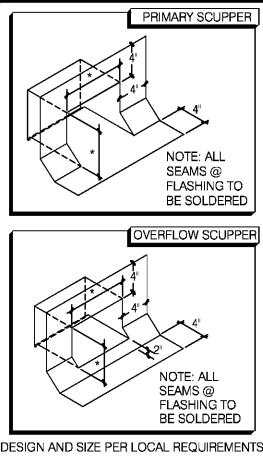

WATERPROOFING:

A. PAINT UNDERSIDE OF PARAPET CAP FLASHING WITH FACTORY BONDED PAINT GRIP OR PRIMER

B. TOP NAILING AT PARAPET CAP FLASHING WILL NOT BE ACCEPTED.

C. PENETRATIONS IN ROOFING MEMBRANE AND FLASHING SHALL ONLY BE MADE AS INDICATED ON THE DRAWINGS OR SPECS

D. SEE SPECIFICATIONS FOR SEALANT SPECS

E. ALL SHEET MTL FLASHING SHALL BE 22 GA MIN.

MISCELLANEOUS:

A. ROOF PENETRATIONS CLOSER THAN 12" FROM ANOTHER WILL NOT BE ALLOWED

B. EXHAUST FANS MIN. 10'-0" AWAY FROM ALL AIR INTAKE / SUPPLY

C. LOCATE WALK-IN CONDENSERS ON ROOF ONLY IF REQUIRED BY CODE

ROOF PLAN NOTES **C**

- (2) KITCHEN HOOD EXHAUST FAN. SEE SHEETS M3.0 & DETAIL 19/A6.0.
- (5) ROOF HATCH: SEE 7/A6.0.
- (9) PIPE HOOD FOR UTILITIES. SEE DETAIL 9/A6.0.
- (10) 24x36 WALK MATS. SEE ROOF SPECS
- (14) CHANGE IN PARAPET ELEVATION, SEE 14/A6.2
- (15) ROOF CRICKET. SEE DETAIL 16/A6.0
- (16) METAL PARAPET CAP
- (17) MAINTAIN MANUFACTURERS ROOFTOP UNIT MAINTENANCE CLEARANCE
- (19) WASTE VENT THROUGH ROOF. THE TOP OF WASTE VENTS SHALL BE 12" HIGHER THAN THE CLOSEST PARAPET CAP U.N.O. OR NOT ALLOWED BY LOCAL JURISDICTION.
- (21) 'DURO-LAST' SINGLE PLY ROOF MEMBRANE OVER MINIMUM R-20 RIGID INSULATION BOARD OVER 5/8" APA RATED EXTERIOR GRADE PLYWOOD OVER TRUSSES. INSTALL PER MANUFACTURER'S SPECIFICATIONS.
- (22) OVERFLOW SCUPPER. REFER TO DIA3.0 FOR ADDITIONAL INFORMATION.
- (25) WATER HEATER VENT

KEY NOTES **B**

CONTRACT DATE:	11/17/20
BUILDING TYPE:	ENDEAVOR MED 40
PLAN VERSION:	SEPT 2020
BRAND DESIGNER:	200109
SITE NUMBER:	297222
STORE NUMBER:	003717
ARCVISION:	200188

TACO BELL
6151 HWY 278 NW
COVINGTON, GA 30014



ROOF PLAN
A3.0

FREDERICK J. GOGLIA
ARCHITECT, NCARB, FDI
1850 CRAIG ROAD, SUITE 300
ST. LOUIS, MO 63146
PH. (314) 415-2400 FAX (314) 415-2300
www.arjcv.com