Order Plans @ www.BIMline.com

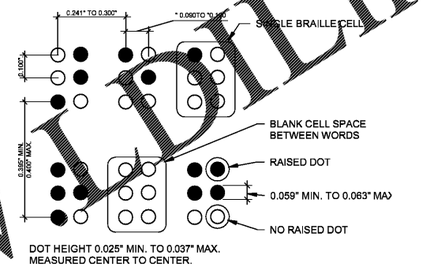

DOT HEIGHT 0.025" MIN. TO 0.037" MAX.
MEASURED CENTER TO CENTER.

BRAILLE MEASUREMENT 1/4" = 1'-0" | **6**

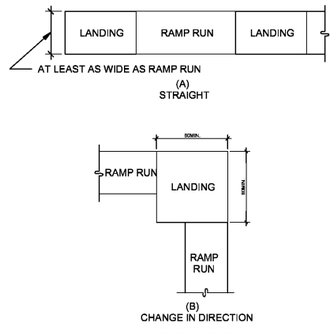

RAMP LANDINGS



BARRIER PREVENTS PASSAGE OF 4" SPHERE WITH ANY PORTION WITHIN 4 OF FLOOR

EDGE PROTECTION OPTIONS

RAMPS 3/16" = 1'-0" | **8**

NOTES:
1. OPEN RISERS ARE NOT PERMITTED.
2. TREAD SURFACES SHALL COMPLY WITH (FLOOR OR GROUND SURFACES & CHANGE LEVEL) DETAIL.
3. THE LEADING 2" OF THE TREAD SHALL HAVE VISUAL CONTRAST OF DARK-ON-LIGHT LIGHT-ON-DARK FROM THE REMAINDER OF THE TREAD.
4. HANDRAIL GRIPPING SURFACES SHALL BE CONTINUOUS ALONG THEIR LENGTH AND SHALL NOT BE OBSTRUCTED ALONG THEIR TOPS OR SIDES. THE BOTTOM OF THE HANDRAIL GRIPPING SURFACES SHALL NOT BE OBSTRUCTED FOR MORE THAN 20 PERCENT OF THE LENGTH. WHERE PROVIDED, HORIZONTAL PROJECTIONS SHALL OCCUR 1-1/2" MINIMUM BELOW THE BOTTOM OF THE HANDRAIL GRIPPING SURFACE.
5. HANDRAIL GRIPPING SURFACES WITH CIRCULAR CROSS SECTIONS SHALL HAVE AN OUTSIDE DIAMETER OF 1-1/4" (32 MM) MINIMUM AND 2" MAXIMUM.
6. HANDRAIL GRIPPING SURFACES AND ANY SURFACES ADJACENT TO THEM SHALL BE OF SHARP OR ABRASIVE ELEMENTS AND SHALL HAVE ROUNDED EDGES.
7. HANDRAILS SHALL NOT ROTATE WITHIN THEIR FITTINGS.



TREADS AND RISERS FOR ACCESSIBLE STAIRWAYS



STAIR NOSINGS



HANDRAIL HEIGHT

HANDRAIL CLEARANCE



HORIZONTAL PROJECTIONS BELOW GRIPPING SURFACE



HANDRAIL NON-CIRCULAR CROSS SECTION

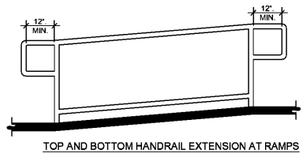

TOP AND BOTTOM HANDRAIL EXTENSION AT RAMPS



TOP HANDRAIL EXTENSION AT STAIRS



NOTE: X = TREAD DEPTH

BOTTOM HANDRAIL EXTENSION AT STAIRS

STAIRWAYS AND HANDRAILS 3/8" = 1'-0" | **4**

FREDERICK J. GOGLIA
ARCHITECT, NCARB, RDI
950 CRAIG ROAD, SUITE 300 ST. LOUIS, MO 63146
PH. (314) 415-2400 FAX (314) 415-2300 www.arcvi.com

CONTRACT DATE:	11/17/20
BUILDING TYPE:	ENDEAVOR MED 40
PLAN VERSION:	SEPT 2020
BRAND DESIGNER:	200109
SITE NUMBER:	297222
STORE NUMBER:	003717
ARCVISION:	200188

TACO BELL

6151 HWY 278 NW
COVINGTON, GA 30014

ENDEAVOR
"GO MOBILE"

ACCESSIBILITY REQUIREMENTS

ADA1.3