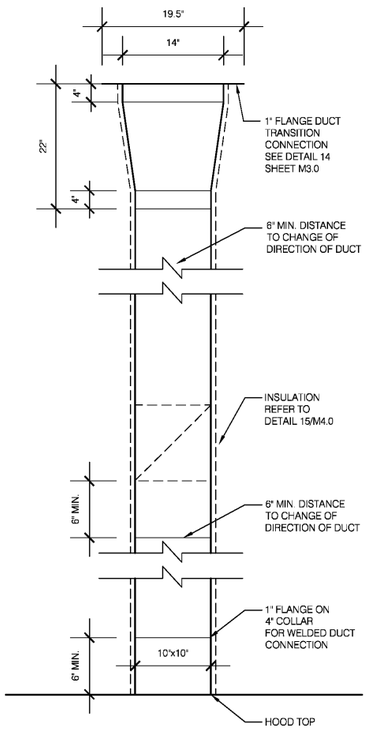

TB HOOD DUCT TRANSITION N.T.S. **11**

NOT USED N.T.S. **8**

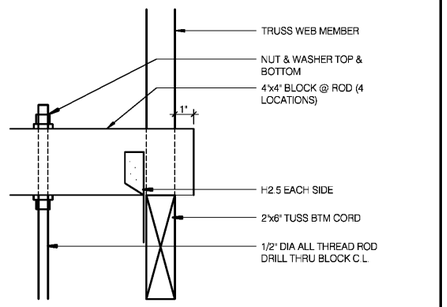

ROD ATTACHMENT N.T.S. **7**

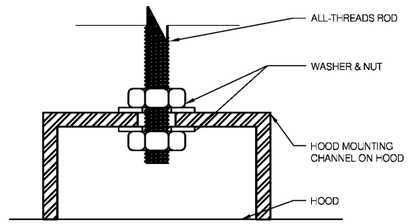

BOLT CONNECTION TO HOOD N.T.S. **4**

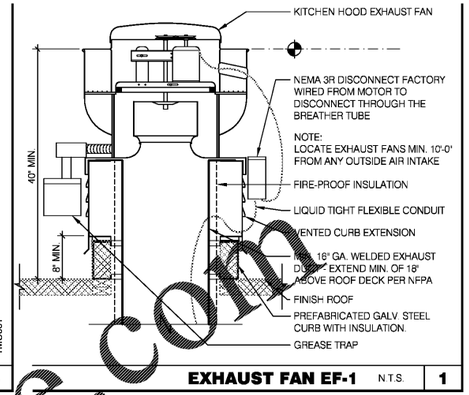

EXHAUST FAN EF-1 N.T.S. **1**

NOT USED N.T.S. **5**

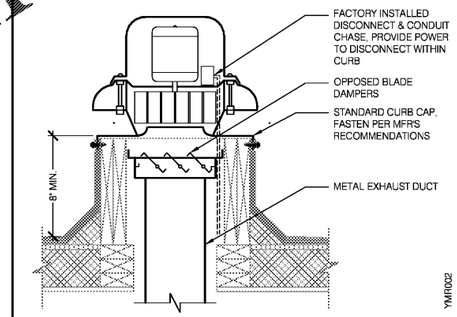

RESTROOM FAN (EF-2) N.T.S. **2**

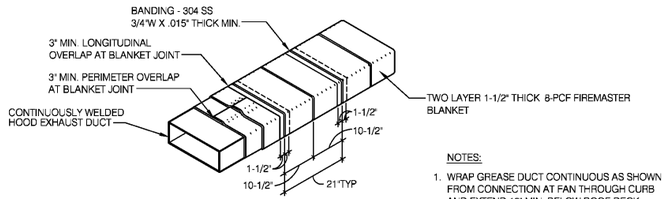

BANDING REQUIREMENTS: USE 304 STAINLESS STEEL BANDS A MAXIMUM 1-1/2" FROM BLANKET EDGE AND SPACED A MAXIMUM OF 10-1/2" ON CENTER.

NOTES:

1. WRAP GREASE DUCT CONTINUOUS AS SHOWN FROM CONNECTION AT FAN THROUGH CURB AND EXTEND 18" MIN. BELOW ROOF DECK.
2. FOR HORIZONTAL RUNS OF EXHAUST DUCTS PROVIDE TYPICAL TRAPEZE SUPPORT SYSTEM WITH 1/2" HANGER RODS A MAXIMUM OF 6' FROM INSULATION EDGE. TRAPEZE SUPPORT SHALL BE SPACED A MAXIMUM OF 60" ON CENTER BETWEEN CENTERLINE OF VERTICAL EXHAUST AND
3. SLOPE HORIZONTAL EXHAUST DUCT RUNS A MINIMUM OF 1/4" PER FOOT (2% SLOPE) TOWARDS EXHAUST HOOD.
4. PROVIDE INSULATED ACCESS DOOR OR PANEL NEAR EACH POINT OF EXHAUST DUCT RUN FOR CLEANING AND INSPECTION OF DUCT. PROVIDE AN APPROVED SIGN AT ACCESS DOOR OR PANEL WHICH READS " ACCESS PANEL DO NOT OBSTRUCT"

KITCHEN HOOD EXHAUST DUCT SYSTEM DETAIL N.T.S. **9**

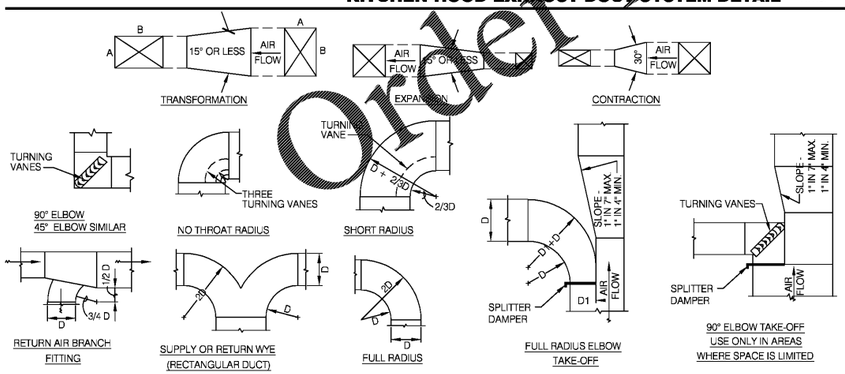

TYPICAL DUCTWORK DETAILS N.T.S. **10**

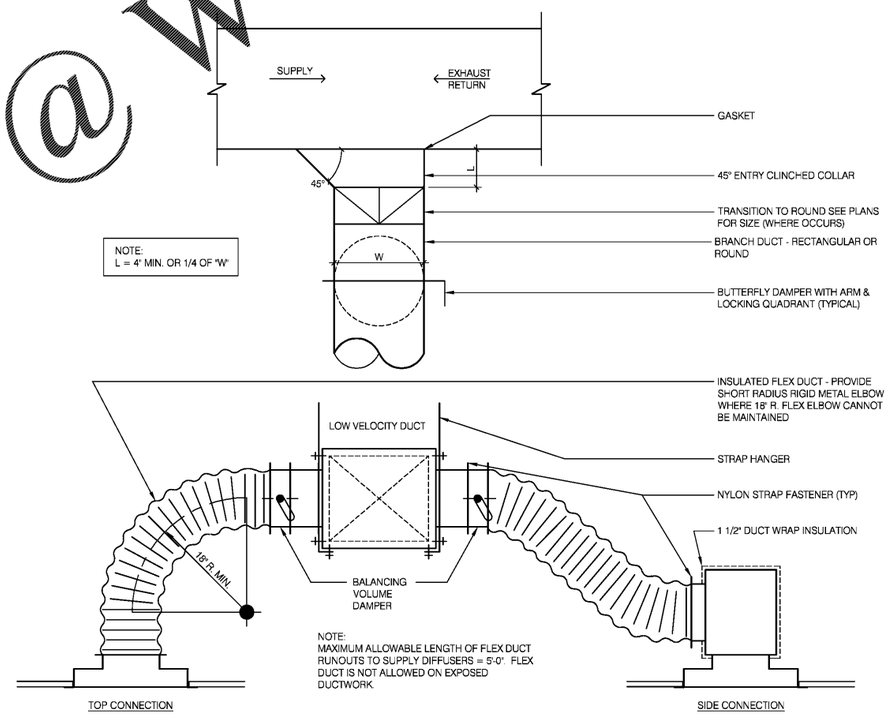

CEILING DIFFUSER CONNECTIONS N.T.S. **6**

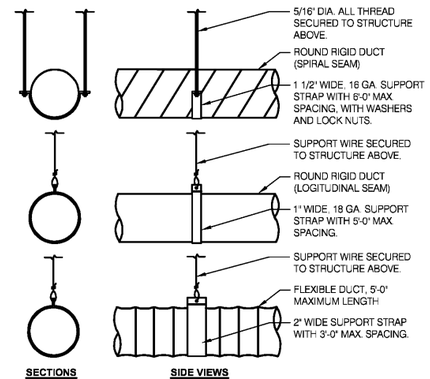

DUCT SUPPORT DETAIL **3**

Order Plans @ WWW.LDILine.com

ARCVISION INCORPORATED
ARCHITECTURE • ENGINEERING • STORE PLANNING
SAINT LOUIS / DALLAS / LAS VEGAS / ORLANDO
1950 CRAG ROAD, SUITE 300 ST. LOUIS, MO 63146
PH. (314) 415-2400 FAX (314) 415-2300 www.arcv.com

REVISION	FEB18

CONTRACT DATE:	11/17/20
BUILDING TYPE:	ENDEAVOR MED 40
PLAN VERSION:	SEPT 2020
BRAND DESIGNER:	200109
SITE NUMBER:	297222
STORE NUMBER:	003717
ARCVISION:	200188

TACO BELL
6151 HWY 278 NW
COVINGTON, GA 30014

TACO BELL
ENDEAVOR
"GO MOBILE"

MECHANICAL AND HOOD DETAILS

M4.0