


Order Plans

WWW.DIline.com

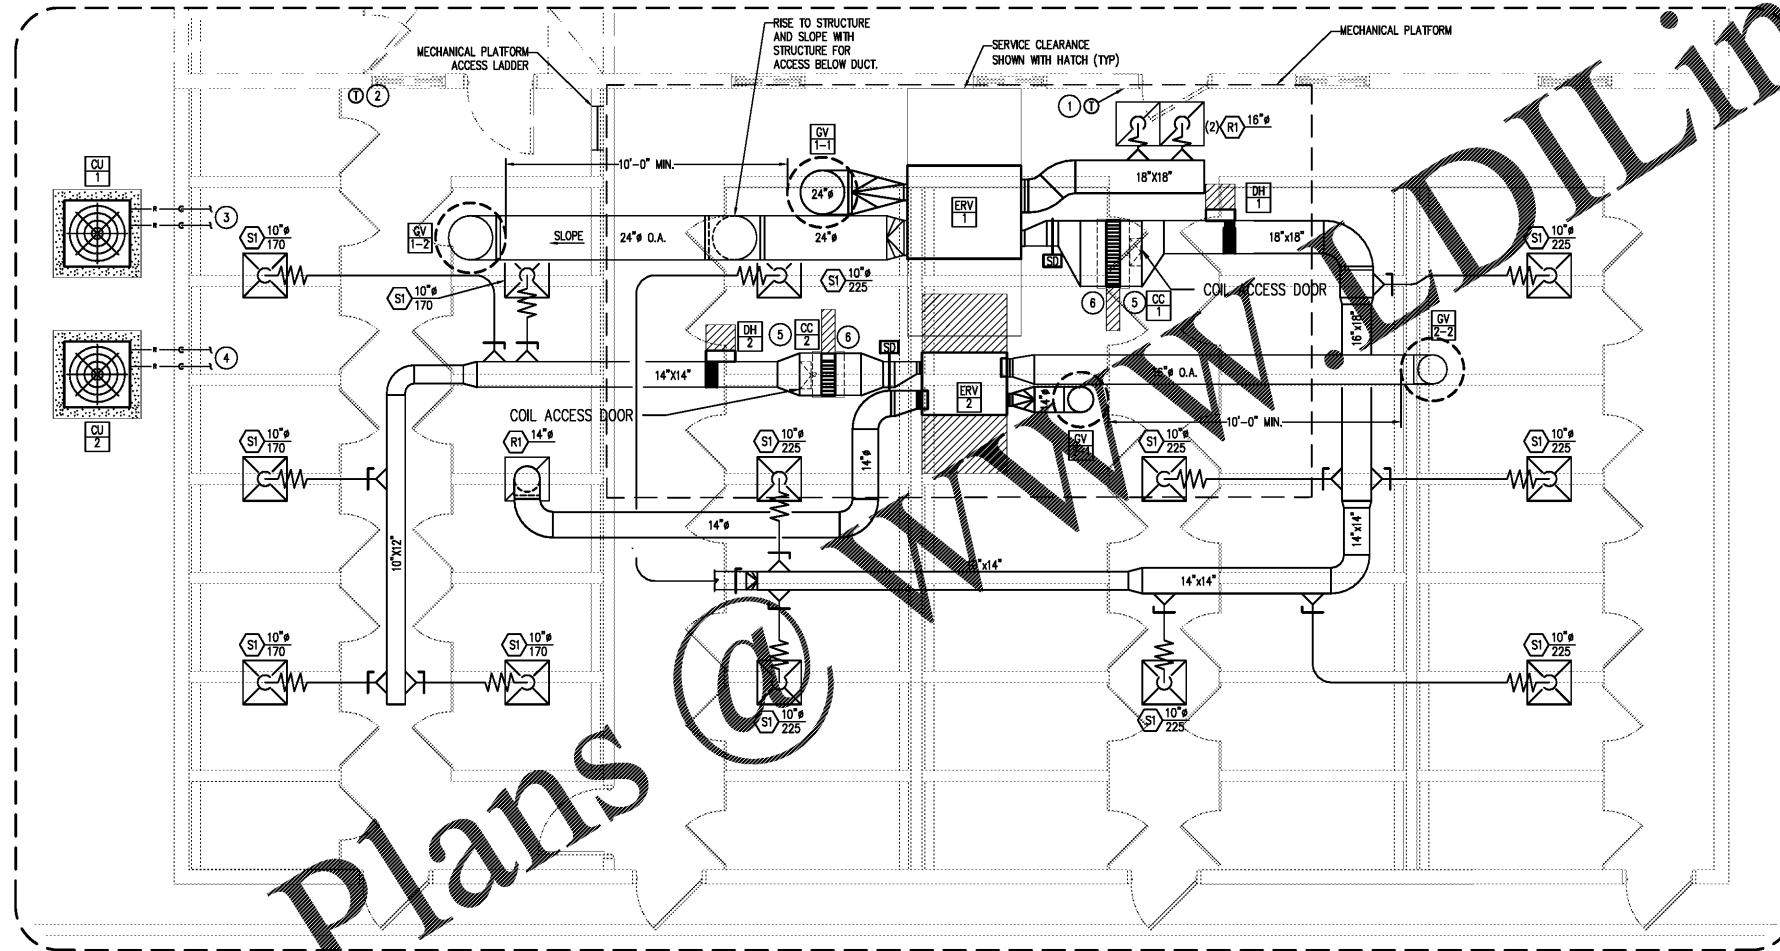

**KEYED NOTES: (THIS SHEET ONLY)**

- ① PROVIDE CONTROLS USING PROGRAMMABLE THERMOSTAT TO ENERGIZE COOLING WHEN SPACE TEMPERATURE IS ABOVE 80 DEGREES. THERMOSTAT SHALL PROVIDE DEHUMIDIFICATION SEQUENCE FOR TWO STAGE HEATER DH-1 AND COOLING COIL CC-1. SET POINT FOR HUMIDISTAT SHALL BE 60RPH FOR THIS SYSTEM. ERV-1 FANS SHALL OPERATE CONTINUOUSLY. SET THERMOSTAT FAN MODE TO "ON".
- ② PROVIDE CONTROLS USING PROGRAMMABLE THERMOSTAT TO ENERGIZE COOLING WHEN SPACE TEMPERATURE IS ABOVE 80 DEGREES. THERMOSTAT SHALL PROVIDE DEHUMIDIFICATION SEQUENCE FOR TWO STAGE HEATER DH-2 AND COOLING COIL CC-2. SET POINT FOR HUMIDISTAT SHALL BE 60RPH FOR THIS SYSTEM. ERV-2 FANS SHALL OPERATE CONTINUOUSLY. SET THERMOSTAT FAN MODE TO "ON".
- ③ ROUTE REFRIGERANT PIPES TO CC-1. ROUTE AND SIZE PER MANUFACTURER'S INSTRUCTIONS.
- ④ ROUTE REFRIGERANT PIPES TO CC-2. ROUTE AND SIZE PER MANUFACTURER'S INSTRUCTIONS.
- ⑤ PROVIDE CONDENSATE TRAP, SAFETY SWITCH AND ROUTE PIPING TO HUB DRAIN ON MEZZANINE.
- ⑥ PROVIDE AIR-TIGHT INSTALLATION FOR DUCT COIL. 18" UPSTREAM AND 18" DOWNSTREAM DUCT SHALL BE SAME SIZE AS DX COIL.

② ENLARGED MECHANICAL PLAN  
SCALE: 1/4"=1'-0"

BACKGROUND REVISED  
MECHANICAL WORK UNCHANGED

A NEW ADDITION TO  
**ROCKDALE COUNTY  
ANIMAL CONTROL**  
1506 ROCKBRIDGE ROAD, CONYERS, GA 30012

MARK	DATE	DESCRIPTION
△	12/17/19	KENNEL LOCATIONS

DATE: 11-01-18 PROJECT NUMBER: 18-059

DRAWN BY: JWK & KMP CHECK BY: KMP

SHEET TITLE:  
ENLARGED MECHANICAL PLANS - KENNELS

**M2.2**